

Beltz Well No. 12

Research Park Drive, Soquel, CA (Santa Cruz County)

Assessor's Parcel No. 030-18-170

Notice of Preparation / Initial Study

Lead Agency:

City of Santa Cruz
Water Department
212 Locust Street Suite C
Santa Cruz, CA 95060

Contact: Leah Van Der Maaten, P.E., Associate Civil Engineer

Date: December 8, 2010

DATE: December 8, 2010
TO: Public Agencies, Organizations and Interested Parties
FROM: Leah Van Der Maaten, Associate Civil Engineer
SUBJECT: Notice of Preparation of a Draft Environmental Impact Report in Compliance with Title 14, Section 15082(a), 15103, and 15375 of the California Code of Regulations

Pursuant to the State of California Public Resources Code and the “Guidelines for Implementation of the California Environmental Quality Act of 1970” as amended to date, this is to advise you that the Water Department of the City of Santa Cruz has prepared an Initial Study on the following project:

Project Name: Beltz Well No. 12 – Research Park Drive

Agencies: The City of Santa Cruz requests your agency’s views on the scope and content of the environmental information relevant to your agency’s statutory responsibilities in connection with the proposed project, in accordance with California Code of Regulations, Title 14, Section 15082(b).

Organizations And Interested Parties: The City of Santa Cruz Water Department requests your comments and concerns regarding the environmental issues associated with construction and operation of the proposed project.

Location: The Proposed Project site is located on a small parcel (APN 030-18-170) at the corner of Research Park Drive and Cory Street in the unincorporated community of Soquel, Santa Cruz County, California (see Figure 1, Project Location Map, and Figure 2, Proposed Project Site).

Project Site Description: The Proposed Project site is currently vacant, surrounded by a chain link fence, and undeveloped. Adjacent to the site, in a public right of way on Cory Street, is a City of Santa Cruz monitoring well. The Proposed Project site is located in an area designated as Service Commercial under the County of Santa Cruz General Plan. The adjacent surrounding properties are developed with commercial and light industrial land uses. The site is located within the County Urban Services Line (USL) boundary, the area that defines where urban services are provided.

Project Purpose: The purpose of the Proposed Project is to replace Beltz Well No. 4 in order to maintain the City’s historic groundwater production, to locate the replacement well farther inland to protect the Purisima aquifer from the threat of saltwater intrusion, and to improve the reliability and flexibility of the City’s groundwater well system.

Project Description: The City of Santa Cruz Water Department (City) provides water to the residents within the City of Santa Cruz, as well as additional customers outside of the City limits within the County of Santa Cruz, and a portion of the City of Capitola. Most of the City’s water supply comes from surface water sources. A small but important amount (approximately 5%) comes from groundwater supplies, augmenting the City’s water supply during peak demand season. Historically the City has produced groundwater in response to widely fluctuating hydrologic conditions with periods of little production during extremely wet years and periods of high production during drought conditions. The historic normal year groundwater production from the Live Oak well field is 645 ac-ft/yr, approximately 1 million gallons per day (MGD). The loss of Beltz Well No. 4 has impacted the City’s capacity to maintain a stable groundwater supply.

The replacement for Beltz Well No. 4 (Beltz Well No. 12) is proposed to be built on a vacant lot located at the northeast corner of the intersection of Research Park Drive and Cory Street in Soquel, California. Tentative well design would facilitate the use of either a submersible pump or a vertical line-shaft turbine pump. The replacement well would include the following components: (1) a pump and chemical building, approximately

12 feet in height; (2) an iron and manganese treatment system with pressurized filter tanks, approximately 10 feet in height; (3) a backwash tank for the iron and manganese treatment, approximately 15 feet in height; (4) a sand separator, approximately 7 feet in height, and (5) station piping including, but not limited to, a treated water pipeline, a sanitary sewer pipeline, and stormwater drainage facilities that would connect to existing facilities in Research Park Drive.

The replacement well will be drilled to an approximate depth of 320 feet below ground surface (bgs) to provide up to approximately 700 GPM of water, or 1MGD. Groundwater extracted from Beltz Well No.12 would be from the same zone of the Purisima aquifer as the existing Live Oak well field and Beltz Well No. 4. Pumping from Beltz Well No. 12 could be required for a period of up to seven months, corresponding to approximately April 15 to November 15. Production from Beltz Well No. 12 would not increase the City's groundwater extraction, but would redistribute existing City production from the Live Oak well field. While the City maintains the option to produce up to 645 ac-ft/yr from either the existing Live Oak well field or Beltz Well No. 12 in any water year type, typically the City would produce a portion of annual groundwater supplies from the existing Live Oak well field and a portion from Beltz Well No. 12. Redistributing the production away from the coast during certain years is essential to protecting the Purisima Aquifer from saltwater intrusion and maintaining the City's water level goals along the coast.

Environmental Issues: The City of Santa Cruz Water Department has prepared an Initial Study that describes the potential environmental effects of the proposed project. Based on the conclusions of the Initial Study, it has been determined that an EIR is the appropriate level of environmental documentation. The EIR will include the provision of alternatives.

Public Review Period: The City of Santa Cruz Water Department has determined to make this NOP and Initial Study available for public review and comment pursuant to California Code of Regulations, Title 14, Section 15082(b). The City of Santa Cruz Water Department will accept written comments for the NOP and Initial Study between December 17, 2010 and January 17, 2011

Public Scoping Meeting: The City of Santa Cruz Water Department will receive public input on the project and the NOP/IS during the 30-day scoping period, at a public meeting to be held on January 10, 2011 at 6:30 p.m. at the Best Western Capitola By-the-Sea Inn & Suites: 1435 41st Ave, Capitola, CA 95010. Comments from the community and interested parties are encouraged.

Responses And Comments: By 5:00 p.m., January 17, 2011, please indicate a contact person for your agency or organization and send your comments to:

Leah Van Der Maaten, P.E., Associate Civil Engineer
City of Santa Cruz, Water Department
212 Locust Street Suite C, Santa Cruz CA 95060

Comments may also be sent by FAX at (831) 420-5201

Document Availability: The Initial Study is available for public review during regular business hours at the locations listed below.

- City of Santa Cruz Water Department, Engineering, 212 Locust Street Suite C, Santa Cruz CA 95060
- Santa Cruz Public Library, Capitola Branch, 2005 Wharf Road, Capitola, CA 95010-2002
- Santa Cruz Public Library, Central Branch, 224 Church Street, Santa Cruz, CA 95060-38
- City of Santa Cruz website (www.cityofsantacruz.com)

TABLE OF CONTENTS

PAGE

I. PURPOSE OF THE NOTICE OF PREPARATION AND INITIAL STUDY1

II. BACKGROUND3

III. ENVIRONMENTAL SETTING & PROJECT DESCRIPTION.....3

A. INTRODUCTION3

B. DEPARTMENT OVERVIEW4

C. PURPOSE AND NEED FOR PROJECT7

D. PROJECT DESCRIPTION7

E. CONSTRUCTION METHODS AND SCHEDULE8

F. OPERATION AND MAINTENANCE8

G. ENVIRONMENTAL MEASURES9

H. PERMITS REQUIRED12

IV. ENVIRONMENTAL CHECKLIST16

1. AESTHETICS.16

2. AGRICULTURE AND FOREST RESOURCES18

3. AIR QUALITY.....19

4. BIOLOGICAL RESOURCES21

5. CULTURAL RESOURCES24

6. GEOLOGY AND SOILS25

7. GREENHOUSE GAS EMISSIONS27

8. HAZARDS AND HAZARDOUS MATERIALS28

9. HYDROLOGY AND WATER QUALITY31

10. LAND USE AND PLANNING35

11. MINERAL RESOURCES36

12. NOISE36

13. POPULATION AND HOUSING40

14. PUBLIC SERVICES41

15. RECREATION42

16. TRANSPORTATION/TRAFFIC42

17. UTILITIES AND SERVICE SYSTEMS.....44

18. MANDATORY FINDINGS OF SIGNIFICANCE45

V. DETERMINATION47

VI. REFERENCES AND DATA SOURCE LIST48

APPENDIX A – BIOLOGICAL RESOURCES DATABASE RESEARCH

APPENDIX B – CULTURAL RESOURCES RECORDS

APPENDIX C – ATLAS ENGINEERING PHASE I REPORT

APPENDIX D – CAPTURE ZONE REPORT

APPENDIX E – WATER QUALITY EVALUATION

LIST OF FIGURES

PAGE

Figure 1. Project Location	13
Figure 2. Proposed Project Site	14
Figure 3. Conceptual Site Plan	15

LIST OF TABLES

PAGE

Table 1. Attainment Status for the North Central Coast Air Basin – 2010	20
Table 2. Land Use Compatibility for Community Noise Environments	37
Table 3. Maximum Allowable Noise Exposure, Stationary Noise Sources	38
Table 4. Typical Construction Equipment Noise Levels.....	38
Table 5. Typical Construction Equipment Vibration Emissions	40

I. PURPOSE OF THE NOTICE OF PREPARATION AND INITIAL STUDY

The City of Santa Cruz Water Department (City) proposes to construct a replacement for Beltz Well No. 4 (Beltz Well No. 12) on a vacant lot located at the northeast corner of the intersection of Research Park Drive and Cory Street in Soquel, California, to maintain the City's historic groundwater production, to locate the replacement well farther inland to protect the Purisima aquifer from the threat of saltwater intrusion, and to improve the reliability and flexibility of the City's groundwater well system.

All "projects" within the State of California are required to undergo environmental review to determine the environmental impacts associated with implementation of the project in accordance with the California Environmental Quality Act (Public Resources Code, Section 21000 et al. 2008). The California Environmental Quality Act (CEQA) was enacted in 1970 by the California Legislature to disclose to decision makers and the public the significant environmental effects of a Proposed Project and identify possible ways to avoid or minimize significant environmental effects of a project by requiring implementation of mitigation measures or recommending feasible alternatives. CEQA applies to all California governmental agencies at all levels, including local, regional and state, as well as boards, commissions, and special district. As such, the City is required to conduct an environmental review to analyze the potential environmental effects associated with the Proposed Project.

The findings in this Initial Study have determined that an Environmental Impact Report (EIR) is the appropriate level of environmental documentation. The Proposed Project could result in potential impacts in biological resources and hydrology issue areas. These issues areas shall be further addressed in the EIR.

The City will be the Lead Agency for the CEQA process related to this Proposed Project and for the EIR that is recommended in this Initial Study (IS) / Notice of Preparations (NOP). The attached IS analyzes the potential for the proposed project to result in environmental impacts.

The City needs to know the views of your agency regarding the scope and content of the environmental information that should be included in the Environmental Impact Report (EIR). The document will be prepared by the City and will include any information necessary for your agency to meet any statutory responsibilities related to the Proposed Project. Your agency will need to use the EIR when considering any permit or other approvals necessary to implement the project. A preliminary list of the environmental topics identified for study in this EIR is provided in the IS checklist (Section IV). If the topics of concern to your agency have already been identified for analysis in the IS, your agency need not provide a response to this notice.

The project description, location, and the environmental issues to be addressed in the EIR are contained in the attached materials.

Due to the time limits mandated by state law, your comments must be sent to the City at the earliest possible date but not later than 5:00 p.m., January 17, 2011. Please send your response to:

Leah Van Der Maaten, P.E., Associate Civil Engineer
City of Santa Cruz, Water Department
212 Locust Street Suite C, Santa Cruz CA 95060

Comments may also be sent by FAX at (831) 420-5201

Document Availability: The Initial Study is available for public review during regular business hours at the locations listed below.

- City of Santa Cruz Water Department, Engineering, 212 Locust Street Suite C, Santa Cruz CA 95060
- Santa Cruz Public Library, Capitola Branch, 2005 Wharf Road, Capitola, CA 95010-2002

- Santa Cruz Public Library, Central Branch, 224 Church Street, Santa Cruz, CA 95060-38
- City of Santa Cruz website (www.cityofsantacruz.com)

Public Scoping Meeting: The City of Santa Cruz Water Department will receive public input on the project and the NOP/IS during the 30-day scoping period, at a public meeting to be held on January 10, 2011 at 6:30 p.m. at the Best Western Capitola By-the-Sea Inn & Suites: 1435 41st Ave, Capitola, CA 95010. Comments from the community and interested parties are encouraged.

II. BACKGROUND

1. **Project Title:** Beltz Well No. 12 – Research Park Drive
2. **Lead Agency Name & Address:** City of Santa Cruz Water Department
212 Locust Street, Suite C
Santa Cruz, California 95060
3. **Contact Person & Phone Number:** **Leah Van Der Maaten, P.E., Associate Civil Engineer**
Phone number: (831) 420-5356
4. **Project Location:** The site is located in the unincorporated community of Soquel, Santa Cruz County, California at Research Park Drive and Cory Street, Assessor’s Parcel No. 030-18-170. (Refer to Figure 1, Proposed Project Location).
5. **General Plan Designation:** CS: Service Commercial
6. **Zoning:** M-1 (Light Industry)
7. **Other Public Agencies whose approval is required:**
 - Santa Cruz City Council – adoption of CEQA document and project approval
 - Santa Cruz County Public Works Department – encroachment permit
 - Santa Cruz County Environmental Health Services – well installation permit
 - California Department of Public Health (DPH) – permit to treat the groundwater and distribute it in the municipal system
 - Regional Water Quality Control Board (Central Coast) – National Pollutant Discharge Elimination System (NPDES) Permit for Discharges with Low Threat to Water Quality

III. ENVIRONMENTAL SETTING & PROJECT DESCRIPTION

A. Introduction

The City of Santa Cruz Water Department (City) proposes to construct a replacement water well and associated facilities in the unincorporated community of Soquel, Santa Cruz County, California (see Figure 1). The proposed well would be located on the northeast corner of Research Park Drive and Cory Street, in Soquel (see Figure 2). As shown in the Conceptual Site Plan (Figure 3), facilities would include: (1) a pump and chemical storage building, approximately 12 feet in height; (2) an iron and manganese treatment system consisting of pressurized filter tanks, approximately 10 feet in height; (3) a backwash tank for the iron and manganese treatment, approximately 15 feet in height; (4) a sand separator, approximately 7 feet in height,

and (5) station piping including, but not limited to, a treated water pipeline, a sanitary sewer pipeline, and stormwater drainage facilities that would connect to existing facilities in Research Park Drive. The replacement well (Beltz Well No. 12) will be drilled to an approximate depth of 320 feet below ground surface (bgs) to provide up to approximately 700 gallons per minute (GPM) of water. Pumping from Beltz Well No. 12 could be required for a period of up to seven months, corresponding to approximately April 15 to November 15. Production from Beltz Well No. 12 would not increase the City's groundwater extraction, but would redistribute existing City production from the Live Oak well field. While the City maintains the option to produce up to 645 ac-ft/yr from either the existing Live Oak well field or Beltz Well No. 12 in any water year type, typically the City would produce a portion of annual groundwater supplies from the existing Live Oak well field and a portion from Beltz Well No. 12.

B. Department Overview

The City is responsible for providing water to over 90,000 people in the City, unincorporated Santa Cruz County, a small part of the City of Capitola, and several agricultural customers along Highway 1 between the City limits and the town of Davenport. There are four main sources of water supply for the City including North Coast sources (Laguna, Majors, and Riggardio Creeks and Liddell Spring), San Lorenzo River (including Tait Street Diversion, Tait wells, and Felton Diversion), Loch Lomond Reservoir, and Live Oak wells. Approximately 5% of the City's water supply is groundwater provided by the Live Oak well field (formerly called the Beltz well field).

The primary water management problem presently facing the City of Santa Cruz is the lack of adequate water supply during periods of drought. In normal and wet years when rainfall and runoff are normal to abundant, base flows in the coast and river sources are restored by winter rains. Storage in Loch Lomond is typically replenished to full capacity with runoff from the Newell Creek watershed and water diverted from the San Lorenzo River at Felton. Under these weather conditions, the water supply system is capable of meeting the community's total annual water requirements.

The system is highly vulnerable to shortage in below normal, dry, and drought years, however, when the San Lorenzo River and coast sources run low. In these years, the system relies more heavily on water stored in Loch Lomond to satisfy demand, which draws down the reservoir level lower than usual and depletes available storage. In critically dry or multi-year drought conditions, the combination of very low surface flows in the coast and river sources and depleted storage in Loch Lomond reservoir reduces available supply to a level that cannot support even average dry season demands.

The City experienced severe water supply deficiencies in both the 1976-77 and 1987-92 droughts. In 1977, the City imposed severe water rationing in response to a critical shortage of water. During the 1987-92 drought, a water supply emergency was declared and either usage restrictions or rationing was imposed each year for five consecutive years. The 1976-77 event has since been established as the most severe drought of record, and is used by the City as a benchmark for assessing system reliability. If a critical drought similar to 1976-77 occurred in 2005, shortages would have been in excess of 40%.

Operations studies conducted by the City show that the problem of water shortage will worsen, in terms of both frequency and magnitude, as the population of the region grows and demand for water increases over time.

As noted above, the City's primary sources of water supply are surface water diversions; however, approximately 5% of the City's water supply is groundwater provided by the Live Oak well field. This well field only extracts water from the coastal portions of the Purisima aquifer. While the Live Oak wells groundwater system is a small portion of the City's water supply, it is still an important source of water as it is used to augment the City's water supply during peak demand and drought periods. Historically the City has produced groundwater in response to widely fluctuating hydrologic conditions with periods of little production during extremely wet years and periods of high production during drought conditions. Specifically, the City has operated its wells during a period of 150 to 200 days out of the year at a combined

operational rate of about 1 MGD on average (City of Santa Cruz, 2006). During the extended drought of 1987-1988, operation averaged a rate of 2 MGD (City of Santa Cruz, 2005). In the City's Integrated Water Plan (IWP) Program DEIR (City of Santa Cruz, 2005), the City documented its planning goal of maintaining groundwater production into the future at the maximum rate of approximately 2 MGD (1,500 GPM) during drought conditions; which is equal to approximately 1,300 ac-ft/yr. However, the City recognized that the uncertain nature of groundwater conditions in the western portion of the basin is a serious issue and has limited future maximum extraction during all water years to 645 ac-ft/yr, or approximately 1MGD (700 GPM).

Currently, the Live Oak well field has four active wells, still referenced as Beltz wells (No. 7, 8, 9 and 10). Beltz Wells No. 8 and No. 9 were installed in 1998 and began producing water for the City in 1999. Beltz Well No. 10 was installed in 2009. Beltz Well No. 7, installed in 1974, has poor yield.. The City currently produces 1 MGD (700 GPM) from the Live Oak wells. A replacement of Beltz Well No. 4 is needed to restore water system reliability and to protect the Purisima aquifer from seawater intrusion, especially during critical drought periods. Groundwater extracted from Beltz Well No.12 would be from the same zone of the Purisima aquifer as the existing Live Oak well field and Beltz Well No. 4.

A recent study completed by the City to investigate the hydrogeological conditions of the area concluded that new production wells developed by the City should be shifted inland from the existing Live Oak well field in an attempt to control groundwater levels and protect the Purisima aquifer from seawater intrusion (Hopkins, 2009). The City has proposed to develop Beltz Well No. 12 at the Research Park Drive site, which is located approximately 1.5 miles inland and northeast of the Live Oak well field.

Groundwater Monitoring

The City currently maintains a network of groundwater monitoring wells in the Live Oak area to provide the City the ability to collect groundwater levels and water quality samples from individual aquifer zones in the Soquel, Capitola, Live Oak and coastal areas. Three Cory Street monitoring wells were constructed adjacent to the Proposed Project site, in a public right of way on Cory Street, in November of 2009. These monitoring wells provide the City the ability to monitor groundwater conditions further inland and collect site-specific hydrogeologic information for the development of Beltz Well No. 12. As constructed, the Cory Street monitoring wells consist of nested well designs that utilized 2-inch-diameter well casing and screen assemblies which range in depths from 70 to 350 feet bgs. The preliminary well designs were based on projections using a recent hydrogeological interpretation of the Purisima Formation aquifer zones (Hopkins, 2009), and were finalized based on the site specific geological findings obtained during the test hole drilling process.

During monitoring well drilling hydrogeologists collected and analyzed drill cuttings, compiled a lithologic log, and monitored drill rig activities to determine the depths of specific Purisima Formation (Purisima) aquifer zones in this inland portion of the Live Oak-Capitola area. Upon reaching the planned depth for each borehole, an electric log of the borehole was recorded to provide additional data for final well design. Monitoring well design was determined through correlation of the lithological log and the geophysical survey (electric log).

The Cory Street Monitoring Well was drilled, constructed, and sampled between November 16, 2009 and December 4, 2009. A 10-inch-diameter pilot borehole was drilled to a depth of approximately 350 feet bgs. The hydrogeological information collected during the installation of the Cory Street Monitoring Well indicates that the main aquifer units at this location are the Purisima A and AA zones. While it is possible the underlying Santa Margarita Formation may be a viable aquifer zone, it likely lies at a depth of about 200 feet below the Cory Street monitoring well and is not presently being produced by the Beltz Wells. The hydrogeological study also concluded that it is reasonable for a properly designed and constructed well in the vicinity of the Cory Street site to be capable of producing up to approximately 800 GPM during long-term operation.

Regional Groundwater Basins

The Purisima aquifer and Santa Margarita formation underlie the Proposed Project area and are part of the Soquel-Aptos Groundwater Basin. The Purisima aquifer is the primary source of groundwater in the region. The entire production of the City's Live Oak well field is derived from groundwater contained in the Purisima Formation (Hopkins Groundwater Consultants, Inc. 2004) and accounts for approximately 5% of the City's water supply. The primary aquifer units consist of fine-to-coarse grained marine sands interbedded and confined by silt and sandy clay strata (Hopkins Groundwater Consultants, Inc. 2004). The Purisima aquifer is relatively shallow under the City of Santa Cruz, but slopes southeast, becoming deeper under Soquel Creek. Potential groundwater recharge areas for the Purisima aquifer are located along the foothills of the Santa Cruz Mountains in the eastern and northern quarters of the City of Santa Cruz water service area.

The Santa Margarita formation lies beneath the Purisima aquifer; it is believed to be comprised of a moderately cemented sandstone. Available data indicate it likely ranges from 40 to 60 feet thick and lies on top of the crystalline bedrock which defines the effective base of fresh water. In the Live Oak area, the Santa Margarita aquifer is deeply buried and undeveloped.

Watersheds

The entire Proposed Project area is within the Big Basin Hydrologic Unit, as defined by the Central Coast Regional Water Quality Control Board, and includes portions of the San Lorenzo and Aptos Creek Hydrologic subareas (CCRWQCB 1994). At the coast, the San Lorenzo subarea stretches from Younger Lagoon east to the Santa Cruz Harbor at the outlet of Arana Creek. The Aptos Soquel subarea stretches east from the Santa Cruz Harbor to La Selva Beach.

The City is divided into five sub-watersheds that make up the San Lorenzo Hydrologic subarea (City of Santa Cruz, 2003). Each drains directly to the Pacific Ocean. These watersheds are:

- Moore Creek Watershed
- Westside Watershed
- Neary Lagoon Watershed
- San Lorenzo River Watershed
- Arana Gulch Watershed

Two additional watersheds and a small lake are located in the Aptos Soquel Basin in Capitola and unincorporated areas of Santa Cruz County. These are:

- Rodeo Gulch Creek Watershed
- Soquel Creek Watershed
- Schwann Lake

The two watersheds located in the vicinity of the Proposed Project site are the Soquel Creek Watershed and the Rodeo Gulch Creek watershed. Soquel Creek is located approximately 0.48 mile to the east of the Proposed Project site. Soquel Creek flows through unincorporated portions of Santa Cruz County in its upper watershed, and the center of Capitola as it approaches the ocean. The creek is daylighted throughout its entire length as it flows through open space, residential, and commercial land uses. "Daylighted" refers to streams and creeks that are not enclosed in a culvert or pipe. Soquel Creek terminates at Capitola City Beach.

Rodeo Gulch Creek is located approximately 0.16 mile immediately west of the Proposed Project site. The Rodeo Gulch Creek watershed flows through the unincorporated area of Live Oak between the cities of Santa Cruz and Capitola. The watershed consists primarily of open space in the upper watershed, and residential use in the lower reaches. Rodeo Gulch Creek is daylighted for most of its length and flows into Corcoran Lagoon, before terminating at the Pacific Ocean.

Seawater Intrusion

Historic pumping from the Live Oak well field has resulted in conditions conducive to seawater intrusion. The Live Oak well field's location near the coast makes it the last pumper to capture groundwater that would otherwise become offshore flow through the ocean floor outcrop. The City maintains a network of groundwater monitoring wells and regularly tracks water levels along the coast to detect conditions that could signify the presence of seawater intrusion and to understand how the aquifer responds to pumping stresses. Measurements at a monitoring well near the coast (Pleasure Point) following the production period during the last drought (1987 and 1988) indicate that water levels along the coast dropped to near or below sea level. Following the drought, water levels then recovered to nearly 20 feet above mean sea level (Johnson et al. 2004). Pumping throughout the aquifer has progressively increased since the 1960's and is expected to continue. Conditions from 1994 to 2004 indicate that additional pumping by Soquel Creek Water District (SqCWD) and privately owned inland wells has lowered the amount of offshore flow available for capture by the Live Oak well field (Hopkins Groundwater Consultants, Inc. 2004).

C. Purpose and Need for Project

The purpose of the Proposed Project is to replace Beltz Well No. 4 in order to maintain the City's historic groundwater production, to locate the replacement well farther inland to protect the Purisima aquifer from the threat of saltwater intrusion, and to improve the Live Oak Well system's reliability and flexibility of the City's groundwater system.

D. Project Description

The replacement of Beltz Well No. 4 with Beltz Well No. 12 and associated treatment facilities would be installed on a vacant lot located at the northeast corner of the intersection of Research Park Drive and Cory Street in Soquel, California. As shown in Figure 3, the replacement water well would include the following components: (1) a pump and chemical storage building, approximately 40 feet by 20 feet and approximately 12 feet in height; (2) an iron and manganese treatment system consisting of pressurized filter tanks, approximately 35 feet by 9 feet and approximately 10 feet in height; (3) a backwash tank for the iron and manganese treatment, approximately 16 feet in diameter and approximately 15 feet in height; (4) a sand separator, approximately 7 feet in height; and (5) station piping, including, but not limited to, treated water pipeline, sewer connections, and new stormwater drainage facilities that would connect to existing facilities in Research Park Drive. The Proposed Project site would be enclosed with a chain-link fence with privacy slats. The site would also be developed with a paved driveway connecting to Research Park Drive, security lighting, and crushed rock around the Proposed Project facilities.

The replacement well will be drilled to an approximate depth of 320 feet below ground surface (bgs) to provide up to approximately 700 GPM of water. Tentative well design includes a 32-inch diameter bore hole and a 16-inch diameter well casing and screen design to facilitate the use of either a submersible pump or a vertical line-shaft turbine pump. The well will likely be located in a pump and chemical storage building which will also contain the pump controls and a storage area for the Sodium hypochlorite (typically 350 gallons or less of 12.5% Sodium hypochlorite). It is possible that the well will not be enclosed by a building but chemicals will still need to be stored inside an enclosed area that is protected from the sun. Sodium hypochlorite is used as a disinfectant for the finished water and for pretreatment in the removal of iron and manganese. The exact treatment process will be determined once the well has been drilled since pilot testing should be done prior to design of wellhead treatment. However, iron and manganese treatment typically consists of adding sodium hypochlorite to oxidize the iron and manganese into a form that is easier to remove. Next the water is run through a filter media, such as green sand, anthrasand, or pyrolusite, where the iron and manganese is physically removed by filtration/straining action. There is a slight possibility that Potassium permanganate would also be used in the iron and manganese treatment system. The treated water is then piped to the City's potable water distribution line located adjacent to the Proposed Project site in Research Park Drive.

At least daily, the filter media is cleaned by backwashing to remove the accumulated iron and manganese. The backwash is then piped to the backwash tank. In this tank, the iron and manganese settle out from the groundwater. The clear water is piped to the County sanitary sewer line located immediately adjacent to the Proposed Project site in Research Park Drive and/or recirculated to the wellhead treatment and the remaining sludge is transported offsite every year to an appropriate disposal facility.

E. Construction Methods and Schedule

Construction Methods

The well would be drilled by a contractor licensed in the State of California, utilizing the reverse-circulation hydraulic rotary drilling method. Prior to well drilling, Underground Services Alert (USA) would be contacted to identify the location of any existing utilities, which would be avoided. Equipment used for well construction would include a rotary drill rig with drilling fluid/mud system, temporary water storage tank, well development rig, two support trucks, and a forklift.

During borehole excavation, drill fluid (typically consisting of a water and bentonite clay slurry) and cuttings (consisting of native clay, silt, sand, and gravel) would be contained. A staging area would be located on the Proposed Project site to store drill-fluid containment, drill-cuttings containment, construction equipment and materials. The drill cuttings would ultimately be disposed of offsite, in accordance with state laws, at an appropriate disposal facility. Drilling fluids would be removed after construction using a qualified truck service and disposed of at a facility licensed to handle non-toxic and non-hazardous liquid waste. Water generated during well development and aquifer testing will be discharged in the storm drain and monitored as required by the National Pollution Discharge Elimination System (NPDES) permit.

After the well installation the well pump and chemical building would be constructed, the filter tanks, the backwash tank, and the sand separator would be installed and connections would be made to the potable water, sanitary sewer, and stormwater drainage lines.

Schedule

Well installation construction is anticipated to take place over a two month period in late summer 2011. The two month construction period begins with site preparation and continues with well drilling, development and pump testing through to final site clean-up. During this construction period, there will be intermittent periods of 24-hour construction activity associated with the well drilling, development and pump testing. This is due to the need to proceed continuously until well casings can be sunk to avoid the risk of the walls collapsing.

Construction of wellhead treatment, as well as site improvement work, is expected to occur from over a three month period in late spring/early summer 2012. The Proposed Project is expected to become operational in fall 2012.

F. Operation and Maintenance

Routine maintenance would consist of a daily visit by a City staff person in a small truck to check on the facility operations.

In the event of a power failure, emergency power would be provided by a diesel generator that will otherwise be stored and maintained at an off-site location.

G. Environmental Measures

Environmental measures are methods, measures, or practices that avoid, reduce, or minimize a project's adverse effects on various environmental resources. They can be applied before, during, or after construction of the project to reduce or eliminate potential environmental effects. The following standard environmental measures would be implemented as part of the Proposed Project. They are drawn from city and county ordinances, and other applicable regulations and agency practices. The City would ensure that these measures are included in the project construction specifications, as appropriate.

- 1) **Measures to Minimize Effects of Construction-related Noise.** The following noise control measures will be included in the construction contract specifications to reduce and control noise generated from construction-related activities. The City will monitor successful compliance with the County noise ordinance.
 - a) Except under special circumstances approved by the City, the normal working day for construction activities will be between the hours of 7:00 a.m. and 6:00 p.m. on weekdays and Saturday. No construction will occur on Sundays or legal holidays, or at night without prior written approval from the City and Santa Cruz County Planning Department. However, during the well drilling, development and testing, work will be 24 hours a day.
 - b) Construction equipment will have appropriate mufflers, intake silencers, and noise control features, and will be properly maintained and equipped with exhaust mufflers that meet state standards.
 - c) Vehicles and other gas- or diesel-powered equipment will be prohibited from unnecessary warming up, idling, and engine revving.
 - d) Residents within 100 feet of construction activities will be notified by the City in writing (i.e., letter or flier) at least 1 week prior to construction activities. The notice should include construction hours, duration, and name and telephone number or e-mail address of the staff member the public should contact with noise complaints.
 - e) A sign will be posted at all active construction sites, giving the name and telephone number or e-mail address of the staff member the public should contact with noise complaints. The sign is required to be at least 1,296 square inches (1 square yard) in size. All noise complaints will be recorded and submitted to the Santa Cruz County Planning Department as part of the annual report process. If necessary due to complaints, the construction contractor will provide additional noise attenuating measures such as sound blankets, additional mufflers, or engine shrouding.
 - f) Although impact tools are not planned for breaking pavement, impact tools will be hydraulically or electrically powered, if used, to avoid noise associated with compressed air exhaust from pneumatically powered tools. If within 50 feet of a residence, they also will be shrouded and shielded.
- 2) **Measures to Control and Minimize Effects of Construction Traffic.** The following traffic control measures were developed in coordination with a county permit engineer and will be incorporated into the construction specifications.
 - a) Provide through access for emergency vehicles at all times.
 - b) Maintain access for driveways and private roads.
 - c) Provide adequate off-street parking or use designated public parking areas for construction-related vehicles not in use through the construction period.

- d) Maintain pedestrian and bicycle access and circulation during project construction, including the primary pedestrian and bicycle pathways. If construction encroaches upon sidewalk, a safe detour will be provided for pedestrians at the nearest painted cross walk. If construction encroaches on a bike lane, warning signs will be posted that indicate bicycles and vehicles are sharing the roadway.
 - e) Traffic controls on arterials and collectors should include flag persons wearing bright orange or red vests and using the “Stop/Slow” paddle to warn motorists of construction activity.
 - f) Maintain access to public transit and ensure that movement of public transit vehicles is not impeded as a result of construction activities.
 - g) Post standard construction warning signs in advance of the construction area and at any intersection that provides access to the construction area.
 - h) If there are lane closures, notify the Santa Cruz County Fire Department and Sheriff’s Department of construction locations and ensure that alternative evacuation and emergency routes are designed to maintain response times during construction periods, if necessary.
 - i) Provide written notification to appropriate contractors regarding appropriate routes to and from construction sites and weight and speed limits for local roads used to access construction sites. Submit a copy of all such written notifications to the Santa Cruz County Planning Department.
 - j) Post a sign at all active construction sites, giving the name and telephone number or e-mail address of the City staff member the public should contact with complaints regarding construction traffic. The sign is required to be at least 1,296 square inches (1 square yard) in size. All construction traffic complaints will be recorded and forwarded to the Santa Cruz County Planning Department as part of the annual report process.
 - k) Repair or restore the road right-of-way to its original condition upon completion of the work for which an encroachment permit was issued.
- 3) **Measures to Protect Trees.**
- a) No trees will be removed.
 - b) All trees with a diameter greater than 12 inches will be protected from disturbance during construction by installing a temporary fence around the tree’s dripline, as required by the Santa Cruz County Planning Department.
 - c) There will be no stockpiling or staging beneath tree canopies.
 - d) If determined necessary by the City to remove pavement beneath tree canopies, a certified arborist will be present to direct any permitted root pruning. This is not anticipated.
- 4) **Measures to Protect Previously Unknown Cultural Resources and Human Remains.** If buried cultural resources are identified during ground disturbing activities, work will stop in that area and within 100 feet of the discovery site until a qualified archaeologist can assess the significance of the find. Cultural resources may include chipped stone or ground stone, historic debris, building foundations, or human bone. As necessary, appropriate measures will be developed in consultation with the Santa Cruz County Planning Department and Archaeologist, State Office of Historic Preservation, and other appropriate agencies.

If human skeletal remains are encountered, the County Coroner will be contacted immediately, as required by County Ordinance No. B6-18. If the County Coroner determines that the remains are Native American, the Coroner will contact the Native American Heritage Commission (pursuant to Section 7050.5c of the California Health and Safety Code) and the County Coordinator of Indian Affairs.

If any human remains are discovered in any location other than a dedicated cemetery, there shall be no further excavation or disturbance of the site or any nearby area reasonably suspected to overlie adjacent human remains until: 1) the County coroner has been informed and has determined that no investigation of the cause of death is required; and 2) if the remains are of Native American origin, the descendants from the deceased Native Americans have made a recommendation to the landowner or the person responsible for the excavation work for means of treating or disposing of with appropriate dignity the human remains and any associated grave goods, as provided in Public Resources Code Section 5097.98; or the Native American Heritage Commission was unable to identify a descendent or the descendent failed to make a recommendation with 24 hours after being notified by the Commission.

- 5) **Measures to Protect Water Quality.** To minimize the mobilization of sediment to adjacent water bodies, the following erosion and sediment control measures will be included in the construction specifications, based on the Santa Cruz County Ordinance (Chapter 16.22 Erosion Control) and standard dust reduction measures. Only minor grading of the project site for storm drain improvements would occur.
- a) Water all active construction areas where soil is exposed at least twice daily, and more often if needed, to control dust generation during earthmoving activities.
 - b) Cover all trucks hauling drill cuttings and other loose materials, or require all trucks to maintain at least 2 feet of freeboard.
 - c) Sweep all paved roads, parking areas, and staging areas at construction sites daily or more often, as needed to control dust.
 - d) Cover or apply nontoxic soil stabilizers to inactive construction area (previously graded area inactive for 10 days or more) that could contribute sediment to waterways.
 - e) Enclose and cover exposed stockpiles of dirt or other loose, granular construction materials that could contribute sediment to waterways.
 - f) Limit traffic speeds on unpaved roads to 5 mph.
 - g) Contain soil and filter runoff from disturbed areas by berms, vegetated filters, silt fencing, straw wattle, plastic sheeting, catch basins, or other means necessary to prevent the escape of sediment from the disturbed area.
 - h) No earth or organic material shall be deposited or placed where it may be directly carried into a stream, marsh, slough, lagoon, or body of standing water.
 - i) No insecticides, pesticides, or herbicides will be used.
 - j) Prohibit the following types of materials from being rinsed or washed into the streets, shoulder areas, or gutters: concrete; solvents and adhesives; thinners; paints; fuels; sawdust; dirt; gasoline; asphalt and concrete saw slurry; chlorinated water. (None of these materials are anticipated.)

H. Permits Required

It is anticipated that permits will be required from the following agencies:

- Santa Cruz City Council – adoption of CEQA document and project approval
- Santa Cruz County Public Works Department – encroachment permit
- Santa Cruz County Environmental Health Services – well installation permit
- California Department of Public Health (DPH) – permit to treat the groundwater and distribute it in the municipal system
- Santa Cruz County Sanitation District – approval to discharge backwash water into sanitary sewer system
- Regional Water Quality Control Board (Central Coast) – National Pollutant Discharge Elimination System (NPDES) Permit for Discharges with Low Threat to Water Quality

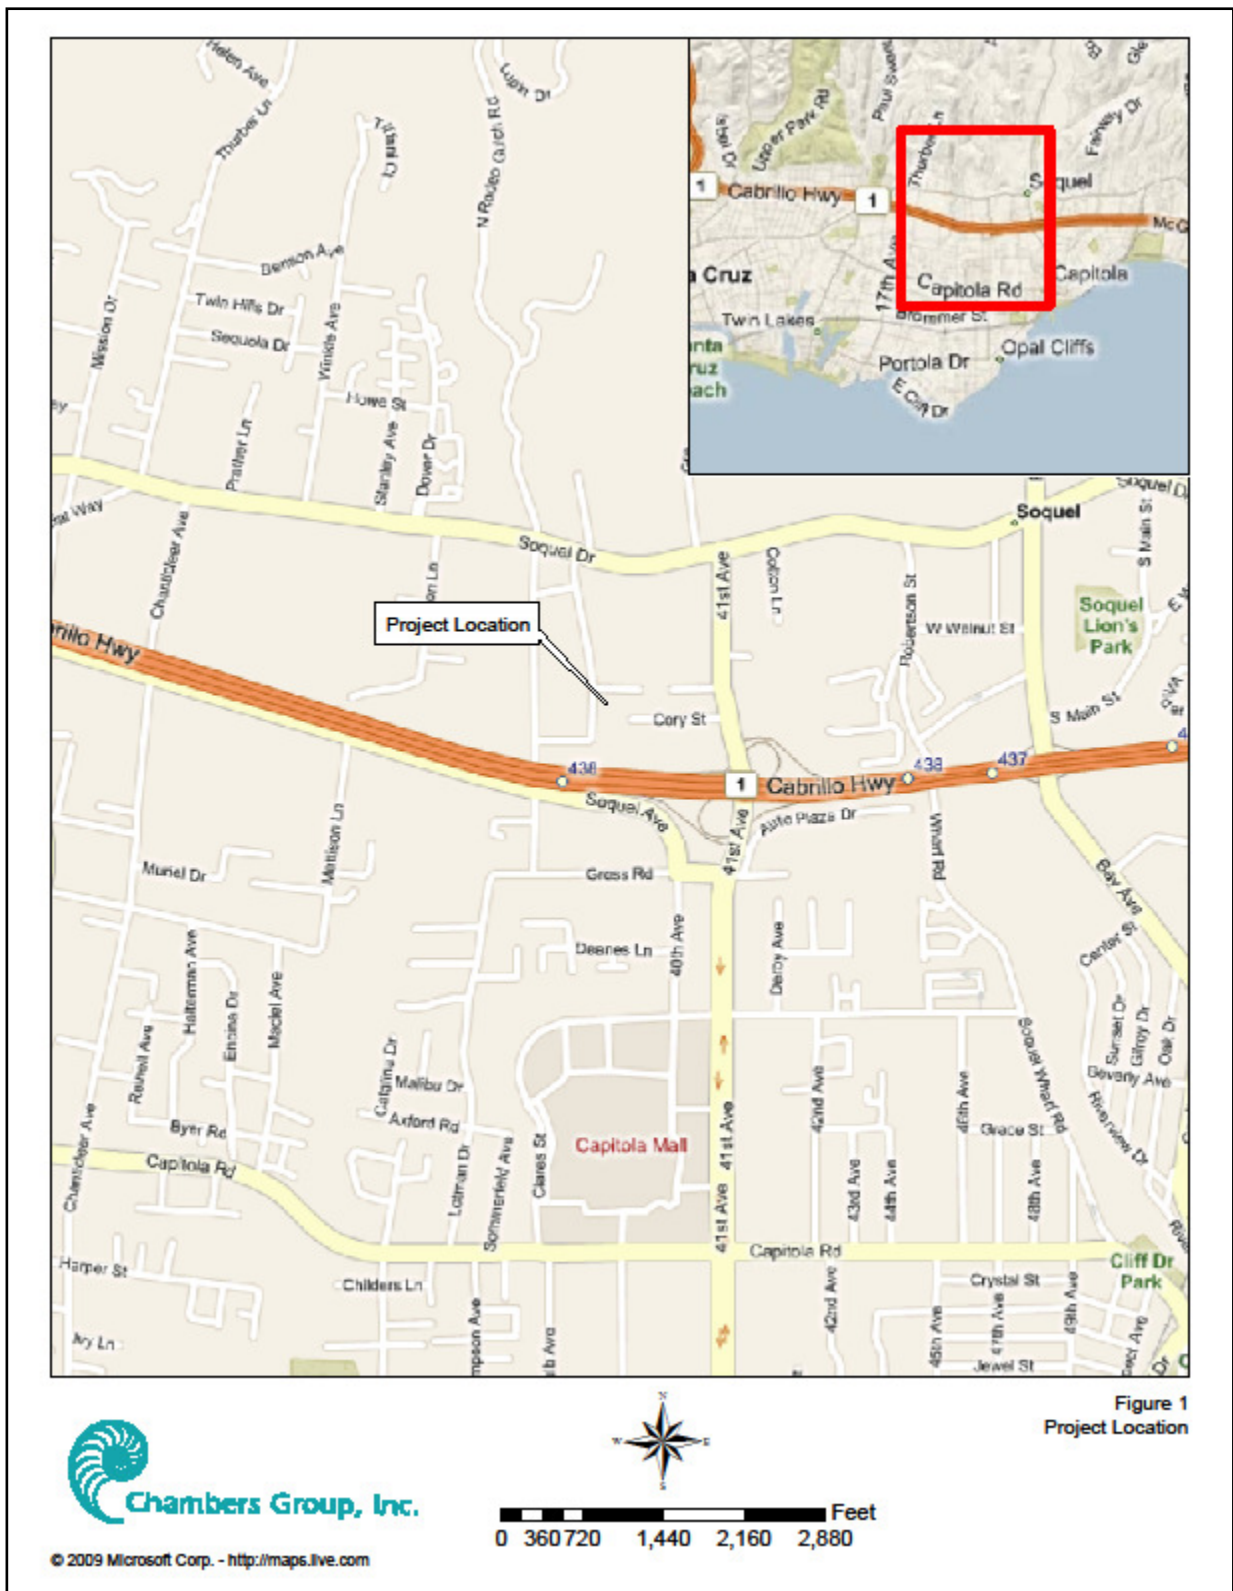


Figure 1. Project Location



Figure 2. Proposed Project Site

PROPOSED
CONCEPTUAL SITE PLAN
BELTZ WELL 12
 RESEARCH PARK DRIVE
 SOQUEL, CALIFORNIA • SANTA CRUZ COUNTY
 APRIL 12, 2010

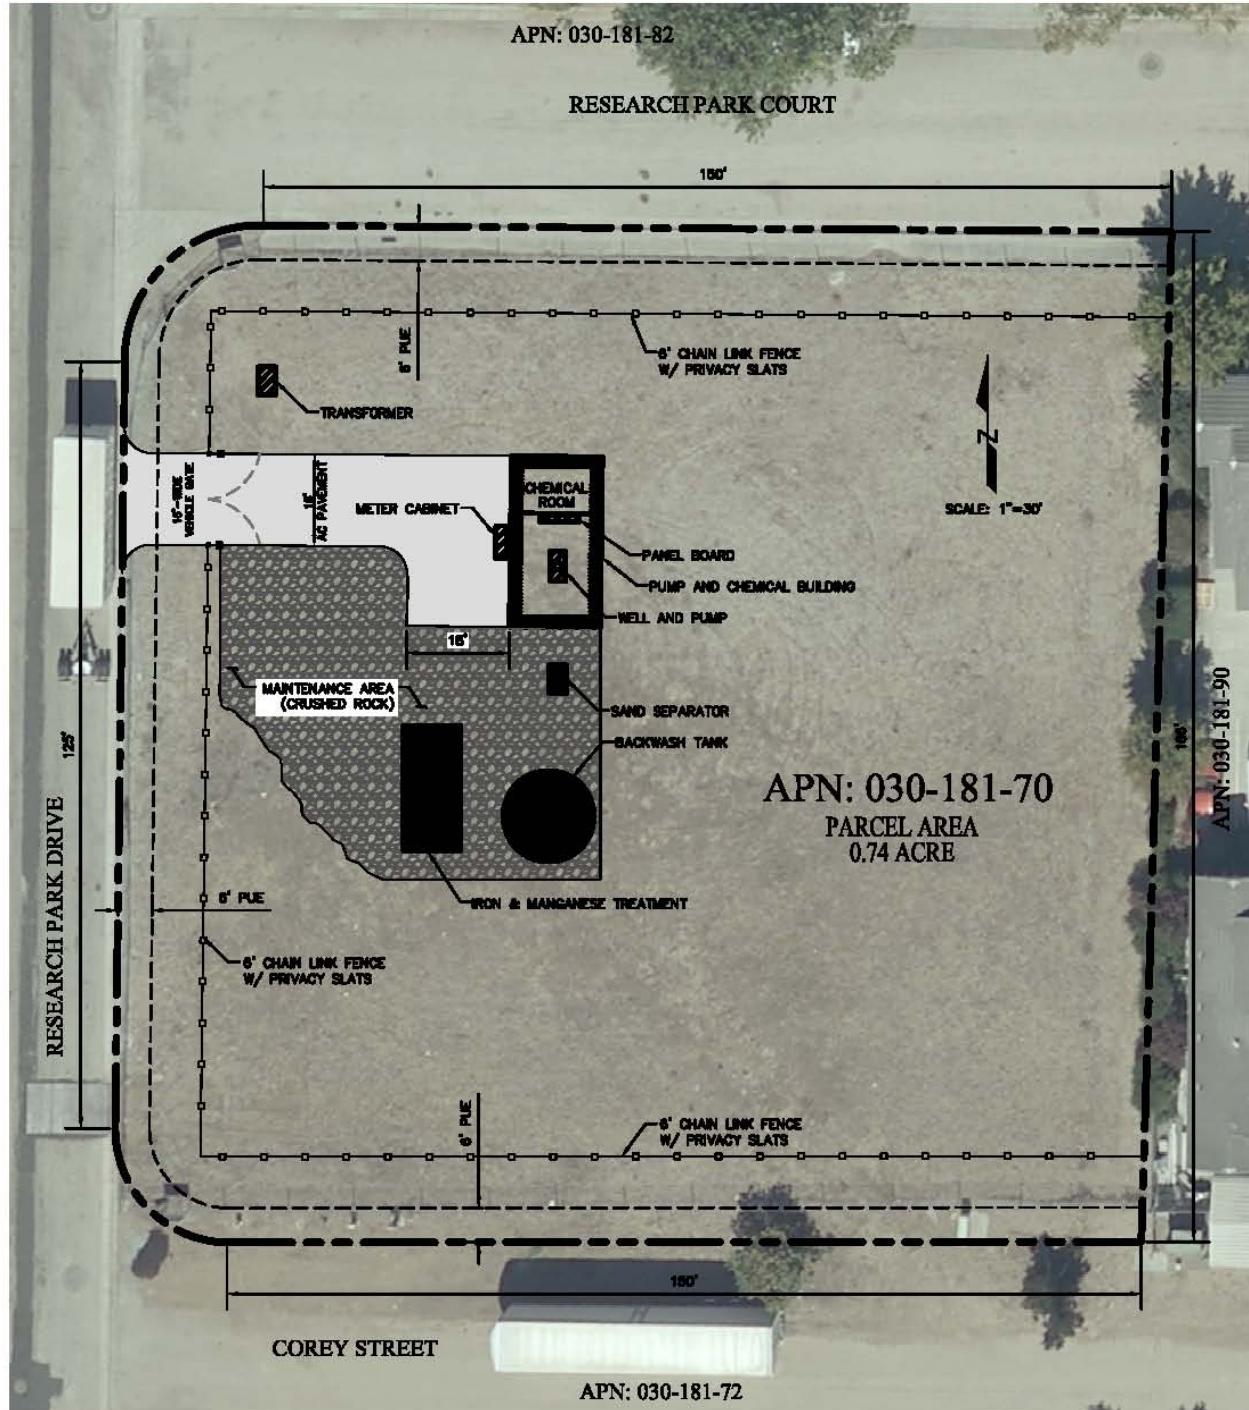


Figure 3. Conceptual Site Plan

IV. ENVIRONMENTAL CHECKLIST

Environmental Factors Potentially Affected: The environmental factors checked below would be potentially affected by this project, involving at least one impact that is a "Potentially Significant Impact" as indicated by the checklist on the following pages.

- | | | |
|--|---|---|
| <input type="checkbox"/> Aesthetics | <input type="checkbox"/> Agriculture Resources | <input type="checkbox"/> Air Quality |
| <input checked="" type="checkbox"/> Biological Resources | <input type="checkbox"/> Cultural Resources | <input type="checkbox"/> Geology /Soils |
| <input type="checkbox"/> Hazards & Hazardous Materials | <input checked="" type="checkbox"/> Hydrology / Water Quality | <input type="checkbox"/> Land Use / Planning |
| <input type="checkbox"/> Mineral Resources | <input type="checkbox"/> Noise | <input type="checkbox"/> Population / Housing |
| <input type="checkbox"/> Public Services | <input type="checkbox"/> Recreation | <input type="checkbox"/> Transportation / Traffic |
| <input type="checkbox"/> Utilities / Service Systems | <input checked="" type="checkbox"/> Mandatory Finding of Significance | |

Instructions:

- 1) A brief explanation is required for all answers except "No Impact" answers that are adequately supported by the information sources a lead agency cites. A "No Impact" answer is adequately supported if the referenced information sources show that the impact simply does not apply to projects like the one involved (e.g., the project falls outside a fault rupture zone). A "No Impact" answer should be explained where it is based on project-specific factors as well as general standards (e.g., the project will not expose sensitive receptors to pollutants, based on a project-specific screening analysis).
- 2) All answers must take account of the whole action involved, including off-site as well as on-site, cumulative as well as project-level, indirect as well as direct, and construction as well as operational impacts.
- 3) Once the lead agency has determined that a particular physical impact may occur, then the checklist answers must indicate whether the impact is potentially significant, less than significant with mitigation, or less than significant. "Potentially Significant Impact" is appropriate if there is substantial evidence that an effect may be significant. If there are one or more "Potentially Significant Impact" entries when the determination is made, an EIR is required.
- 4) "Negative Declaration: Less Than Significant With Mitigation Incorporated" applies where the incorporation of mitigation measures has reduced an effect from "Potentially Significant Impact" to a "Less Than Significant Impact." The lead agency must describe the mitigation measures, and briefly explain how they reduce the effect to a less than significant level (mitigation measures from Section XVII, "Earlier Analyses," may be cross-referenced).
- 5) Earlier analyses may be used where, pursuant to the tiering, program EIR, or other CEQA process, an effect has been adequately analyzed in an earlier EIR or negative declaration. Section 15063(c)(3)(D). In this case, a brief discussion should identify the following:
 - a) Earlier Analysis Used. Identify and state where they are available for review.
 - b) Impacts Adequately Addressed. Identify which effects from the above checklist were within the scope of and adequately analyzed in an earlier document pursuant to applicable legal standards, and state whether such effects were addressed by mitigation measures based on the earlier analysis.
 - c) Mitigation Measures. For effects that are "Less than Significant with Mitigation Measures Incorporated," describe the mitigation measures which were incorporated or refined from the earlier document and the extent to which they address site-specific conditions for the project.
- 6) Lead agencies are encouraged to incorporate into the checklist references to information sources for potential impacts (e.g., general plans, zoning ordinances). Reference to a previously prepared or outside document should, where appropriate, include a reference to the page or pages where the statement is substantiated.
- 7) Supporting Information Sources: A source list should be attached, and other sources used or individuals contacted should be cited in the discussion.
- 8) The explanation of each issue should identify:
 - a) the significance criteria or threshold, if any, used to evaluate each question; and
 - b) the mitigation measure identified, if any, to reduce the impact to less than significance

*Note: Instructions may be omitted from final document.

ENVIRONMENTAL EFFECTS

Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
---	---	--	----------------------

1. AESTHETICS.

Would the project:

- | | | | | |
|---|--------------------------|--------------------------|--------------------------|-------------------------------------|
| a. Have a substantial adverse effect on a scenic vista? | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
|---|--------------------------|--------------------------|--------------------------|-------------------------------------|

ENVIRONMENTAL EFFECTS

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
b. Substantially damage scenic resources, including, but not limited to, trees, rock outcroppings, and historic buildings within a State scenic highway?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
c. Substantially degrade the existing visual character or quality of the site and its surroundings?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Create a new source of substantial light or glare which would adversely affect day or nighttime views in the area?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Discussion

(a-b) Effects on Vistas, Scenic Resources. Scenic views in the County of Santa Cruz, as well as the City, are either situated near the coast or toward the Santa Cruz Mountains. The southern portion of the Proposed Project site is located within a designated scenic corridor (County of Santa Cruz GIS). However, views of the and from the Proposed Project site are limited to the immediate surrounding commercial and light industrial land uses. These are made up of one and two story industrial and commercial buildings and urban landscaping. In addition, the Proposed Project site is flat, vacant, and is not developed or landscaped. Therefore, the installation of Beltz Well No. 12 would not impact the scenic views in the area. No further study of this issue is required.

The Proposed Project is not located near or within a state scenic highway. There are no officially designated state scenic highways in the County of Santa Cruz; however, State Highway 1 (CA-1) and State Highway 17 (CA-17) are eligible state scenic highways (California Department of Transportation, 2010). CA-1 is located approximately 0.1 mile south of the Proposed Project site. CA-17 is located approximately 2.9 miles to the east of the site. The Proposed Project site is not visible from either of these highways due to intervening structures. Therefore, the installation of Beltz Well No. 12 would not have an impact on either eligible state scenic highway. In addition, there are no scenic resources on the Proposed Project site, including trees, rock outcroppings, or historic buildings, and therefore would not result in an impact to scenic resources. No further study of this issue is required.

(c-d) Degradation of Surrounding Visual Character. The Proposed Project involves the installation of a well on a flat, vacant, and undeveloped parcel in a commercial zone. Construction impacts would be temporary and are not anticipated to change the character of the area substantially and would therefore be less than significant. The installation of Beltz Well No. 12 would result in a change in the existing visual character of the site from a vacant, undeveloped parcel to a parcel developed with water production facilities. These facilities would not be inconsistent with the surrounding commercial and light industrial development. In addition, there are no existing scenic resources on the Proposed Project site. Therefore, the Proposed Project would result in a less than significant impact to the existing visual character or quality of the site and its surroundings. No further study of this issue is required.

Existing lighting in the surrounding area currently consists of street lights, building outdoor and security lighting. The Proposed Project would add security lighting, similar to that of existing surrounding properties. Nighttime lighting will be limited to low-wattage outdoor security lighting. All lighting will be shielded and directed onto the Proposed Project site. New lighting impacts would be less than significant. No further study of this issue is required.

Further Study Required: Further evaluation of the potential aesthetics impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
2. AGRICULTURE AND FOREST RESOURCES				
Would the project: <i>(In determining whether impacts to agricultural resources are significant environmental effects, lead agencies may refer to the California Agricultural Land Evaluation and Site Assessment Model (1997) prepared by the California Dept. of Conservation as an optional model to use in assessing impacts on agriculture and farmland.)</i>				
a. Convert Prime Farmland, Unique Farmland, or Farmland of Statewide Importance (Farmland), as shown on the maps prepared pursuant to the Farmland Mapping and Monitoring Program of the California Resources Agency, to non-agricultural use?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
b. Conflict with existing zoning for agricultural use, or a Williamson Act contract?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
c. Conflict with existing zoning for, or cause rezoning of, forest land (as defined in Public Resources Code section 12220(g)), timberland (as defined by Public Resources Code section 4526), or timberland zoned Timberland Production (as defined by Government Code section 51104(g))?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
d. Result in the loss of forest land or conversion of forest land to non-forest use?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
e. Involve other changes in the existing environment which, due to their location or nature, could result in conversion of Farmland, to non-agricultural use or conversion of forest land to non-forest use?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Discussion

(a) The Proposed Project would not convert Prime Farmland, or Farmland of Statewide Importance, as shown on the maps prepared pursuant to the Farmland Mapping and Monitoring Program of the California Resources Agency. The proposed site is not within any of the mapped farmland units designated by the California Resources Agency (California Division of Land Resource Protection, 2006). Aerial photographs show that the Proposed Project site has been vacant for at least the past 33 years (Atlas Engineering Services, Inc.). No impact would occur and no further study of this issue is required.

(b) The Proposed Project site is zoned for light industrial use, thus it would not conflict with existing zoning for agricultural use or a Williamson Act contract (County of Santa Cruz GIS). No impact would occur.

(c-e) The Proposed Project would involve the installation of a well on an undeveloped parcel within an urban area; and would not conflict with zoning for forest land or timberland, or convert forestland to non-forest use. Aerial photographs show that the Proposed Project site has been vacant for at least the past 33 years (Atlas Engineering Services, Inc.). No impact would occur and no further study of this issue is required.

Further Study Required: Further evaluation of the potential agricultural and forest resources impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
3. AIR QUALITY				
<i>Would the project: (Where available, the significance criteria established by the applicable air quality management or air pollution control district may be relied upon to make the following determinations.)</i>				
a. Conflict with or obstruct implementation of the applicable air quality plan?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. Violate any air quality standard or contribute substantially to an existing or projected air quality violation?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
c. Result in a cumulatively considerable net increase any criteria pollutant for which the project region is non-attainment under an applicable federal or state ambient air quality standard (including releasing emissions which exceed quantitative thresholds for ozone precursors)?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Expose sensitive receptors to substantial pollutant concentrations?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
e. Create objectionable odors affecting a substantial number of people?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

The proposed project is located within the North Central Coast Air Basin (NCCAB), which is comprised of a single air district, the Monterey Bay Unified Air Pollution Control District (MBUAPCD). The MBUAPCD consists of Santa Cruz, San Benito, and Monterey Counties. As shown below, Santa Cruz County is currently in violation of the State 1-hour and 8-hour ozone standards and the State PM₁₀ standard. Designations are made by pollutant according to the following categories:

- Attainment** – Air quality in the area meets the standard.
- Nonattainment Transitional** – Air quality is approaching the standard (State only).
- Nonattainment** – Air quality in the area fails to the applicable standard.
- Unclassified** – Insufficient data to designate area or designations have yet to be made.

Nonattainment designations are of most concern because they indicate that unhealthy levels of the pollutant exist in the area, which typically triggers a need to develop a plan to achieve the applicable standard. Current State and National designations for the NCCAB are shown below:

Table 1. Attainment Status for the North Central Coast Air Basin – 2010

Pollutant	State Standards	National Standards
Ozone (O ₃)	Nonattainment ¹⁾	Attainment
Inhalable Particulates (PM ₁₀)	Nonattainment	Attainment
Fine Particulates (PM _{2.5})	Attainment	Unclassified/Attainment
Carbon Monoxide (CO)	Monterey Co. - Attainment San Benito Co. - Unclassified Santa Cruz Co. - Unclassified	Attainment
Nitrogen Dioxide (NO ₂)	Attainment	Attainment
Sulfur Dioxide (SO ₂)	Attainment	Attainment
Lead	Attainment	Unclassified/Attainment

Notes: ¹⁾ Nonattainment pollutants are highlighted in **Bold**.

MBUAPCD works directly with county transportation commissions and local governments cooperates actively with all federal and state agencies and is directly responsible for reducing emissions from stationary, mobile, and indirect sources. MBUAPCD has responded to this requirement by preparing a series of Clean Air Plans that provide emission reduction measures for each criteria pollutant that is currently or previously not in attainment. MBUAPCD's most recent Air Quality Attainment Plans (listed below), address feasible control measures to reach attainment status for ozone and PM.

2008 Air Quality Management Plan - Adopted August 2008. The District's AQMP for achieving the 2006 California ozone standard.

2007 Federal Maintenance Plan - Adopted May 2007. The District's plan for maintaining the 1997 federal ozone standard.

2005 Particulate Matter Plan - Adopted December 2005. The District's plan for particulate matter made in response to Senate Bill 656.

Discussion

(a, b) Consistency with Air Quality Plan, Violate an Air Quality Standard

The North Central Coast Air Basin does not meet State standards for ozone and PM₁₀. Therefore, the regional pollutants of concern that would be emitted by the project are ozone precursors (Volatile Organic Compounds [VOCs] and nitrogen oxides [NOx]), and dust.

The project will emit small amounts of PM₁₀, VOCs and NOx during project construction and operation. In fact, project construction is expected to result in short-term, localized impacts to air quality due to generation of dust. However, standard dust control best management practices, such as periodic watering, will be implemented during construction to reduce these impacts to a less than significant level.

Project operational activities that may result in the emission of pollutants include daily vehicle trips for well maintenance and inspection; and operation of the proposed electrical pump and wellhead treatment. Emissions associated with these activities would be negligible.

Neither construction nor operational activities associated with the proposed project are expected to result in air quality violations nor are they expected to contribute substantially to an existing air quality violation. The

proposed project therefore, would be consistent with existing MBUAPCD Air Quality Management Plans for Ozone and PM₁₀ and no significant impact would occur.

(c) Cumulative Impacts

The proposed project air emissions would be negligible and would not result in any violations to existing air quality standards. The project therefore, would not contribute substantially to a cumulative air quality impact and no further study of this issue is required.

(d) Sensitive Receptors.

One of the primary reasons for air quality standards is the protection of those members of the population who are most sensitive to the adverse health effects of air pollution, termed “sensitive receptors”. The term “sensitive receptors” refers to specific population groups as well as the land uses where they would reside for long periods. Sensitive receptors are land uses such as residences, schools, daycare centers, and medical recreational facilities that are more susceptible to the effects of air pollution than the population at large. The project site is surrounded by commercial and light industrial land uses. There are no nearby land uses that would be considered to be sensitive.

Short-term construction activities proposed by the project would result in diesel exhaust emissions from onsite heavy-duty equipment. Particulate exhaust emissions from diesel-fueled engines (diesel PM) were identified as a TAC by the California Air Resources Board (CARB) in 1998. The proposed construction activities will generate diesel PM emissions from the use of off-road diesel equipment required for site grading and earth movement, paving, and other construction activities.

Because the use of mobilized equipment would be temporary and there are no sensitive receptors located in close proximity to the project site, diesel PM from construction activities would not result in significant impacts. No further study of this issue is required.

(e) Odors.

Potential sources that may emit odors during construction activities include the application of materials such as asphalt pavement. The objectionable odors that may be produced during the construction process are short-term in nature and the odor emissions are expected to cease upon the drying or hardening of the odor producing materials. Due to the short-term nature and limited amounts of odor producing materials being utilized, and considering that there are no sensitive land uses and no outdoor use areas in general (with the exception of parking lots), no significant impact related to odors are anticipated during construction or operation of the proposed project. No further study of this issue is required.

Further Study Required: Further evaluation of the potential air quality impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
--	---	---	--	----------------------

4. BIOLOGICAL RESOURCES

Would the project:

- a. Have a substantial adverse effect, either directly or through habitat modifications, on any species identified as a candidate, sensitive, or special status species in local or regional plans, policies, or regulations, or by the California Department of Fish and Game

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
or U.S. Fish and Wildlife Service?				
b. Have a substantial adverse effect on any riparian habitat or other sensitive natural community identified in local or regional plans, policies, regulations or by the California Department of Fish and Game or US Fish and Wildlife Service?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. Have a substantial adverse effect on federally protected wetlands as defined by Section 404 of the Clean Water Act (including, but not limited to, marsh, vernal pool, coastal, etc.) through direct removal, filling, hydrological interruption, or other means?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Interfere substantially with the movement of any native resident or migratory fish or wildlife species or with established native resident or migratory wildlife corridors, or impede the use of native wildlife nursery sites?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
e. Conflict with any local policies or ordinances protecting biological resources, such as a tree preservation policy or ordinance?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
f. Conflict with the provisions of an adopted Habitat Conservation Plan, Natural Community Conservation Plan, or other approved local, regional, or state habitat conservation plan?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Discussion

Biological resources include Habitats and Vegetative Communities, Migratory Corridors, Plants, Wildlife, Fisheries, Species Status Species (regulated by law, regulation or policy, such as threatened and endangered species), and waters of the United States. CEQA establishes State policy to prevent significant, avoidable damage to the environment by requiring changes in projects through the use of alternatives or mitigation measures.

(a-f) Special Status Species and Sensitive Habitat Areas.

Construction

The Proposed Project site is a 0.74 acre vacant parcel devoid of substantial vegetation, surrounded by a chain link fence, and located in an urban area. The adjacent surrounding properties are developed with commercial and light industrial land uses and are landscaped with ornamental trees, shrubbery, and grasses.

Plant communities of Santa Cruz County that support threatened, endangered and California species of concern include: grasslands, coastal scrub, and coastal strand, coastal salt marsh, and freshwater marsh, riparian woodlands, redwood forests, closed cone coniferous forests, mixed evergreen forests, chaparral, foothill woodlands and oak/savanna grasslands. The Proposed Project site does not include and is not adjacent to any of these plant communities. No occurrences of candidate, sensitive, or special status wildlife or plant species have been recorded for the Proposed Project site (Chambers Group Inc. 2010, Appendix A). In addition, the Proposed Project site is not suitable for the listed species of concern that occur in Santa Cruz County (Chambers Group Inc. 2010). The Proposed Project site may provide limited habitat for common wildlife species that utilize urban landscaping and are tolerate of pedestrian and vehicle traffic, however, no significant impacts would be expected due to the small size of the area that would be developed and the abundance of surrounding urban habitat.

No riparian habitat, wetlands, migration corridors or wildlife nursery sites occur within or adjacent to the Proposed Project site. Rodeo Gulch Creek is located approximately 0.16 mile west of the Proposed Project site, and Soquel Creek is located approximately 0.48 mile to the east of the Proposed Project site. Construction activities would result in a minor amount of soil disturbance. If soil is not contained and is directly exposed to rain, soil erosion and sediment could flow off-site. This impact is considered less than significant because erosion and sediment control measures would be implemented as part of the project (see “Measures to Protect Water Quality” in Section G, Environmental Measures). Drilling fluids and well development fluids would be removed as necessary during construction using a qualified vacuum truck service and disposed of at a facility licensed to handle non-toxic and non-hazardous liquid waste. In addition, the Proposed Project site is separate from these creeks by urban development. There would be no discharge of sediment or well construction materials into Rodeo Gulch Creek or Soquel Creek, and therefore no significant impact would occur. No further study of this issue is required.

There are no trees located on the Proposed Project site. There are medium and large sized ornamental trees located on the properties surrounding the Proposed Project site. These trees may provide habitat for nesting birds. However, this vegetation is currently exposed to the noise associated with the existing truck and construction equipment activity from the surrounding industrial/commercial uses. Proposed Project related construction noise would be similar in nature and short term. During the operation of the Proposed Project, routine maintenance would consist of a daily visit by a City staff person in a small truck to check on the facility operations. In addition, the project includes several measures to minimize construction-related noise, and reduce dust, (see Section G, Environmental Measures). No significant impacts would be expected. No further study of this issue is required.

The County of Santa Cruz has an ordinance on Significant Tree Protection (County Code 16.34) that protects trees of significant size, age, or biological or cultural importance. There are no trees on the Proposed Project site and there would be no removal of trees associated with the Proposed Project. Additionally, the Proposed Project site is not located in a habitat conservation plan; natural community conservation plan; or any other local, regional, or state habitat conservation plan. No significant impact would occur and no further study of this issue is required.

Operations

Soquel Creek, which is located approximately 0.48 mile to the east of the Proposed Project site, supports a population of the federal threatened Evolutionarily Significant Unit (ESU) of south/central California Coast steelhead (*Oncorhynchus mykiss irideus*). In addition, Soquel Creek previously supported the federal and State endangered ESU of Central California Coast Coho salmon (*Oncorhynchus kisutch*). Soquel Creek has been designated as Critical Habitat for these species. Both the steelhead and the federal endangered tidewater goby (*Eucyclogobius newberryi*) also have been collected intermittently in Soquel Creek. Refer to Appendix A for further description of these biological resources.

City well production is limited to the summer/fall months (approximately April 15 to November 15), and, thus, would not be expected to affect winter and spring flows in Soquel Creek. Because potential drawdown

would occur during the summer and fall, operation of the Proposed Project would not be expected to affect the migration and spawning of steelhead because steelhead adults migrate upstream primarily from December through April and smolts migrate downstream primarily from March through May (Sogard et al 2009). However, the lower portions of Soquel Creek and especially Soquel Creek Lagoon provide important summer rearing habitat for juvenile steelhead (Alley and Associates 2003, 2004). The lagoon typically produces 10 to 35 percent of the smolt-sized juveniles in the mainstem of Soquel Creek each year (Alley and Associates 2004). Steelhead populations in Soquel Creek lagoon are threatened by inadequate stream inflow in summer during drought years (Alley and Associates 2004). A hydrogeological study calculating potential streamflow losses from Proposed Project is being prepared and this issue will be analyzed in the EIR.

Further Study Required: The EIR will include further study related to the potential for stream flow losses in Soquel Creek and Soquel Creek Lagoon from the Proposed Project.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
5. CULTURAL RESOURCES				
Would the project:				
a. Cause a substantial adverse change in the significance of a historical resource as defined in §15064.5?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. Cause a substantial adverse change in the significance of an archaeological resource pursuant to §15064.5?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
c. Directly or indirectly destroy a unique paleontological resource or site or unique geologic feature?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Disturb any human remains, including those interred outside of formal cemeteries?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Discussion

(a-c) The Northwest Information Center (NWIC), Sonoma State University, Rohnert Park, California has conducted a cultural resources records search (NWIC File No. 09-1232) for the subject property in Santa Cruz, California (Appendix B). The purpose of this review was to examine any existing cultural resources survey reports, archaeological site records, and historic maps to determine whether previously documented prehistoric or historic archaeological sites, architectural resources, cultural landscapes, or ethnic resources exist within or adjacent to the project area. The record search/literature review was also conducted to determine whether any historic properties listed on or determined eligible for listing on the National Register of Historic Places (NRHP) or California Register of Historical Resources (CRHR) exist within the project area.

There have been 26 cultural studies conducted within a ½ mile radius of the subject property. These consisted primarily of block surveys for parcels of various sizes. As a result of these studies, four archaeological sites have been recorded within a ½ mile radius of the subject property. Two of these sites are multi-component sites with prehistoric remains and historic residential remains. The remaining two are historic residential archaeological sites.

NWIC provided a list of addresses for known historic properties within a ½ mile radius of the subject property. A review of the streets, particularly Cory Street, indicated no historic structures are listed in the vicinity of the Proposed Project site. No properties listed as a California Landmark are within a ½ mile radius of the Proposed Project site.

No archaeological resources were identified during the records search for this project. However, there is a low potential to encounter cultural resources materials during ground-disturbing construction activities. A less than significant impact would occur because the Proposed Project includes minimization measures requiring that, in the event a cultural resource (i.e., historic or prehistoric artifact, fossilized shell, or bone) is discovered during ground-disturbing activities, all work be stopped within 100 feet and County planning staff and archaeologist be contacted to determine appropriate action (see Measure to Project Previously Unknown Cultural Resources and Human Remains” in Section G, Environmental Measures). No further study of this issue is required.

Fossils are paleontological resources that may exist in sedimentary and cool volcanic flow rocks and are considered to be a non-renewable resource by the Society of Vertebrate Paleontology. The Proposed Project site does not fall within an area sensitive for paleontological resources or fossils. With the implementation of the previously described minimization measure, a less than significant impact would occur in the event that a paleontological resource is discovered during ground-disturbing activities. No further study of this issue is required.

(d) The Proposed Project site does not contain any known human remains and there are no known cemeteries within the Project area. With the implementation of the previously described minimization measure, a less than significant impact would occur in the event that human remains are discovered during ground-disturbing activities. No further study of this issue is required.

Further Study Required: Further evaluation of the potential cultural resources impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
--	---	---	--	----------------------

6. GEOLOGY AND SOILS

Would the project:

a. Expose people or structures to potential substantial adverse effects, including the risk of loss, injury, or death involving:

i) Rupture of a known earthquake fault, as delineated on the most recent Alquist-Priolo Earthquake Fault Zoning Map issued by the State Geologist for the area or based on other substantial evidence of a known fault? Refer to Division of Mines and Geology Special Publication 42.

	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
--	--------------------------	--------------------------	-------------------------------------	--------------------------

ii) Strong seismic ground shaking?

	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
--	--------------------------	--------------------------	-------------------------------------	--------------------------

iii) Seismic related ground failure, including liquefaction?

	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
--	--------------------------	--------------------------	-------------------------------------	--------------------------

iv) Landslides?

	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
--	--------------------------	--------------------------	-------------------------------------	--------------------------

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
b. Result in substantial soil erosion or the loss of topsoil?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
c. Be located on a geologic unit or soil that is unstable, or that would become unstable as a result of the project, and potentially result in on, or off, site landslide, lateral spreading, subsidence, liquefaction or collapse?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Be located on expansive soil, as defined in Table 18-1-B of the Uniform Building Code (1994), creating substantial risks to life or property?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
e. Have soils incapable of adequately supporting the use of septic tanks or alternative wastewater disposal systems where sewers are not available for the disposal of wastewater?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Discussion

(a, c, d) Seismic and Geologic Hazards. Northern California is a seismically active region that is prone to earthquakes. The Proposed Project site is located near the Coastal Range Geologic Province, and in the vicinity of active earthquake faults. The site is located near, but not within, designated Alquist Priolo Earthquake Fault Zones, Loma Prieta and Laurel. The Vergeles Fault and the San Andreas Fault are located to the northeast of the Proposed Project site. Therefore, the site is located in an area that may be subject to strong seismic ground shaking. However, the site is located approximately 52 miles away from the nearest County designated fault zone. The Proposed Project site has a low potential for seismic related ground failure, liquefaction, and landslides (County of Santa Cruz, 2002). Additionally, the Proposed Project would be designed in accordance with the California Building Code (CBC) for the peak site ground acceleration. Since the design and construction of the project would conform to the specific mandated structural design requirements to protect against strong seismic shaking, the potential impacts due to strong seismic shaking are less than significant. No further study of this issue is required.

(b, e) Soils and Erosion. The Proposed Project would not result in substantial soil erosion or the loss of topsoil. Although short-term impacts would normally occur during trenching and other construction work, the area involved is less than one acre. Construction activities would result in a minor amount of soil disturbance. If soil is not contained and is directly exposed to rain, soil erosion and sediment could flow off-site. This impact is considered less than significant because erosion and sediment control measures would be implemented as part of the project (see “Measures to Protect Water Quality” in Section G, Environmental Measures). No further study of this issue is required.

The Proposed Project would not result in new or increased demand for the use of septic tanks or alternative wastewater disposal systems. No impact would occur and no further study of this issue is required.

Further Study Required: Further evaluation of the potential geology impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
--	---	---	--	----------------------

7. GREENHOUSE GAS EMISSIONS

Would the project:

- | | | | | |
|--|--------------------------|--------------------------|-------------------------------------|--------------------------|
| a. Generate greenhouse gas emissions, either directly or indirectly, that may have a significant impact on the environment? | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| b. Conflict with an applicable plan, policy or regulation adopted for the purpose of reducing the emissions of greenhouse gases? | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

Discussion:

Setting

No air district or other regulatory agency in California has identified a significance threshold for Greenhouse Gas (GHG) Emissions generated by a Proposed Project, or a methodology for analyzing impacts related to GHG emissions or global climate change. By adoption of AB 32 and SB 97; however, the State of California has established GHG reduction targets and has determined that GHG emissions as they relate to global climate change are a source of adverse environmental impacts in California. AB 32, California Climate Solutions Act of 2006 (See Statutes 2006, Chapter 488, enacting Health & Safety Code, Sections 38500–38599), establishes regulatory, reporting, and market mechanisms to achieve quantifiable reductions in GHG emissions and a cap on statewide GHG emissions.

AB 32 includes language identifying the various environmental problems in California caused by global warming (Health & Safety Code, Section 38501[a]). SB 97 acknowledges that climate change is a prominent environmental issue that requires analysis under CEQA and the Governor’s Office of Planning and Research to prepare State CEQA Guidelines revisions addressing the mitigation of GHGs or their consequences (Statutes 2007, Chapter 185 enacting Public Resources Code Sections 21083.05 and 21097). While the text of AB 32 focuses on major stationary and area sources of GHG emissions, the primary objective of AB 32 is to reduce California’s contribution to global climate change by reducing California’s total annual production of GHG emissions. To meet GHG emission targets of AB 32, California would need to generate less GHG emissions than current levels.

The proper context for addressing the issue in a CEQA document is the discussion of cumulative impacts, since the emissions of one single project would not cause global climate change, but GHG emissions from multiple projects throughout the world could result in a cumulative impact concerning global climate change. It is recognized, however, that for most projects no simple metric is available to determine if a single project would substantially increase or decrease overall GHG emission levels or conflict with the goals of AB 32.

The impact that GHG emissions have on global climate change does not depend on whether the emissions were generated by stationary, mobile, or area sources, or whether they were generated in one region or another. Thus, consistency with the state’s requirements for GHG emissions reductions is the best metric for determining whether the proposed project would contribute to global warming. In the case of the proposed project, if the project substantially impairs the state’s ability to conform with the mandate to reduce GHG emissions to 1990 levels by the year 2020, then the impact of the project would be cumulatively considerable (i.e., significant).

Impacts

(a) GHG emissions generated during construction and operation of the proposed project would predominantly be in the form of CO₂. In comparison to criteria air pollutants, such as ozone and PM₁₀, CO₂, and other GHG emissions persist in the atmosphere for a much longer period of time. GHG sources associated with construction activities of the project would include the operation of off-road construction equipment, worker vehicle trips, and trips by haul trucks bringing materials to the sites. While GHG emissions generated by these construction activities may be considered new, they would be temporary in nature and would not be considered substantial given the project’s small size.

New long-term operational-GHG emissions associated with the proposed project would be generated by daily vehicle trips during operation of Beltz Well No. 12. As stated previously, operation of the proposed project will not result in pollutant levels that exceed criteria pollutant standards, nor will the project contribute substantially to cumulative air quality impacts. GHG emissions associated with project operations would be less than significant. No further study of this issue is required.

(b) There have been significant legislative and regulatory activities that directly and indirectly affect climate change and GHGs in California. The primary climate change legislation in California is AB 32, the California Global Warming Solutions Act of 2006. AB 32 focuses on reducing GHG emissions in California and AB 32 requires that GHGs emitted in California be reduced to 1990 levels by the year 2020.

The CARB is the state agency charged with monitoring and regulating sources of emissions of GHGs in California that contribute global warming in order to reduce emissions of GHGs. The CARB Governing Board approved the 1990 GHG emissions level of 427 million metric tons of CO₂ equivalent (MMTCO_{2e}) on December 6, 2007. Therefore, in 2020, annual emissions in California are required to be at or below 427 MMTCO_{2e}. The CARB Board approved the Climate Change Scoping Plan (Scoping Plan) in December 2008. The Scoping Plan “proposes a comprehensive set of actions designed to reduce overall GHG emissions in California, improve our environment, reduce our dependence on oil, diversify our energy sources, save energy, create new jobs, and enhance public health” (CARB 2008). The measures in the Scoping Plan will be developed over the next two years through rule development at the CARB and other agencies and are expected to be in place by 2012.

As stated previously, project generated construction and operational GHG emissions would be marginal and therefore, the project would not conflict with an applicable plan, policy or regulation adopted for the purpose of reducing the emissions of greenhouse gases. No further study of this issue is required.

Further Study Required: Further evaluation of the potential GHG impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
8. HAZARDS AND HAZARDOUS MATERIALS				
Would the project:				
a. Create a significant hazard to the public or the environment through the routine transport, use, or disposal of hazardous materials?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. Create a significant hazard to the public or the environment through reasonably foreseeable upset and accident conditions involving the release of hazardous materials	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
into the environment?				
c. Emit hazardous emissions or handle hazardous or acutely hazardous materials, substances, or waste within one-quarter mile of an existing or proposed school?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
d. Be located on a site which is included on a list of hazardous materials sites compiled pursuant to Government Code Section 65962.5 and, as a result, would it create a significant hazard to the public or the environment?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
e. For a project located within an airport land use plan or, where such a plan has not been adopted, within two miles of a public airport or public use airport, would the project result in a safety hazard for people residing or working in the project area?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
f. For a project within the vicinity of a private airstrip, would the project result in a safety hazard for people residing or working in the project area?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
g. Impair implementation of or physically interfere with an adopted emergency response plan or emergency evacuation plan?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
h. Expose people or structures to a significant risk of loss, injury or death involving wildland fires, including where wildlands are adjacent to urbanized areas or where residences are intermixed with wildlands?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Discussion

(a) Material that is transported, stored, or disposed of during project construction and operation has the potential to contain hazardous materials and could present a hazard to construction workers, the public, or the environment if improperly managed. Vehicles and equipment used for construction would contain or require the temporary, short-term use of potentially hazardous substances, such as fuels, lubricating oils, and hydraulic fluid. Additionally, chemicals proposed to be onsite include sodium hypochlorite, used as a disinfectant for the finished water and pre-treatment in the iron and manganese treatment system, and possibly potassium permanganate, which may be used for pre-treatment in the iron and manganese treatment system. The City would ensure compliance with all environmental regulations managed by the Santa Cruz County Environmental Health Services Department and the Central Fire Protection District Of Santa Cruz County. The City would ensure compliance with any applicable rules and regulations, including the State of California CCR Title 23 Health and Safety Regulations, as managed by the Santa Cruz County Environmental Health

Services Department and the Central Fire Protection District Of Santa Cruz County. No significant impacts would occur and therefore, no further study of this issue is required.

(b) No significant risk of accidental upset or the release of hazardous substances is anticipated. The City will ensure compliance with applicable rules and regulations to reduce potential impacts relative to hazardous materials to less than significant levels. No further study of this issue is required.

(c) The nearest school to the Proposed Project site is Kinder Cottage, a privately owned child care center, and it is located approximately 0.25 mile south of the Proposed Project site, on the opposite side of CA-1. Other schools in the area include Good Shepherd Catholic located approximately 0.36 mile to the west, The Bay School located approximately 0.49 mile to the west, Soquel High School located approximately 0.56 mile to the east, and Soquel Elementary School located approximately 0.65 mile to the east. The Proposed Project is not anticipated to result in a release of hazardous emissions, hazardous or acutely hazardous material, or substances in the vicinity of sensitive receptors due to implementation of standard operational procedures and protocols, as well as BMPs. No significant impacts are expected and no further study of this issue is required.

(d) A Phase I Environmental Assessment was conducted for the Proposed Project (Atlas, Appendix C). This included a review of federal and state standard and supplemental databases to identify hazardous material sites pursuant to Government Code Section 65962.5 within one mile of the Proposed Project site; as well as review of local records, such as Santa Cruz County Environmental Health Services Hazardous Materials Files. A government records and public documents search conducted by Environmental Data Resources, Inc. (EDR), an environmental database service, did not identify the site as being on any environmental lists. The search identified 23 properties within one mile of the site listed on at least one of the databases searched (discounting redundant listings). The databases searched included, but was not limited to: the Federal National Priority List, the Federal CERCLIS (Comprehensive Environmental Response Compensation, and Liability Information System) list, Federal institutional controls / engineering controls registries, State and tribal landfill and/or solid waste disposal site lists, State and tribal leaking storage tank lists, State and tribal registered storage tank lists, and local lists of hazardous waste / contaminated sites.

The State Water Resources Control Board Geotracker (Geotracker) is an internet based database of leaking underground storage tank cleanup sites, other cleanup sites (e.g. solvents or metals), land disposal sites, military cleanup sites, and permitted underground storage tank sites. A search of the Geotracker database listed 27 sites, 20 closed and 7 active, within 1,000 feet of the Proposed Project site. The Proposed Project site was not listed.

Of the sites identified through the environmental database search and the Geotracker search, the Phase I Environmental Assessment determined that only one site, a Leaking Underground Fuel Tank (LUFT) site at 2178 41st Avenue, had the potential to impact the Proposed Project's water supply.

The LUFT site at 2178 41st Avenue may pose a risk to the quality of water pumped from a water supply well constructed on the Proposed Project site. A site inspection and environmental assessment field checklist were completed by Atlas on July 1, 2009. Upon inspection of the site, it was noted that there was no evidence to suggest that the site has a potentially significant environmental condition. Based on the recommendation in the Phase I report, a capture zone analysis was conducted to determine the likelihood of petroleum hydrocarbons from the LUFT site entering the well during production (Appendix D). The analysis calculated the capture zone for pumping Beltz Well No. 12 at the maximum production rate of 800 GPM to determine if the LUFT site is within the capture zone. Based on the analysis, it was determined that the LUFT site located at 2178 41st Avenue does not pose a potentially significant environmental condition that could impact the use of the site for a drinking water well for the following reasons:

- The LUFT site is outside of the Proposed Project's capture zone. Groundwater outside of the well site capture zone would not drain into the proposed well.
- The contamination is much shallower than the depth of the proposed well perforations.
- The groundwater at the LUFT site flows away from the Proposed Project site.

No significant impacts would occur and therefore, no further study of this issue is required.

(e) The Proposed Project site is located approximately 10.4 miles northwest of the Watsonville Municipal Airport and would not result in a safety hazard for people working in the project area. Therefore, no impacts related to public airports would occur. No further study of this issue is required.

(f) The nearest private airstrip is in the unincorporated community of Bonny Doon, approximately 10.6 miles northwest of the Proposed Project site. No impact would occur and no further study of this issue is required.

(g) The Proposed Project would not interfere with emergency response plans or operations near the Proposed Project site. Very limited construction in Research Park Drive, in order to make connections to existing pipelines (water, sanitary sewer, stormdrain) would result in a less than significant impacts to emergency vehicle operations because the City would implement a traffic control plan (see “Measures to Control and Minimize Effects of Construction Traffic” in Section G, Environmental Measures). No further study of this issue is required.

(h) The Proposed Project site is not located in an area of the County that is subject to the risk of wildland fire (County of Santa Cruz 2002). All construction and operation activities would be conducted in compliance with standard safety protocols, which would minimize the potential release of flammable materials (including fuel, lubricants, paint, and solvents). No significant impacts are expected and no further study of this issue is required.

Further Study Required: Further evaluation of the potential hazards and hazardous materials impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
9. HYDROLOGY AND WATER QUALITY				
Would the project:				
a. Violate any water quality standards or waste discharge requirements?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. Substantially deplete groundwater supplies or interfere substantially with groundwater recharge such that there would be a net deficit in aquifer volume or a lowering of the local groundwater table level (e.g., the production rate of pre-existing nearby wells would drop to a level which would not support existing land uses or planned uses for which permits have been granted)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. Substantially alter the existing drainage pattern of the site or area, including through the alteration of the course of a stream or river, in a manner which would result in substantial erosion or siltation on- or off-site?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Substantially alter the existing drainage	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
pattern of the site or area, including through the alteration of the course of a stream or river, or substantially increase the rate or amount of surface runoff in a manner which would result in flooding on- or off- site?				
e. Create or contribute runoff water which would exceed the capacity of existing or planned stormwater drainage systems or provide substantial additional sources of polluted runoff?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
f. Otherwise substantially degrade water quality?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
g. Place housing within a 100-year flood hazard area as mapped on a federal Flood Hazard Boundary or Flood Insurance Rate Map or other flood hazard delineation map?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
h. Place within a 100-year flood hazard area structures which would impede or redirect flood flows?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
i. Expose people or structures to a significant risk of loss, injury or death involving flooding, including flooding as a result of the failure of a levee or dam?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
j. Inundation by seiche, tsunami, or mudflow?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Discussion

(a, e, f) Water Quality.

Construction.

Construction activities would result in a minor amount of soil disturbance. If soil is not contained and is directly exposed to rain, soil erosion and sediment could flow into the storm drain system, resulting in the potential degradation of water quality. This impact is considered less than significant because erosion and sediment control measures would be implemented as part of the project (see “Measures to Protect Water Quality” in Section G, Environmental Measures).

Well hole excavation would generate drill cuttings, drilling fluids and mud. These materials will not be discharged in the storm drain system, but would be hauled offsite for disposal. A staging area would be located on the Proposed Project site to contain drill cuttings, and drilling fluids and mud, and store construction equipment and materials. Drill cuttings and mud would ultimately be disposed of offsite, in accordance with state laws, at an appropriate disposal facility. Drilling fluids would be removed, as necessary, during construction using a qualified truck service and disposed of at a facility licensed to handle non-toxic and non-hazardous liquid waste.

Water generated during well development and aquifer testing will be discharged into the storm drain in Research Park Drive and conveyed to Rodeo Gulch Creek. During well development a rubber packer assembly is hoisted up and down to swab the gravel envelope to remove sand, silt, and mud from the screened sections of the well. Typically this produces turbid water at a rate of approximately 100 to 200 GPM for up to 30 hours. Well development also requires pumping flows that are gradually increased to the maximum pumping rate of the well (approximately 1,000 GPM), which is anticipated to take approximately 40 hours. Each time the pumping rate is increased, turbid water is produced. Aquifer testing will include a 10 hour step draw-down test with discharge rates increasing up to approximately 1,000 GPM, followed by a 24 hour constant rate pumping test with a discharge rate of approximately 700 GPM. Water discharged from aquifer testing is not anticipated to be turbid.

Construction discharges into the storm drain system containing excessive levels of turbidity could degrade the quality of Rodeo Gulch Creek. Prior to construction of the Proposed Project the City will acquire a NPDES General Permit for Discharges with Low Threat to Water Quality from the Central Coast Regional Water Quality Control Board (CCRWQCB). As part of the permitting process, the City will design and implement a plan to treat water extracted for well development and aquifer testing prior to discharge into the storm drain system. Treatment of water shall occur as required to reduce turbidity to levels that protect the beneficial uses of Rodeo Gulch Creek, as outlined in the CCRWQCB Basin Plan. Monitoring/sampling of extracted water will occur prior to discharge, as needed to ensure turbidity level objectives are met. If turbidity cannot be reduced to levels that protect beneficial uses of receiving waters then extracted water will be hauled offsite disposed of at a facility licensed to handle non-toxic and non-hazardous liquid waste, such as the Liquid Waste Receiving Facility at 110 California Street in the City of Santa Cruz. With the implementation of this plan, impacts involving construction discharges into the storm drain system would be less than significant. No further study of this issue is required.

Groundwater Quality

A monitoring well was constructed adjacent to the Proposed Project site in a public right of way on Cory Street (CS) and sampled to evaluate water quality prior to construction of the production well (Hopkins, 2010a, Appendix E). The CS monitoring well consisted of nested well designs that utilized 2-inch-diameter well casing and screen assemblies which ranged in depths from 110 to 350 feet bgs.

Tests results for Well CS No. 1 (deep) (AA Zone) indicate that the groundwater is of a sodium bicarbonate/sulfate chemical character and has a total dissolved solids (TDS) concentration of 670 milligrams per liter (mg/l). Results for Well CS No. 2 (middle) indicate that the groundwater is of a sodium sulfate character and has a TDS concentration of 520 mg/l. Laboratory results for Well CS No. 3 (shallow) indicate that the groundwater is of a sodium bicarbonate character and has a TDS concentration of 440 mg/l. Consistent with the quality of other groundwater locally produced from the Purisima Formation, these data indicate that the groundwater will need to be treated to reduce the concentration of iron and manganese prior to distribution for municipal use. The water quality results for Well CS No. 3 (shallow) showed positive results of low concentrations of organic analyses for benzene, chloroform, and total trihalomethanes. Upon re-testing, no organics were detected (MWH Laboratories, 2010, Appendix E). The initial positive results are expected to have resulted from residual of components from previous testing conducted by the well contractor or laboratory error (i.e., poor decontamination clean-up of equipment).

In summary, the Title 22 water quality test results obtained during this study indicate that the potential aquifer zone(s) available for production will be of suitable quality for use as a drinking water supply (Hopkins, 2010a). Available data indicates that the water may be of a slightly better quality than the groundwater produced from the City's current well facilities in the Live Oak area (Hopkins, 2004) and (Fugro, 1998). No significant impacts are expected. No further study of this issue is required.

Operation.

During operation, the iron and manganese removed through the treatment system is piped to the backwash tank. In this tank, the iron and manganese settles out from the groundwater. The backwash water will be piped to the County sanitary sewer line located immediately adjacent to the Proposed Project site in Research Park Drive and the remaining sludge will be transported and disposed of offsite, in accordance with state laws, at an appropriate disposal facility. The City will obtain the necessary approval from Santa Cruz County Sanitation to discharge groundwater into the sanitary sewer system. There would be no discharge of backwash materials into storm drains, and therefore, no significant impact would occur. No further study of this issue is required.

(b) Groundwater. Historically the City has operated the Live Oak well field at 1 MGD during normal years and up to 2 MGD (1,500 GPM) during drought years, however, the City currently has the production capacity to extract only 1,055 GPM from the Live Oak well field (SCWD, 2006). Development of new wells in the Live Oak well field to restore the historical production rate during a drought (1,500 GPM) would contribute to decreasing groundwater levels near the coast in the Purisima aquifer and would contribute to conditions conducive to seawater intrusion. A recent study of hydrogeologic conditions in the area completed by the City concluded that new production wells developed by the City should be shifted inland from the existing Live Oak well field in an effort to control groundwater levels and protect the Purisima aquifer from seawater intrusion (Hopkins, 2009).

The Proposed Project is located approximately 1.5 miles inland and northeast of the coastal Live Oak well field and within the Purisima aquifer of the Soquel-Aptos Groundwater Basin. The Proposed Project involves the installation of Beltz Well No. 12 in order to augment the existing supply and recover the lost capacity from the existing or destroyed wells. Beltz Well No. 12 will be installed to regain the City's historic groundwater production rates from the Purisima aquifer, which was impacted by the loss of Beltz Well No. 4. While Beltz Well No. 12 would produce up to 700 GPM, the City would limit aggregate production from this well and the existing wells in the Live Oak well field to the historic normal year extraction rate of 1 MGD. The Proposed Project would result in groundwater extraction consistent with the City's Integrated Water Plan (2005). Groundwater extracted from Beltz Well No.12 would be from the same zone of the Purisima aquifer as the existing Live Oak well field and Beltz Well No. 4. Monitoring of coastal groundwater levels will continue after development of Beltz Well No. 12.

A hydrogeological analysis is being prepared and this issue will be analyzed in the EIR.

(c, d) Drainage. The Proposed Project would be located on a currently undeveloped parcel, with much of the installation occurring underground. Only minor site grading would occur and only a small portion of the 0.74 acre site would be covered with impervious surfaces. This small increase in impervious surfaces would not result in a significant change in drainage patterns or the amount of surface runoff. No significant impact associated with drainage patterns, flooding on- or offsite, or stormwater drainage systems would occur. The Proposed Project would not otherwise degrade water quality. No significant impact would occur and no further study of this issue is required.

(g-h) Flood Hazards. The Proposed Project does not involve the construction of housing. Therefore, no housing would be constructed within a 100-year flood hazard area as a result of the Proposed Project. No impact would occur. The Proposed Project would not involve the construction of structures that would impede or redirect flood flows. No impact would occur and no further study of this issue is required.

(i-j) Dam Failure/Tsunami Inundation. The Proposed Project site is in an area with no potential for hazard of inundation from failure of local dams, seiche, or mudflow. No significant impact would occur.

Although the Proposed Project site is located in a coastal region, the area has little to no potential for being exposed to inundation by a tsunami. In addition the well will be capped and underground and any inundation

would have minimal impact on the well. No significant impact would occur and no further study of this issue is required.

Further Study Required: The EIR will include further study related to groundwater supplies or recharge.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
10. LAND USE AND PLANNING				
Would the project:				
a. Physically divide an established community?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
b. Conflict with any applicable land use plan, policy, or regulation of an agency with jurisdiction over the project (including, but not limited to the general plan, specific plan, local coastal program, or zoning ordinance) adopted for the purpose of avoiding or mitigating an environmental effect?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
c. Conflict with any applicable habitat conservation plan or natural community conservation plan?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Discussion

(a) The Proposed Project involves the addition of a water well on a small undeveloped parcel. The surrounding area is developed with commercial and light industrial land uses. The Proposed Project would not physically divide an established community. No impact would occur and no further study of this issue is required.

(b) The Proposed Project site involves the addition of a water well and associated facilities to a currently undeveloped parcel and would be compatible with existing County of Santa Cruz Zoning and General Plan designations of (CS) Service Commercial and M-1 (Light Industry) under the Santa Cruz County general plan and zoning designations. The Proposed Project is considered consistent with these designations, as well as relevant policies in the County General Plan and Local Coastal Program (LCP) (Santa Cruz County 1994), including those listed below.

- Public facility uses are allowed in all urban residential land use designation and zoning districts, as well as limited public facility uses in commercial designations and districts (Policy 2.21.2).
- All new and rehabilitated wells shall be required to comply with state and local construction standards, as specified in the County well ordinance, to prevent contamination of groundwater supplies (5.8.6 LCP). Well construction involving multiple zone completions will be provided with intermediate bentonite and neat cement seals to separate the discrete monitoring depths. These measures will mitigate the potential for abandoned wells to become a source groundwater contamination and prevent water quality degradation.
- Water system improvement programs for storage, treatment, and distribution facilities shall be supported to meet necessary water supply and fire suppression requirements (7.18.4 LCP).

No impact would occur and no further study of this issue is required.

(c) The Proposed Project site is not located in a habitat conservation plan; natural community conservation plan; or any other local, regional, or state habitat conservation plan. No impact would occur and no further study of this issue is required.

Further Study Required: Further evaluation of the potential land use impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
11. MINERAL RESOURCES				
Would the project:				
a. Result in the loss of availability of a known mineral resource that would be of value to the region and the residents of the state?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
b. Result in the loss of availability of a locally-important mineral resource recovery site delineated on a local general plan, specific plan or other land use plan?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Discussion:

(a, b) The Proposed Project site is not identified as being within a significant resource zone in the County’s General Plan. As such, the construction of the replacement water well on a currently undeveloped parcel would not interfere with mineral resource extraction. The Proposed Project would be limited to a small area under an acre in size and would not result in the loss of availability of a known or locally important resource. No mineral resource extraction would occur as part of the Proposed Project. No impact would occur and no further study of this issue is required.

Further Study Required: Further evaluation of the potential mineral resources impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
12. NOISE				
Would the project result in:				
a. Exposure of persons to or generation of noise levels in excess of standards established in the local general plan or noise ordinance, or applicable standards of other agencies?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. Exposure of persons to or generation of excessive ground borne vibration or ground borne noise levels?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
c. A substantial permanent increase in ambient noise levels in the project vicinity above levels existing without the project?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
d. A substantial temporary or periodic increase in ambient noise levels in the project vicinity	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
above levels existing without the project?				
e. For a project located within an airport land use plan or, where such a plan has not been adopted, within two miles of a public airport or public use airport, would the project expose people residing or working in the project area to excessive noise levels?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
f. For a project within the vicinity of a private airstrip, would the project expose people residing or working in the project area to excessive noise levels?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Discussion:

The project site is within an urban area and there are no adjacent land uses that are traditionally considered as “sensitive” to noise (schools, libraries, churches, hospitals, and residential uses). The County of Santa Cruz General Plan Noise Element does however, have noise thresholds and guidelines to protect commercial and office land uses which are adjacent to the proposed project site. These are presented in the Land Use Compatibility for Community Noise Environments table and the Maximum Allowable Noise Exposure for Stationary Sources table.

The County of Santa Cruz General Plan Noise Element Land Use Compatibility table recommends that the normally acceptable noise level range for the exterior of office and commercial buildings be 50-60 CNEL. CNEL (Community Noise Equivalent Level) is a weighted, 24-hour average noise descriptor. Exterior noise levels of up to 80 CNEL are considered acceptable with noise reduction measures considered.

Table 2. Land Use Compatibility for Community Noise Environments

	Normally Acceptable	Conditionally Acceptable	Unacceptable
Office Buildings, Business Commercial, and Professional	50-60 CNEL	60-80 CNEL	80+ CNEL

Source: Modified from County of Santa Cruz General Plan Noise Element

The County of Santa Cruz General Plan Noise Element also includes maximum allowable noise exposure standards for stationary noise sources (below). Maximum hourly noise exposure due to project noise is not to exceed 50 Leq (Equivalent Continuous Noise Level) during the daytime and not to exceed 45 Leq during the nighttime. Maximum noise events are not to exceed 70 dB during the daytime and not to exceed 65 dB during the night; and impulsive noise is not to exceed 65 dB during the daytime and not to exceed 60 dB during the nighttime.

Table 3. Maximum Allowable Noise Exposure, Stationary Noise Sources

Maximum Allowable Noise Exposure Stationary Noise Sources⁽¹⁾		
	Daytime ⁽²⁾ (7 PM to 10 PM)	Nighttime (10 PM to 7 AM)
Hourly Leq-average hourly noise level, dB	50	45
Maximum Level, dB	70	65
Maximum Level dB - Impulsive Noise	65	60

dB = decibel

(1) As determined at the property line of the receiving land use. When determining the effectiveness of noise mitigation measures, the standards may be applied on the receptor side of noise barriers or other property line noise mitigation measures.

(2) Allowable levels shall be raised to the ambient noise levels where the ambient levels exceed the allowable levels. Allowable levels shall be reduced 5 dB if the ambient hourly Leq is at least 10 dB lower than the allowable level.

Source: Modified from County of Santa Cruz General Plan Noise Element

Impacts

(a, c, d)

Construction Noise

Land Uses Compatibility. As shown in Table 6 below, construction of the proposed project will generate noise levels that will generally range between 74 and 90 dBA Leq at the property line. These noise levels would result in a temporary noise level increase above ambient noise levels and would also exceed Stationary Noise Standards presented in the County of Santa Cruz General Plan Noise Element and may also occasionally exceed 24-hour average noise level standards presented in the General Plan Land Use Compatibility Guidelines.

Table 4. Typical Construction Equipment Noise Levels

Typical Construction Equipment Noise Levels		
Type of Equipment	Range of Maximum Sound Levels Measured (dBA at 50 ft.)	Suggested Maximum Sound Levels for Analysis (dBA at 50 ft.)
Rock Drills	83-99	96
Jack Hammers	75-85	82
Pneumatic Tools	78-88	85
Pumps	74-84	80
Dozers	77-90	85
Scrapers	83-91	87
Haul Trucks	83-94	88
Cranes	79-86	82
Portable Generators	71-87	80
Rollers	75-82	80
Tractors	77-82	80
Front-End Loaders	77-90	86

Typical Construction Equipment Noise Levels		
Type of Equipment	Range of Maximum Sound Levels Measured (dBA at 50 ft.)	Suggested Maximum Sound Levels for Analysis (dBA at 50 ft.)
Hydraulic Backhoe	81-90	86
Hydraulic Excavators	81-90	86
Graders	79-89	86
Air Compressors	76-89	86
Trucks	81-87	86

Construction activities would result in less than significant impacts to noise because the City would implement noise minimization measures (see “Measures to Control and Minimize Effects of Construction-related Noise” in Section G, Environmental Measures). No further study of this issue is required.

Operational Noise

Operation of the proposed project is not expected to exceed either the Land Use Compatibility Guidelines or the Stationary Noise Standards presented in the County of Santa Cruz General Plan Noise Element nor will it result in significant long term increases in ambient noise levels. Noise from the well itself is expected to be below ambient levels and the proposed pump and appurtenances are proposed to be within a block brick enclosure. This type of enclosure is expected to provide approximately 20 dB of noise reduction. No significant operational noise impacts are expected and no further study of this issue is required.

(b) Groundborne Vibration

Ground-borne vibration is an oscillatory motion that is often described by the average amplitude of its velocity in inches per second or more specifically, peak particle velocity. Ground-borne vibration is much less common than airborne noise; the ambient peak particle velocity of a residential area is commonly .0003 inches per second or less, well below the threshold of human perception of .0059 inches per second. Nonetheless, human reactions to vibration are highly subjective, and even levels below the threshold can cause minor annoyances like rattling of dishes, doors, or fixtures.

Table 7 shows the peak particle velocities of some common construction equipment. The most vibration-causing piece of equipment that may be used on-site is the vibratory roller. This machine can cause vibration strong enough to annoy people over 100 feet away. Still, ground vibration is attenuated by distance even faster than noise and the majority of construction will take place more than 100 feet away from sensitive receptors. The proposed project will not result in excessive groundborne vibration or noise. No significant impact would occur and no further study of this issue is required.

Table 5. Typical Construction Equipment Vibration Emissions

Typical Construction Equipment Vibration Emissions			
Equipment	Peak Particle Velocity in inches per second ²		
	at 25 ft.	at 50 ft.	At 100 ft.
Clam Shovel Drop (slurry wall)	0.202	0.143	0.101
Vibratory Roller	0.210	0.0148	0.105
Hoe Ram	0.089	0.063	0.045
Large Bulldozer	0.089	0.063	0.045
Caisson Drilling	0.089	0.063	0.045
Loaded Trucks	0.076	0.054	0.038
Jackhammer	0.035	0.025	0.018
Small Bulldozer	0.003	0.002	0.002

(e-f) The project area is not located within two miles of a public airport. The project site is located 12 miles northwest of the Watsonville Municipal Airport. Therefore, the proposed project would not expose people residing or working in the surrounding area to excessive levels of airport-generated noise, and no impacts would occur. No further study of this issue is required.

Further Study Required: Further evaluation of the potential noise impacts is not required.

Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
---------------------------------------	---	-------------------------------------	------------------

13. POPULATION AND HOUSING

Would the project:

- | | | | | |
|---|--------------------------|--------------------------|--------------------------|-------------------------------------|
| a. Induce substantial population growth in an area, either directly (for example, by proposing new homes and businesses) or indirectly (for example, through extension of roads or other infrastructure)? | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| b. Displace substantial numbers of existing housing, necessitating the construction of replacement housing elsewhere? | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| c. Displace substantial numbers of people, necessitating the construction of replacement housing elsewhere? | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |

Discussion

(a) Population Growth. The Proposed Project does not provide housing. The Proposed Project involves installation of a well to support an existing potable water system but does not involve the expansion of the service. The Proposed Project will improve system reliability and flexibility by replacing Beltz Well No. 4. It will continue to serve the City of Santa Cruz, some unincorporated areas of Santa Cruz County, a small part

of the City of Capitola, and several agricultural customers along Highway 1 between the City limits and the town of Davenport. No impact would occur and no further study of this issue is required.

(b-c) Removal of Housing and/or Displacement of Residents. The installation of Beltz Well No. 12 is taking place on an undeveloped parcel in a commercially zoned area. The Proposed Project would not displace any existing housing units, necessitating the construction of replacement housing elsewhere. No impact would occur.

The Proposed Project involves a well installation to support an existing water system. The Proposed Project would not displace any people, necessitating the construction of replacement housing elsewhere. No impact would occur and no further study of this issue is required.

Further Study Required: Further evaluation of the potential population and housing impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
14. PUBLIC SERVICES				
Would the project result in substantial adverse physical impacts associated with the provision of new or physically altered governmental facilities, need for new or physically altered governmental facilities, the construction of which could cause significant environmental impacts, in order to maintain acceptable service ratios, response times or other performance objectives for any of the public services:				
a. Fire protection?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. Police protection?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
c. Schools?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Parks?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
e. Other public facilities?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Discussion

(a-e) The Proposed Project involves the installation of a well to support an existing water system. The project would not increase the demand for fire and police protection, schools, parks, or other public facilities. Further, the project would not induce growth requiring the extension of existing services or creation of new services.

Very limited construction in Research Park Drive, in order to make connections to existing pipelines (water, sanitary sewer, stormdrain) would result in a less than significant impacts to emergency vehicle operations because the City would implement a traffic control plan (see “Measures to Control and Minimize Effects of Construction Traffic” in Section G, Environmental Measures).

No significant impacts would occur and no further study of this issue is required.

Further Study Required: Further evaluation of the potential public facilities impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
15. RECREATION				
Would the project:				
a. Increase the use of existing neighborhood and regional parks or other recreational facilities such that substantial physical deterioration of the facility would occur or be accelerated?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
b. Include recreational facilities or require the construction or expansion of recreational facilities, which might have an adverse physical effect on the environment?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Discussion

(a) The Proposed Project does not involve uses that would contribute to the increase use of existing neighborhood and regional parks or other recreational facilities such as substantial physical deterioration of the facility. No impact would occur and no further study of this issue is required.

(b) The Proposed Project does not include or require recreational facilities. No impact would occur and no further study of this issue is required.

Further Study Required: Further evaluation of the potential population and housing impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
16. TRANSPORTATION/TRAFFIC				
Would the project:				
a. Conflict with an applicable plan, ordinance or policy establishing measures of effectiveness for the performance of the circulation system, taking into account all modes of transportation including mass transit and non-motorized travel and relevant components of the circulation system, including but not limited to intersections, streets, highways and freeways, pedestrian and bicycle paths, and mass transit?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. Conflict with an applicable congestion management program, including, but not limited to level of service standards and travel demand measures, or other standards established by the county congestion management agency for designated roads or highways?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
c. Result in a change in air traffic patterns,	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
including either an increase in traffic levels or a change in location that results in substantial safety risks?				
d. Substantially increase hazards due to a design feature (e.g., sharp curves or dangerous intersections) or incompatible uses (e.g., farm equipment)?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
e. Result in inadequate emergency access?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
f. Conflict with adopted policies, plans, or programs supporting alternative transportation (e.g., bus turnouts, bicycle racks)?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Discussion

(a-b) Implementation of the proposed project would not result in a substantial increase that would have an adverse effect on roadways, affect roadway capacity or level of service, or contribute to a cumulative effect.

Traffic-generating construction activities include a minor amount of construction and delivery vehicles traveling to the Proposed Project site. During construction, these vehicles would be staged on the Proposed Project site. There would be a temporary increase in traffic during the construction phase due to materials being moved to and from the site. Once the project is completed, the City of Santa Cruz Water Department anticipates that the staff would to visit the Proposed Project site approximately 7 days per week.

This increase in traffic would result in a less than significant impacts because the traffic increase would be minor and short term, and several measures would be implemented to minimize and control effects of traffic on local roadways (see “Measures to Control and Minimize Traffic Effects” in Section G, Environmental Measures).

The Proposed Project would install a well on an undeveloped parcel. The Proposed Project would change the existing site use, but no significant increase in site traffic volumes, if any, are anticipated to occur. No impact would occur and no further study of this issue is required.

(c) The Proposed Project would not result in a change in air traffic patterns, including either an increase in air traffic levels or location of air traffic resulting in substantial safety risks. No impact would occur and no further study of this issue is required.

(d) The Proposed Project would not create or alter roadways in a manner that would increase hazards or result in an incompatible use. No impact would occur and no further study of this issue is required.

(e) The Proposed Project would not result in inadequate emergency access. No impact would occur.

(f) The Proposed Project would have adequate parking capacity anticipated to support the City of Santa Cruz Water Department maintenance staff. No impact would occur and no further study of this issue is required.

(g) The Proposed Project would not conflict with alternative transportation. Maintenance personnel would be the only traffic generated by the project once it is operational. No impact would occur and no further study of this issue is required.

Further Study Required: Further evaluation of traffic and transportation impacts is not required.

	Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than-Significant Impact	No Impact
17. UTILITIES AND SERVICE SYSTEMS				
Would the project:				
a. Exceed wastewater treatment requirements of the applicable Regional Water Quality Control Board?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. Require or result in the construction of new water or wastewater treatment facilities or expansion of existing facilities, the construction of which could cause significant environmental effects?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
c. Require or result in the construction of new storm water drainage facilities or expansion of existing facilities, the construction of which could cause significant environmental effects?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
d. Have sufficient water supplies available to serve the project from existing entitlements and resources, or are new or expanded entitlements needed?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
e. Result in a determination by the wastewater treatment provider which serves or may serve the project that it has adequate capacity to serve the project's projected demand in addition to the provider's existing commitments?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
f. Be served by a landfill with sufficient permitted capacity to accommodate the project's solid waste disposal needs?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
g. Comply with federal, state, and local statutes and regulations related to solid waste?	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Discussion

(a, b, e) Wastewater Collection and Treatment. Sewage generated from residential, commercial and industrial uses within the City of Santa Cruz and Santa Cruz County is collected and transported to the Santa Cruz Wastewater Treatment Facility, located near Neary Lagoon. The Santa Cruz Wastewater Treatment Facility is currently rated to treat up to approximately 17 MGD of wastewater, with an average daily flow of 10 MGD (City of Santa Cruz).

The Proposed Project would generate up to approximately 5,000 gallons per day of backwash to be discharged into the sanitary sewer when the well is in operation. This small amount would not cause an increased burden or need for wastewater or potable water facilities beyond that contemplated in the City's

General Plan and General Plan EIR. No significant impact would occur and no further study of this issue is required.

(c) Storm Drainage Facilities. The Proposed Project would not require additional or expanded stormwater conveyance facilities. No impact would occur and no further study of this issue is required.

(d) Water Supply. The Proposed Project would be operated by City of Santa Cruz Water Department. The Proposed Project would not require new or expanded entitlements. The Proposed Project would involve the installation of a replacement well to support the existing groundwater system. No impact would occur and no further study of this issue is required.

(f, g) Solid Waste Disposal. According to the County of Santa Cruz General Plan, solid waste generated in the County of Santa Cruz is disposed of at the Buena Vista Landfill. The Buena Vista landfill is permitted to accept 838 Tons/day and is expected to reach capacity in 2019 (California Department of Resources Recycling and Recovery). All solid waste generated during construction would be disposed properly according to the County of Santa Cruz standard construction practices by the construction contractor. Minimal solid waste would be generated during operation. The Proposed Project would comply with AB32 requirements for the diversion of solid waste from landfills. Issues related with hazardous waste disposal are addressed in Section VII. a.. No significant impact would occur and no further study of this issue is required.

The Proposed Project would comply with all relevant federal, state, and local statutes and regulations related to solid waste. No impact would occur and no further study of this issue is required.

Further Study Required: Further evaluation of the potential utilities impacts is not required.

Potentially Significant Impact	Potentially Significant Unless Mitigation Incorporated	Less-Than- Significant Impact	No Impact
--------------------------------------	---	-------------------------------------	--------------

18. MANDATORY FINDINGS OF SIGNIFICANCE

Would the project:

- a. Does the project have the potential to degrade the quality of the environment, substantially reduce the habitat of a fish or wildlife species, cause a fish or wildlife population to drop below self-sustaining levels, threaten to eliminate a plant or animal community, reduce the number or restrict the range of a rare or endangered plant or animal or eliminate important examples of the major periods of California history or prehistory?

<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
-------------------------------------	--------------------------	--------------------------	--------------------------

(a) The Proposed Project would involve the installation of a water well in an urban area and would not have the potential to substantially degrade the quality of the environment; reduce habitat of fish or wildlife species; threaten plant or animal communities; or reduce the number or restrict range of rare plants or animals; or eliminate important examples of the major periods of California history or prehistory. No cultural resources were identified during cultural resources investigation of the Proposed Project area. There is a low potential to encounter cultural resources materials during ground-disturbing construction activities, however, a less than significant impact would occur with the incorporation of the previously described Minimization Measures.

The Proposed Project would not result in a change in the significance of the biological resources and potential for resources to be found is extremely low. The Proposed Project site does not provide significant biological

habitat for species of concern and or federally listed species. No sensitive wildlife has been documented on the proposed project site. A hydrogeological study calculating potential streamflow losses from Proposed Project is being prepared. The effect of the Proposed Project’s pumping on Soquel Creek discharges on sensitive species potentially located in Soquel Creek and Soquel Creek streambed habitat will be further analyzed in the EIR.

Further Study Required: The EIR will include further study related to groundwater supplies or recharge and the potential for stream flow losses in Soquel Creek and Soquel Creek Lagoon from the Proposed Project.

- b. Does the project have impacts that are individually limited, but cumulatively considerable? (“Cumulatively considerable” means that the incremental effects of a project are considerable when viewed in connection with the effects of past projects, the effects of other current projects, and the effects of probable future projects)?
-

(b) Cumulative Effects. Implementation of the Proposed Project could have the potential to have impacts that are individually limited, but cumulatively considerable. Where the Proposed Project would have no impact, specifically with respect to agricultural resources, land use and planning, mineral resources, recreation, and population and housing, it would not contribute to cumulative impacts. In addition, issues specific to site conditions, such as site geology and soils, do not have cumulative effects. The Proposed Project is not growth inducing; thus, it would not contribute to the cumulative effects of population growth. The incremental effects of the Proposed Project on biological and hydrological resources could contribute to cumulative impacts. These issues will be further analyzed in the EIR, and, subsequently, their cumulative effects will also be analyzed in the EIR.

Further Study Required: The EIR will include further study related to groundwater supplies or recharge and the potential for stream flow losses in Soquel Creek and Soquel Creek Lagoon from the Proposed Project.

- c. Does the project have environmental effects which will cause substantial adverse effects on human beings, either directly or indirectly?
-

(c) Substantial Adverse Effects on Human Beings. Construction and operation of the Proposed Project would not result in environmental effects which would cause substantial adverse effects on human beings, either directly or indirectly. Minimization measures previously described would reduce any impacts to a less than significant level.

Further Study Required: Further evaluation of the substantial adverse effects on human beings is not required.

V. DETERMINATION

On the basis of this initial evaluation:

- I find that the proposed project COULD NOT have a significant effect on the environment and a NEGATIVE DECLARATION will be prepared.
- I find that although the proposed project could have a significant effect on the environment, there will not be a significant effect in this case because revisions in the project have been made by or agreed to by the project proponent. A MITIGATED NEGATIVE DECLARATION will be prepared.
- I find that the proposed project MAY have a significant effect on the environment, and an ENVIRONMENTAL IMPACT REPORT is required.
- I find that the proposed project MAY have a “potentially significant impact” or “potentially significant unless mitigated” impact on the environment, but at least one effect 1) has been adequately analyzed in an earlier document pursuant to applicable legal standards, and 2) has been addressed by mitigation measures based on the earlier analysis as described on attached sheets. An ENVIRONMENTAL IMPACT REPORT is required, but it must analyze only the effects that remain to be addressed.
- I find that although the proposed project could have a significant effect on the environment, because all potentially significant effects (a) have been analyzed adequately in an EARLIER EIR or NEGATIVE DECLARATION pursuant to applicable legal standards, and (b) have been avoided or mitigated pursuant to that earlier EIR or NEGATIVE DECLARATION, including revisions or mitigation measures that are imposed upon the proposed project, nothing further is required.



Signature

Director
City of Santa Cruz Water Department

December, 13, 2010

Date

VI. REFERENCES AND DATA SOURCE LIST

The following is a list of references used in the preparation of this document. Unless attached herein, copies of all reference reports, memorandums and letters are on file with the City of Santa Cruz Water Department. References to Publications prepared by Federal or State agencies may be found with the agency responsible for providing such information.

1. Alley and Associates. March 2003. "Soquel Creek Salmonid Assessment and Enhancement Plan, 2003" *in* Santa Cruz County Resource Conservation District. 2003. Soquel Creek Watershed Assessment and Enhancement Project Plan.
2. Alley and Associates. June 2004. "Soquel Creek Lagoon Management and Enhancement Plan Update.
3. Atlas Engineering Services, Incorporated. Phase I Environmental Assessment. July 15, 2010.
4. Biological Report prepared by Chambers Group, Inc., 2010.
5. California Air Resources Board (CARB). Climate Change Scoping Plan – "A Framework for Change." December 2008.
6. California Department of Resources, Recycling and Recovery, 2010.
7. California Department of Transportation, Eligible and Officially Designated Routes, 2010, <http://www.dot.ca.gov/hq/LandArch/scenic/cahisys.htm>.
8. California Department of Transportation. 1992 Transportation Related Earthbourne Vibrations, California Department of Transportation Experience.
9. California Division of Land Resource Protection. Farmland Mapping and Monitoring Program. 2006.
10. Central Coast Regional Water Quality Control Board (CCRWQCB). 1994. *Basin Plan*.
11. City of Santa Cruz General Plan 1990-2005., adopted October 27, 1992, last amended October 28, 2003.
12. City of Santa Cruz Integrated Water Plan PEIR. EDAW, Inc. June 2005.
13. City of Santa Cruz Water Department (SCWD), 2006. *2005 Urban Water Management Plan*. February 2006.
14. County of Santa Cruz Emergency Management Plan. April 2002.
15. Cultural resources record search prepared by Chambers Group, Inc., 2010.
16. Fugro West, Inc (Fugro 1998), *Beltz Wells A and B Construction Project Santa Cruz County, California*. Prepared for the City of Santa Cruz Water Department, Dated April, 2008.
17. Google Earth, 2010.
18. Hopkins Groundwater Consultants, Inc. July 2004. *Santa Cruz Groundwater Study. Final Draft Report*. Prepared for the City of Santa Cruz.
19. Hopkins Groundwater Consultants, Well Facility Siting Study, February 2007.
20. Hopkins Groundwater Consultants, Inc., 2009. *Hydrogeological Conditions Study of Live Oak-Capitola Area, Soquel-Aptos Groundwater Basin, Santa Cruz, California*, Prepared for City of Santa Cruz. October 2009.
21. Hopkins Groundwater Consultants, Inc., 2010. Summary of Operations Report. City of Santa Cruz Beltz Monitoring Well Construction Project Cory Street Well Site. February 2010.
22. Monterey Bay Unified Air Pollution Control District (MBUAPCD). Particulate Matter Plan, December 2005.
23. MBUAPCD. Federal Maintenance Plan. May 2007.
24. MBUAPCD. Air Quality Management Plan. August 2008.
25. MBUAPCD. CEQA Air Quality Guidelines, Amended through February 2008.
26. MWH Laboratories, 2010. Laboratory Report for City of Santa Cruz Water Quality Laboratory. June 2010.
27. Public Resources Code (PRC), Section 21000 et al. 2008
28. Santa Cruz County 1994 General Plan.
29. Santa Cruz County Code. Passed August 4, 2009.
30. Santa Cruz County. Geographic Information System, GISWEB. 2010.
31. Sogard et al 2009. *Seasonal Patterns of Abundance, Growth, and Site Fidelity of Juvenile Steelhead in a Small Coastal California Stream*.
32. of Juvenile Steelhead in a Small Coastal California Stream
33. USGS, http://waterdata.usgs.gov/nwis/nwisman/?site_no=11160000&agency_cd=USGS, August 2010.

REPORT AUTHORS AND CONSULTANTS

City of Santa Cruz Water Department

Leah Van Der Maaten, P.E., Associate Civil Engineer

Ryan Jolley, Environmental Project Analyst

Chambers Group, Inc.

James Smithwick, Ph.D.

Vice President/Director of Planning

Paula Fell

Project Manager/Senior Environmental Planner

Greg McCafferty

Principal Planner

Noel Davis, Ph.D.

Principal Marine Biologist

Joe O'Bannon

Principal Air Specialist

Roma Stromberg

Principal Environmental Planner/Noise Specialist

David Smith

Senior Cultural Specialist

Meghan Directo

Associate Environmental Planner



APPENDIX A – Biological Resources Database Research



**Beltz Well Project Number 20177
Literature Review**

Reviewer	John Kanlund : Chambers Group, Inc.
Date	04/13/2010

Project Name: Beltz Well Project Number 20177
Study Area: Undeveloped Lot in Santa Cruz County, California

About the Project Location

The project is located in Northern California near Rodeo Gulch Creek and Soquel Creek.

Habitat Description:

Unimproved vacant lot in the County of Santa Cruz, California

Habitat Concerns:

The project site is an unimproved vacant lot in the County of Santa Cruz, California and does not contribute additional habitat to species listed as threatened or endangered.

Endangered Species of Santa Cruz County, California

Listing Status Key:

- E – Endangered
- T – Threatened
- CH – Critical Habitat
- PE – Taxa proposed for listing as endangered
- PT – Taxa proposed for listing as threatened
- PCH – Critical habitat which has been proposed
- C – Candidate species for which the Fish and Wildlife Service has on file sufficient information on the biological vulnerability and threats to support proposals to list as endangered or threatened.

Amphibians

California Red-Legged Frog
Rana aurora dratytonii

Listing Status: E, PCH

Habitat: Ponds marshes, streams and lagoons.

Characteristics: Size ranges from 1.5 to 5 inches in length. Large well-developed hind legs with webbed feet. Coloration includes white, brown, gray, red, olive and orange with a pattern of dark flecks or spots. The underside of the California Red-Legged Frog is primarily white with patches of bright red or orange.

Threats: Primary predation from garter snakes, raccoons and birds.

Web location: <http://www.santacruzpl.org/endangered/species/1/>
<http://www.fws.gov/arcata/es/amphibians/crlf/crlf.html>

California Tiger Salamander

Ambystoma californiense

Listing Status: E, PCH

Habitat: Grassland and open woodlands of foothills and valleys. Use rodent burrows of ground squirrels and gophers for shelter.

Characteristics: Males range from 7 to 8 inches in length and Females range from 6-7 inches in length. The coloration pattern is primarily white or yellow spots and or bars on a dark brown black body covering the sides and back. The underside of the California Tiger Salamander is white to a pale yellow in color.

Threats: Not known

Web location: <http://www.santacruzpl.org/endangered/species/4/>

Santa Cruz Long-Toed Salamander

Ambystoma macrodactylum croceum

Listing Status: E, PCH

Habitat: Coastal woodlands and chaparral near the ponds and freshwater marshes where it breeds. Species uses the underground burrows of mice, gophers and moles.

Characteristics: Size ranges from 4 to 12 inches in length. The coloration pattern is primarily orange and yellow stripping on a dark brown black body. The underside of the Santa Cruz-Toed Salamander is a dark brown in color.

Threats: Habitat loss, road construction and urbanization

Web location: <http://www.santacruzpl.org/endangered/species/5/>

Birds

Brown Pelican

Pelecanus occidentalis

Listing Status: E

Habitat: The Brown Pelican can be found on the Pacific and Atlantic and Gulf coasts in coastal and sandy beaches and lagoons. The Brown Pelican can also be found around waterfronts and marinas.

Characteristics: Adult Brown Pelican is a large dark gray, brown bird with white around the head and neck. The juvenile Brown Pelican is gray-brown above and has white on the neck with white underparts.

Threats: Pesticides and habitat loss.

Web location: <http://www.santacruzpl.org/endangered/species/6/>

California Clapper Rail

Rallus Longirostris Obsoletus

Listing Status: E

Habitat: The California Clapper Rail can be found year-round in coastal wetlands on the Pacific coasts in San Francisco, Monterey and Morrow Bays. The California Clapper Rail uses shallow water and mudflats for foraging. Species prefers areas with high vegetative cover nearby.

Characteristics: Adult California Clapper Rail measures 13-19 inches. It has a hen like appearance and has a downward-curving bill. The coloration pattern of the California Clapper Rail is Olive brown-upperparts and a cinnamon-buff colored breast.

Threats: Pesticides and habitat loss.

Web location: <http://www.santacruzpl.org/endangered/species/7/>

Marbled Murrelet

Brachyramphus marmoratus

Listing Status: T, CH

Habitat: The Marbled Murrelet can be found in salt-water coastal areas near the shoreline on the Pacific coast. The Marbled Murrelet uses coniferous forests near the ocean for nest sites.

Characteristics: Adult male and female Marbled Murrelets are small seabirds about the size of a robin. They have a black bill and a black tail.

Threats: Nest predation and prey limitation.

Web location: <http://www.santacruzpl.org/endangered/species/8/>

Western Snowy Plover

Charadrius alexandrinus nivosus

Listing Status: T, CH

Habitat: The Western Snowy Plover can be found on beaches and dry mud and salt flats near the sandy shores of rivers, lakes and ponds.

Characteristics: Male Western Snowy Plover is a small shorebird with a pale coloring and a sandy colored dorsum with a white venter and thin dark bill with a dark or grayish feet and legs. The adult male Western Snowy Plover

has a partial breast band and a dark ear patch. The adult female Western Snowy Plover may lack the black areas in the plumage. Juveniles may have light edges on dorsal body feathers resulting in a scaly pattern.

Threats: Native and introduced predators and human disturbances including ranking of the beach and continued loss of habitat.

Web location: <http://www.santacruzpl.org/endangered/species/10/>

Yellow-billed Cuckoo

Coccyzus americanus

Listing Status: C

Habitat: Can be found on beaches and dry mud-salt flats near the sandy shores of rivers, lakes and ponds.

Characteristics: The Yellow-billed Cuckoo is a medium-sized bird generally about 1 ft in length. The adult Yellow-billed Cuckoo has a long tail and gray to brown coloring on the head and back with white underparts.

Threats: Habitat loss and pesticides and predators.

Web location: <http://www.santacruzpl.org/endangered/species/11/>

Fish

Coho Salmon

Oncorhynchus Kisutch

Listing Status: E, CH

Habitat: Small tributary streams or possibly lakes with gravel for spawning and shaded streams with tree-lined banks for rearing.

Characteristics: Silver sides and a dark blue back. Adults have a darker red skin color with and are generally about 28 inches in length and weight ranges from 7-11 pounds.

Threats: Unknown

Web location: <http://www.santacruzpl.org/endangered/species/2/>

Steelhead Trout

Oncorhynchus mykiss

Listing Status: E, CH

Habitat: The Steelhead Trout is born in freshwater streams and then migrate to the open ocean. Native Steelhead Trout return to their native fresh water habitats to spawn.

Characteristics: Steelhead Trout are dark olive in color with silvery-white shading on the underside. A distinct pink to red strip can be seen running along the sides of the Steelhead Trout. They are generally 45 inches in length and can weigh up to 55 pounds.

Threats: Human induced and natural factors.

Web location: <http://www.santacruzpl.org/endangered/species/3/>
<http://www.nmfs.noaa.gov/pr/species/fish/steelheadtrout.htm>

Tidewater Goby

Eucyclogobius newberryi

Listing Status: E

Habitat: The Tidewater Goby frequents small coastal lagoons and lower reaches of streams and the larger portions of bays.

Characteristics: The Tidewater Goby is a small gray-brown fish that is considered a bottom-dwelling fish with large fins and a ventral sucker. The Tidewater Goby similar to many bottom-dwelling fish has a relatively large mouth. The Tidewater Goby typically averages two inches in length.

Threats: Salinity and tidal fluctuations. Threats also include degradation of coastal lagoons by human development.

Web location: <http://www.santacruzpl.org/endangered/species/12/>

Invertebrates

Mount Hermon June Beetle

Polyphylla barbata

Listing Status: E

Habitat: Sandy soils and sparsely vegetated soils.

Characteristics: Large white-lined June beetle.

Threats: Sand mining and urban development

Web location: <http://www.santacruzpl.org/endangered/species/15/>

Ohlone Tiger Beetle

Cincindela ohlone

Listing Status: E

Habitat: Coastal terraces and patches of grasslands.

Characteristics: Adults are elongated medium-sized beetles that are identified by their green, blue, red and yellow coloration often highlighted by stripes and spots.

Threats: A restricted range and relatively small population.

Web location: <http://www.santacruzpl.org/endangered/species/16/>

Smith's Blue Butterfly

Euphilotes enoptes smithi

Listing Status: E

Habitat: Coastal and inland sand dunes as well as steep slopes along the coast. Coastal buckwheat scrub habitats.

Characteristics: Sandy soils and sparsely vegetated soils.

Threats: Habitat destruction due to sand mining, invasion of non-native plants, off road vehicles and development.

Web location: <http://www.santacruzpl.org/endangered/species/14/>

Zayante Band-winged Grasshopper

Trimerotropis infantilis

Listing Status: E

Habitat: The Zayante Band-winged Grasshopper prefers open sparsely vegetated sandy parklands among chaparral or ponderosa pine stands.

Characteristics: Small grasshopper brownish-grey with bluish hind legs.

Threats: Habitat destruction due to sand mining and development.

Web location: <http://www.santacruzpl.org/endangered/species/20/>

Mammals
None listed Relevant to Work Zone

Plants

Ben Lomond Spineflower

Chorizanthe pungens var.

Listing Status: E

Habitat: Limited to sand hills habitat in the Santa Cruz Mountains.

Characteristics: Small annual herb in the buckwheat family native to California.

Threats: Human disturbances such as residential development and sand and gravel mining.

Web location: <http://www.santacruzpl.org/endangered/species/18/>

Monterey Spineflower

Chorizanthe pungens var. pungens

Listing Status: T, CH

Habitat: Limited to sandy soils near coastal areas.

Characteristics: White, rarely pinkish with margins on the lobes and a prostrate to slightly ascending habit.

Threats: Human disturbances such as urban development and introduction of non-natives.

Web location: <http://www.santacruzpl.org/endangered/species/21/>

Robust Spineflower

Chorizanthe robusta var. robusta

Listing Status: E, CH

Habitat: Endemic species of California. Found on coastal and near-coastal areas of Santa Cruz County.

Characteristics: White, rarely pinkish with margins on the lobes.

Threats: Destroyed or degraded habitat due to urbanization and agricultural development as well as introduction of non-natives plants.

Web location: <http://www.santacruzpl.org/endangered/species/22/>
<http://plants.usda.gov/java/profile?symbol=CHRO>

Santa Cruz Cypress

Cupressus abramsiana

Listing Status: E

Habitat: Dry ridges in patches within coastal chaparral and mixed green vegetation.

Characteristics: Santa Cruz Cypress is identified by the grey bark thin and broken into vertical strips, scale-like leaves are bright green.

Threats: Habitat alteration, genetic introgression, insect infestation, competition from non-native plants and disease.

Web location: <http://www.santacruzpl.org/endangered/species/24/>

Santa Cruz Tarplant

Holocarpha macradenia

Listing Status: E

Habitat: Clay soils in grasslands.

Characteristics: Santa Cruz Tarplant, an annual herb, is identified by the yellow flowers in dense heads.

Threats: Continued urban development, agriculture and competition from non-native plants.

Web location: <http://www.santacruzpl.org/endangered/species/26/>

Santa Cruz Wallflower

Erysimum teretifolium

Listing Status: E

Habitat: Endemic to sandstone soils of the Santa Cruz Mountains. Found in northern maritime chaparral and within ponderosa pines in sand parklands.

Characteristics: Santa Cruz Wallflower is a perennial plant identified by the basal rosette of leaves and terminal spike.

Threats: Habitat removal by sand quarrying and residential development.

Web location: <http://www.santacruzpl.org/endangered/species/19/>

Scotts Valley Polygonum

Polygonum hickmanii

Listing Status: E

Habitat: Occurs with other small patches of annual grasslands in well-drained soils.

Characteristics: Scotts Valley Polygonum grows between 1-2 inches tall and is identified by the single white flowers found on the axils of the leaves.

Threats: Habitat alteration, displacement of non-native grasses and the limited amount of habitat.

Web location: <http://www.santacruzpl.org/endangered/species/27/>

Scotts Valley Spineflower

Chorizanthe robusta var. hartwegii

Listing Status: E, CH

Habitat: Sedimentary deposits of sandstone and mudstone.

Characteristics: Scotts Valley Spineflower is a low-growing herb with rose-pink margins confined to the regions with sedimentary sandstone and mudstone deposits.

Threats: Sand mining and residential development.

Web location: <http://www.santacruzpl.org/endangered/species/23/>

Reptiles
None listed Relevant to Proposed Project Site

Species of Concern Santa Cruz County, California

Plants

Coast Wallflower

Erysimum ammophilum

Listing Status: California Species of Concern

Habitat: This species prefers sandy areas near the coast.

Characteristics: A perennial with bright yellow flowers.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Eastwood's Goldenbush

Ericameria fasciculata

Listing Status: California Species of Concern

Habitat: This species prefers dunes and sandy areas near the coast.

Characteristics: A shrub that grows between 1 to 3.5 feet. Eastwood's Goldenbush has a radiating yellow flower heads in terminal clusters of 2 to 6 flowers.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Monterey Ceanothus

Ceanothus cuneatus var. rigidus

Listing Status: California Species of Concern

Habitat: This species prefers sandy hills and flats near forests from San Francisco Bay Area to San Luis Obispo County.

Characteristics: A large shrub that grows 4 to 8 feet tall with small dark green leaves.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Monterey Manzanita

Arctostaphylos montereyensis

Listing Status: California Species of Concern

Habitat: Native to coastal California

Characteristics: An evergreen shrub that is 3-7 feet tall with an erect and bristly leaves. The leaves are simple erect and blade like. Flowers are white and occur in dense clusters.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Sand Gila

Gila tenuifloia arearia

Listing Status: California Species of Concern

Habitat: Confined to areas of bare wind-sheltered areas of coastal sand dune areas.

Characteristics: A short sticky-haired annual herb.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Sandmat Manzanita

Arctostaphylos pumila

Listing Status: California Species of Concern

Habitat: Found in areas with dunes and coastal hills.

Characteristics: A gray low shrub that grows from 2 to 4 feet tall.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Mammals

Monterey Ornate Shrew

Sorex ornatus salarius

Listing Status: California Species of Concern

Habitat/Range: species is found near water marshes along stream sides in valleys, forests and brushy foothills.

Characteristics: Monterey Ornate Shrew is a small mammal 3.5 to 4.25 inches in length with a grayish to brown colored back. The stomach is slightly paler in color and the tail is a dark brown, which is darkest at the tip.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Reptiles

California black legless lizard

Anniella pulchra nigra

Listing Status: California Species of Concern

Habitat/Range: California black legless lizard is found near the Santa Cruz Mountains

Characteristics: The body is elongated, pencil thin and smooth. The California black legless lizard has moveable eyelids with no external ear openings.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Coast Horned Lizard

Phrynosoma coronatum

Listing Status: California Species of Concern

Habitat/Range: Found west of the Sierra Mountains

Characteristics: The Coast Horned Lizard is characterized by horns and the spiny appearance on its' back.

Threats: Unknown

Web location: <http://ucreserve.ucsc.edu/FortOrd/protectedspecies.html>

Native Animal Species to the Santa Cruz Biological Eco-region

American kestrel
western meadowlark
badger
western racer
Buckeye butterfly
white-tailed kite
burrowing owl
horned lark
California ground squirrel
lark sparrow
California ringlet
meadow vole
ferruginous hawk
Ohlone tiger beetle
golden eagle
oxeye satyr butterfly
gopher snake
savannah sparrow

grasshopper sparrow
western bluebird

Native Plant Communities of Santa Cruz County Eco-region

Typical plant communities of Santa Cruz County consist of: grasslands, coastal scrub, and coastal strand, coastal salt marsh, and freshwater marsh, riparian woodlands, redwood forests, sandhills, closed cone coniferous forests, mixed evergreen forests, chaparral, foothill woodlands and oak/savanna grasslands.

These plant communities also include sub-communities such as Monterey Pine Forest, Knobcone Pine Forest, Northern Interior Cypress Forest, Mixed Evergreen Forest, Coast Live oak Forest, Canyon Live Oak Forest, Interior Live Oak Forest, Tan-Oak Forest, Interior Live Oak Woodland, California Bay Forest, Northern Mixed Chaparral, Chamise Chaparral, Serpentine Chaparral, Buck Brush Chaparral, Blue Brush Chaparral, Northern Maritime Chaparral, Mesic North Slope Chaparral, Black Oak Woodland, Valley Oak Woodland, Valley Needle Grass Grassland.

Works Cited

California Department of Fish and Wildlife
<http://www.dfg.ca.gov/>

California Department of Fish and Wildlife Database
http://www.dfg.ca.gov/biogeodata/cnddb/plants_and_animals.asp

Santa Cruz Native Plant Society
<http://cruzcnps.org/currentissues.html>

Santa Cruz Public Libraries
<http://www.santacruzpl.org/endangered/species/25/>

Santa Barbara Natural History Museum
http://www.sbnature.org/collections/invert/entom/polyp_barba.php



APPENDIX B – Cultural Records Search





Ms. Paula Fell
Chambers Group, Inc.
5 Hutton Centre Drive Ste. 750
Santa Ana, CA 92707

Subject: Beltz Well Cultural Resource Records Search

Dear Ms. Fell:

The Northwest Information Center (NWIC), Sonoma State University, Rohnert Park, California has conducted a cultural resources records search (NWIC File No. 09-1232) for the subject property in Santa Cruz, California. The purpose of the records search is to determine if any cultural resources technical studies have been conducted on the subject property and if any historic or prehistoric sites are located on or in proximity to the subject property.

NWIC maintains 7.5 Minute USGS maps showing the locations for technical studies and historic properties and archaeological sites. Chambers Group provided NWIC a portion of the USGS 7.5 Minute Soquel Quadrangle depicting the subject property. A review of the NWIC map indicates the subject property has never been part of a cultural resources technical study and no sites or properties are recorded within the subject property.

There have been 26 cultural studies conducted within a ½ mile radius of the subject property. These consisted primarily of block surveys for parcels of various sizes. As a result of these studies, four archaeological sites have been recorded within a ½ mile radius of the subject property. Two of these sites are multi-component sites with prehistoric remains and historic residential remains. The remaining two are historic residential archaeological sites.

NWIC provided a list of addressed for known historic properties within a ½ mile radius of the subject property. A review of the streets, particularly Cory Street, indicated no historic structures are listed in the vicinity of the subject property.

No properties listed as a California Landmark are within a ½ mile radius of the subject property.

In summary, the subject property has never undergone a cultural resources technical study to determine if historic or prehistoric sites are within its boundary. Prehistoric archaeological sites and historic structures are located within a ½ mile radius of the subject property. It is presently unknown if any of these cultural resources are within the subject property.

Thank you for the opportunity to provide cultural resources services for your project. If you have any questions regarding the records search please contact me at your earliest convenience.

Respectfully,
Chambers Group, Inc.

David M. Smith
Project Manager, Archaeology

www.chambersgroupinc.com
A Certified Disabled Veteran Business Enterprise

REDLANDS

302 Brookside Avenue
Redlands, California 92373
909 • 335-7068
909 • 335-6318 fax

SAN DIEGO

8787 Complex Drive, Suite 220B
San Diego, California 92123
858 • 541-2800
858 • 565-8950 fax

CORPORATE OFFICE

5 Hutton Centre Drive, Suite 750
Santa Ana, California 92707
949 • 261-5414
949 • 261-8950 fax

RENO

1755 E. Plumb Lane, Suite 260
Reno, Nevada 89502
775 • 323-3555
fax 775 • 323-3554

COACHELLA

36-953 Cook Street, Suite 103
Palm Desert, California 92211
760 • 779-0108



APPENDIX C – Atlas Engineering Phase I Report



PHASE 1 ENVIRONMENTAL ASSESSMENT

APN 030-181-70
(Vacant Lot on Research Park Drive)
Soquel, California

July 15, 2009

Prepared For:

City of Santa Cruz Water Department

Prepared By:



Frederick A. Yukic, MS, REA
Principal Engineer



ATLAS
ENGINEERING SERVICES,
INCORPORATED



1.0 INTRODUCTION

1.1 Purpose

A Phase 1 Environmental Assessment was conducted by Atlas Engineering Services, Incorporated (Atlas) for the City of Santa Cruz Water Department (SCWD). The purpose of this Environmental Assessment is to identify recognized environmental conditions connected with the property identified as Assessor's Parcel Number (APN) 030-181-70, a vacant lot on Research Park Drive in unincorporated Santa Cruz County, California (Figures 1 and 2). After review of relevant information, an opinion is rendered regarding the potential impact of the environmental data collected on the proposed use of the Site for construction of a monitor well and water supply production well.

1.2 Scope of Work

This Phase 1 was prepared with reference to the ASTM Standard E 1527-05, entitled "Standard Practice for Environmental Site Assessments: Phase I Environmental Site Assessment Process".

Project Review

Atlas reviewed planning documents to gain an understanding of the project including "Preliminary Hydrogeological Study, City of Santa Cruz, Test Hole and Monitoring Well Construction Project, Work Plan, Santa Cruz, California" dated May 2007 by Hopkins Groundwater Consultants, Inc. and "Preliminary Hydrogeological Study, City of Santa Cruz, Beltz Wells Nos. 11 and 12, Well Siting Study, Santa Cruz, California" dated February 2009 by Hopkins Groundwater Consultants, Inc.. The proposed use of the Site is for construction of a monitor well and a water supply production well.

Records Review

Atlas reviewed records, documents, and other relevant information sources, including: topographic maps, aerial photographs, state/federal regulatory databases, state agency files, and local agency files.

Site Inspection

Atlas conducted a site inspection. During a site inspection on July 1, 2009 an environmental assessment field checklist was completed, data were recorded, pertinent observations related to the condition of the environment at the Site were noted, and the area was inspected for potential environmental hazards.

Interviews

Atlas conducted an interview with the current property manager and an employee of a county agency.



Report Preparation

Atlas prepared this report summarizing recognized environmental conditions connected with the Site including a description of the Site, a summary of records reviewed, and an opinion by Atlas with regard to the recognized environmental conditions at the Site.

2.0 SITE LOCATION and DESCRIPTION

2.1 Site Location

The Site is located on Research Park Drive in Soquel, California (Figure 1). The Site is comprised of Assessor Parcel Number (APN) 030-181-70, and is located between Research Park Court and Cory Street (Figure 2).

2.2 Site Description

The Site is approximately 0.65 acres of relatively flat land that is currently vacant. The area surrounding the Site consists primarily of commercial and light industrial properties.

3.0 RECORDS REVIEW

3.1 Chain-of-Title

The history of ownership of the subject property was investigated by searching the records at Santa Cruz County Recorder's Office (see attached Table 1).

3.2 Sanborn Fire Maps

There are no Sanborn Fire Maps for this area.

3.3 USGS Topographic Maps

United States Geological Services (USGS) maps from 1914, 1954, 1968, 1980 and 1994 were obtained from Environmental Data Resources, Inc. (EDR) and examined.

The 1914 map shows the Site undeveloped land. Highway 1 has not yet been constructed.

The 1954 map shows the Site undeveloped land with a few long structures to the north and a large rectangular structure to the south.

The photorevised map from 1968 shows the Site as undeveloped land with the same features identified in the 1954 map except increased development in the general



area of the Site including construction of Highway 1.

The photorevised map from 1980 shows the Site as undeveloped land with the same features on the Site as in 1968 except that the structure to the south has been removed.

The 1994 map shows the Site as undeveloped land with surrounding properties also largely undeveloped. The long structures to the north have been removed, and new streets has been constructed to the east and north of the Site.

3.4 Aerial Photographs

Aerial photographs from 1948, 1956, 1977, 1987, and 1998 were obtained from Environmental Data Resources Inc. and examined.

The 1948 aerial photograph shows the Site is vacant land along a street on the west side of the Site. To the north is a facility that is accessed from Soquel Avenue that is comprised of four to five long buildings connected by a central, covered accessway. To the east is vacant land, to the south are what appears to be greenhouses, and to the west are a few small structures that are perhaps rural houses.

The 1956 aerial photograph shows the site is still vacant but has been mowed in lines that suggest row crops or hay. The surrounding properties appear the same as in the previous photo.

The 1977 aerial photograph shows conditions unchanged except that the properties to the east have become increasingly developed including what appears to be a lumber yard to the southeast.

The 1987 aerial photograph shows the Site still vacant land, but that Research Park Drive has been constructed on the west and the structures to the north and greenhouses to the south have been removed.

The 1998 aerial photograph shows the Site as vacant land as in previous photos with new commercial/industrial buildings constructed to the north and south.

3.5 Government Records and Public Documents

Environmental Database Search

A government records and public documents search was conducted during the course of this environmental assessment by contracting with Environmental Data Resources, Inc. (EDR), an environmental database service (see Executive Summary in Appendix A). The service searched their database of government records and public documents for properties located within one mile of the Site. The complete list of databases searched is provided in the attached Executive Summary of the EDR report.

The search did not identify the Site as being on any environmental list.

The search identified 23 properties within one mile of the Site listed on at least one of the databases searched (discounting redundant listings).



State Water Resources Control Board Geotracker

The State Water Resources Control Board Geotracker (Geotracker) is an internet based database of leaking underground storage tank cleanup sites, other cleanup sites (e.g. solvents or metals), land disposal sites, military cleanup sites, and permitted underground storage tank sites. Geotracker lists 27 sites within 1,000 feet of the subject property, with 20 closed and 7 still active (Table 2). The subject property is not listed in Geotracker (Table 2).

Santa Cruz County Environmental Health Services Hazardous Materials Files

Atlas visited the offices of Santa Cruz County Environmental Health Services (SCCEHS) to review case files on the Subject Property, the 23 properties identified within one mile of the subject property by the EDR database search, and the 7 open sites listed in Geotracker. SCCEHS does not have any files on the Site.

Atlas reviewed the files on the 23 properties identified in the EDR report and the 7 open UST sites. Of the 7 open UST sites listed in Geotracker as within 1,000 feet of the subject property, the SCCEHS files show that two were closed in the past at the time of UST removal due to only low concentrations of petroleum hydrocarbons in soil (2685 Mattison Lane and 3098 Winkle). Of the five remaining open sites, two sites (4860 Soquel Avenue and 2501 South Main) reported low concentrations of petroleum hydrocarbons in recent water quality sampling [e.g. 5.2 micrograms per liter (ug/L) benzene and 26 ug/L MTBE] while three sites (836 Bay Avenue, 2178 41st Avenue, and 819 Bay Avenue) reported high concentrations of petroleum hydrocarbons (e.g. tertiary butyl alcohol at 1,400 ug/L, benzene at 2,500 ug/L, and benzene at 4,000 ug/L). However, upon a more detailed inspection of local maps it is apparent that these three sites are located more than 1,000 feet from the Site.

Atlas also reviewed the file for a site not listed in the EDR report or Geotracker, 3801 Soquel Drive, a former leaking underground storage tank (LUST) site. This site was granted no further action by SCCEHS, with xylenes present in groundwater at concentrations below the California Regional Water Quality Control Board Central Coast Water Quality Objectives. This file also contained documentation on water supply wells at 3801 Soquel Drive and on the adjoining property at 3715 Soquel Drive (see Appendix B).

Santa Cruz County Building Department

The Santa Cruz County Building Department (SCC Building) files on the Site show that it was formerly listed as 2950 Hillcrest Street, that it was owned by West Foods, Inc., and that a mushroom plant was on the Site and adjacent properties in 1968. SCC Building files also show that the area was subdivided in 1982 and that an attempt was made to develop the Site in 1990 but development was not completed.

Polk Directory

Atlas reviewed the Polk Directory reverse listing for information on the site. Listings for 3600 and 3620 Soquel Drive in 1960, 1965, 1970, and 1975 show occupants of West Foods, Inc. and Shady Oak Mushrooms.



4.0 SITE INSPECTION

On July 1, 2009 the Site was inspected, and an environmental assessment field checklist was completed and, data were recorded (Appendix C). Pertinent observations related to the condition of the environment at the Site were noted, and buildings were inspected for potential environmental hazards. No evidence of dry wells, underground storage tanks, or above ground storage tanks was observed. There was nothing to indicate a potentially significant environmental condition at the Site.

5.0 INTERVIEWS

Atlas interviewed Mr. Allen Guggenheim, realtor and property manager for the owner of the Site, Mr. Rolando Charles of the SCCEHS, and Ms. Dawn Smithson of SCWD.

Mr. Guggenheim had no knowledge that would indicate a recognized environmental condition.

Mr. Charles did not know of any recognized environmental conditions at the Site.

Ms. Smithson was interviewed using the ASTM E 1527-05 "User Questionnaire" (Appendix D). Ms. Smithson had no knowledge that would indicate a recognized environmental condition.

6.0 SUMMARY AND CONCLUSIONS

Atlas performed a Phase 1 Environmental Site Assessment in conformance with the scope and limitations of ASTM Practice E 1527-05 of the Site (APN 030-181-70) located on Research Park Drive at Research Park Court in Soquel, California (Figures 1 and 2). Atlas reviewed records about the Site including topographical maps, aerial photographs, government records, and a limited chain of title. Interviews were conducted with persons knowledgeable about the Site, and an inspection of the Site was conducted. Any exceptions to, or deletions from, this practice are described in Section 8 of this report.

The records review of the chain-of-title found no recognized environmental conditions (Table 1). No Sandborn Fire Maps were found for this area. The USGS topographic maps and the aerial photographs found no recognized environmental conditions. The government records and public documents revealed that the Site is not listed in any environmental. The EDR record search identified 23 properties within one mile of the Site listed on at least one of the environmental databases searched (Appendix A). The State Water Resources Control Board Geotracker lists 27 sites within 1,000 feet of the subject property, with 20 closed and 7 still active, and the Subject Property not listed (Table 2). Files at the offices of Santa Cruz County Environmental Health Services (SCCEHS) did not contain any entries for the Site. SCCEHS files also showed that of the 23 properties within one-mile and 27 listed by Geotracker as within 1,000 feet, only three (836 Bay Avenue, 2178 41st Avenue, and



819 Bay Avenue) had a potentially significant environmental condition that could impact the planned use of the Site. However, upon a more detailed inspection of local maps it is apparent that these three sites are located more than 1,000 feet from the Site, and that only the facility at 2178 41st Avenue is located close enough to the Site to have a potentially significant environmental condition that could impact the planned use of the Site. One additional file at SCCEHS for a closed former fuel tank site at 3801 Soquel Drive showed low levels of groundwater contamination, and contained documentation of two former water supply wells (Appendix B).

The site inspection (Appendix C) and interviews (Appendix D) did not reveal any potentially significant environmental conditions at the Subject Property or Site that might impact planned use.

Based on the information cited above, this assessment has revealed no recognized environmental conditions in connection with the intended use of the Site for construction of a monitor well.

Based on the information cited above, this assessment has revealed no recognized environmental conditions in connection with the intended use of the Site for construction of a water supply production well except for the following:

1. The Leaking Underground Fuel Tank (LUFT) site at 2178 41st Avenue may pose a risk to quality of water pumped from a water supply well constructed on the Site.

7.0 RECOMMENDATIONS

Based on the information and conclusions cited above Atlas recommends that the monitor well be constructed at the Site and sampled for petroleum hydrocarbons to evaluate water quality prior to construction of the production well.

In addition, a capture zone analysis of pumping a production well at this location should be conducted to ascertain the likelihood of petroleum hydrocarbons from the one potentially significant LUFT site entering the well during pumping.

8.0 LIMITATIONS

This Phase I Environmental Site Assessment was conducted in accordance with ASTM Practice E1527-05. The conclusions of this report are professional judgments concerning the significance of the observations made and data gathered during the course of the environmental assessment. No sampling has been conducted. Opinions rendered should not be construed as guarantee or warranty as to the potential liability associated with environmental conditions or impacts at the site.



9.0 CERTIFICATION

I declare that, to the best of my professional knowledge and belief, I meet the definition of Environmental professional as defined in Section 312.10 of 40 CFR 312. I have the specific qualifications based on education, training, and experience to assess a property of the nature, history, and setting of the subject property. I have developed and performed the all appropriated inquiries in conformance with the standards and practices set forth in 40 CFR 312.

**Table 1.
Chain of Title
APN 030-181-70
(vacant lot on Research Park Drive)
Soquel, California**

Date	Owner
1940	Sierra Mushroom Company
December 29, 1949	L.A. Hughes, et al
December 30, 1949	Fay C Hughes
December 11, 1950	Roland E. West, et al
August 6, 1951	West Foods of California
October 31, 1984	Oceanic California, Inc.
July 20, 1990	Rikal Development Corporation
March 25, 1992	Cailber Exchange Corporation
November 4, 1993	Rikal Development Corporation
November 4, 1993	Castle & Cooke California, Inc., et al
April 10, 1996	Nahum Guzik
April 16, 2004	Guzik Trust

Table 2.
 SWRCB Geotracker Sites Within 1,000 Feet
 APN 030-181-70
 (Vacant Lot on Research Park Drive)
 Soquel, California

GEOTRACKER SITE NAME	CLEANUP STATUS	ADDRESS	CITY
T0608700005 FORMER EXXON 7-3604	OPEN - VERIFICATION MONITORING	836 BAY AVE	CAPITOLA
T0608700006	COMPLETED - CASE CLOSED	2501 MAIN ST S	SOQUEL
T0608700052	COMPLETED - CASE CLOSED	809 BAY AVE	CAPITOLA
T0608700053	COMPLETED - CASE CLOSED	2185 CHANTICLEER ST	SANTA CRUZ
T0608700067	COMPLETED - CASE CLOSED	2435 41ST AVE	SANTA CRUZ
T0608700070	COMPLETED - CASE CLOSED	2230 CHANTICLEER ST	SANTA CRUZ
T0608700078 BP #11240	OPEN - VERIFICATION MONITORING	2178 41ST AVE	CAPITOLA
T0608700108	COMPLETED - CASE CLOSED	6100 SOQUEL AVE	SANTA CRUZ
T0608700119	COMPLETED - CASE CLOSED	2255 41ST AVE	CAPITOLA
T0608700160	COMPLETED - CASE CLOSED	2700 41ST ST	SOQUEL
T0608700168 FORMER EXXON 7-0281	OPEN - VERIFICATION MONITORING	2501 MAIN ST S	SOQUEL
T0608700170	COMPLETED - CASE CLOSED	4100 SOQUEL DR	SOQUEL
T0608700195	COMPLETED - CASE CLOSED	2825 MATTISON LN	SANTA CRUZ
T0608700204	COMPLETED - CASE CLOSED	END OF ESPLANADE	CAPITOLA
T0608700205	COMPLETED - CASE CLOSED	41ST AVE	CAPITOLA
T0608700221	COMPLETED - CASE CLOSED	5998 SOQUEL DR	SANTA CRUZ
T0608700231 SKILL CENTER INC	OPEN - REMEDIATION	2685 MATTISON LN	SANTA CRUZ
T0608700238	COMPLETED - CASE CLOSED	2178 41ST AVE	CAPITOLA
T0608700242 TOSCO - FACILITY #2452	OPEN - REMEDIATION	4860 SOQUEL DR	SOQUEL
T0608700245	COMPLETED - CASE CLOSED	3131 PORTER ST	SOQUEL
T0608700250	COMPLETED - CASE CLOSED	2407 PORTER ST	SOQUEL
T0608700265 REDTREE PROPERTIES	OPEN - SITE ASSESSMENT	819 BAY AVE	CAPITOLA
T0608700293	COMPLETED - CASE CLOSED	600 BAY AVE	CAPITOLA
T0608700297 JIMMY SMITH PLUMBING	OPEN - SITE ASSESSMENT	3098 WINKLE AVE	SANTA CRUZ
T0608700304	COMPLETED - CASE CLOSED	4901 SOQUEL DR	SOQUEL
T0608700308	COMPLETED - CASE CLOSED	2210 SOQUEL DR	SANTA CRUZ
T060876507	COMPLETED - CASE CLOSED	7070 SOQUEL AVENUE	SANTA CRUZ



Phase 1 Environmental Assessment
APN 030-181-70
Vacant Lot on Research Park Drive
Soquel, California
July 15, 2009



APPENDIX A


EDR GOVERNMENT RECORD SEARCH EXECUTIVE SUMMARY

SCW2

Research Park Drive
Santa Cruz, CA 95073

Inquiry Number: 2521766.2s
June 17, 2009

The EDR Radius Map™ Report with GeoCheck®

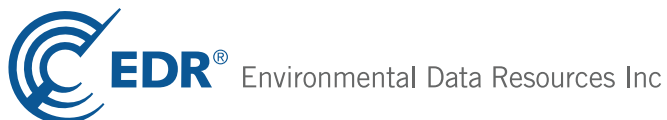

440 Wheelers Farms Road
Milford, CT 06461
Toll Free: 800.352.0050
www.edrnet.com

TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE</u>
Executive Summary	ES1
Overview Map	2
Detail Map	3
Map Findings Summary	4
Map Findings	7
Orphan Summary	60
Government Records Searched/Data Currency Tracking	GR-1
 <u>GEOCHECK ADDENDUM</u>	
Physical Setting Source Addendum	A-1
Physical Setting Source Summary	A-2
Physical Setting SSURGO Soil Map	A-5
Physical Setting Source Map	A-12
Physical Setting Source Map Findings	A-13
Physical Setting Source Records Searched	A-35

Thank you for your business.
Please contact EDR at 1-800-352-0050
with any questions or comments.

Disclaimer - Copyright and Trademark Notice

This Report contains certain information obtained from a variety of public and other sources reasonably available to Environmental Data Resources, Inc. It cannot be concluded from this Report that coverage information for the target and surrounding properties does not exist from other sources. **NO WARRANTY EXPRESSED OR IMPLIED, IS MADE WHATSOEVER IN CONNECTION WITH THIS REPORT. ENVIRONMENTAL DATA RESOURCES, INC. SPECIFICALLY DISCLAIMS THE MAKING OF ANY SUCH WARRANTIES, INCLUDING WITHOUT LIMITATION, MERCHANTABILITY OR FITNESS FOR A PARTICULAR USE OR PURPOSE. ALL RISK IS ASSUMED BY THE USER. IN NO EVENT SHALL ENVIRONMENTAL DATA RESOURCES, INC. BE LIABLE TO ANYONE, WHETHER ARISING OUT OF ERRORS OR OMISSIONS, NEGLIGENCE, ACCIDENT OR ANY OTHER CAUSE, FOR ANY LOSS OF DAMAGE, INCLUDING, WITHOUT LIMITATION, SPECIAL, INCIDENTAL, CONSEQUENTIAL, OR EXEMPLARY DAMAGES. ANY LIABILITY ON THE PART OF ENVIRONMENTAL DATA RESOURCES, INC. IS STRICTLY LIMITED TO A REFUND OF THE AMOUNT PAID FOR THIS REPORT.** Purchaser accepts this Report "AS IS". Any analyses, estimates, ratings, environmental risk levels or risk codes provided in this Report are provided for illustrative purposes only, and are not intended to provide, nor should they be interpreted as providing any facts regarding, or prediction or forecast of, any environmental risk for any property. Only a Phase I Environmental Site Assessment performed by an environmental professional can provide information regarding the environmental risk for any property. Additionally, the information provided in this Report is not to be construed as legal advice.

Copyright 2009 by Environmental Data Resources, Inc. All rights reserved. Reproduction in any media or format, in whole or in part, of any report or map of Environmental Data Resources, Inc., or its affiliates, is prohibited without prior written permission.

EDR and its logos (including Sanborn and Sanborn Map) are trademarks of Environmental Data Resources, Inc. or its affiliates. All other trademarks used herein are the property of their respective owners.

EXECUTIVE SUMMARY

A search of available environmental records was conducted by Environmental Data Resources, Inc (EDR). The report was designed to assist parties seeking to meet the search requirements of EPA's Standards and Practices for All Appropriate Inquiries (40 CFR Part 312), the ASTM Standard Practice for Environmental Site Assessments (E 1527-05) or custom requirements developed for the evaluation of environmental risk associated with a parcel of real estate.

TARGET PROPERTY INFORMATION

ADDRESS

RESEARCH PARK DRIVE
SANTA CRUZ, CA 95073

COORDINATES

Latitude (North):	36.984400 - 36° 59' 3.8"
Longitude (West):	121.967800 - 121° 58' 4.1"
Universal Transverse Mercator:	Zone 10
UTM X (Meters):	591863.5
UTM Y (Meters):	4093436.5
Elevation:	112 ft. above sea level

USGS TOPOGRAPHIC MAP ASSOCIATED WITH TARGET PROPERTY

Target Property Map:	36121-H8 SOQUEL, CA
Most Recent Revision:	1994

AERIAL PHOTOGRAPHY IN THIS REPORT

Portions of Photo from:	2006, 2005
Source:	USDA

TARGET PROPERTY SEARCH RESULTS

The target property was not listed in any of the databases searched by EDR.

DATABASES WITH NO MAPPED SITES

No mapped sites were found in EDR's search of available ("reasonably ascertainable ") government records either on the target property or within the search radius around the target property for the following databases:

STANDARD ENVIRONMENTAL RECORDS

Federal NPL site list

NPL..... National Priority List

EXECUTIVE SUMMARY

Proposed NPL..... Proposed National Priority List Sites
NPL LIENS..... Federal Superfund Liens

Federal Delisted NPL site list

Delisted NPL..... National Priority List Deletions

Federal CERCLIS list

CERCLIS..... Comprehensive Environmental Response, Compensation, and Liability Information System

Federal CERCLIS NFRAP site List

CERC-NFRAP..... CERCLIS No Further Remedial Action Planned

Federal RCRA CORRACTS facilities list

CORRACTS..... Corrective Action Report

Federal RCRA non-CORRACTS TSD facilities list

RCRA-TSDF..... RCRA - Transporters, Storage and Disposal

Federal RCRA generators list

RCRA-LQG..... RCRA - Large Quantity Generators
RCRA-CESQG..... RCRA - Conditionally Exempt Small Quantity Generator

Federal institutional controls / engineering controls registries

US ENG CONTROLS..... Engineering Controls Sites List
US INST CONTROL..... Sites with Institutional Controls

Federal ERNS list

ERNS..... Emergency Response Notification System

State- and tribal - equivalent NPL

RESPONSE..... State Response Sites

State and tribal landfill and/or solid waste disposal site lists

SWF/LF..... Solid Waste Information System

State and tribal leaking storage tank lists

SLIC..... Statewide SLIC Cases
INDIAN LUST..... Leaking Underground Storage Tanks on Indian Land

State and tribal registered storage tank lists

AST..... Aboveground Petroleum Storage Tank Facilities
INDIAN UST..... Underground Storage Tanks on Indian Land

State and tribal voluntary cleanup sites

VCP..... Voluntary Cleanup Program Properties

EXECUTIVE SUMMARY

INDIAN VCP..... Voluntary Cleanup Priority Listing

ADDITIONAL ENVIRONMENTAL RECORDS

Local Brownfield lists

US BROWNFIELDS..... A Listing of Brownfields Sites

Local Lists of Landfill / Solid Waste Disposal Sites

DEBRIS REGION 9..... Torres Martinez Reservation Illegal Dump Site Locations
ODI..... Open Dump Inventory
WMUDS/SWAT..... Waste Management Unit Database
SWRCY..... Recycler Database
HAULERS..... Registered Waste Tire Haulers Listing
INDIAN ODI..... Report on the Status of Open Dumps on Indian Lands

Local Lists of Hazardous waste / Contaminated Sites

US CDL..... Clandestine Drug Labs
HIST Cal-Sites..... Historical Calsites Database
SCH..... School Property Evaluation Program
Toxic Pits..... Toxic Pits Cleanup Act Sites
CDL..... Clandestine Drug Labs

Local Land Records

LIENS 2..... CERCLA Lien Information
LUCIS..... Land Use Control Information System
LIENS..... Environmental Liens Listing
DEED..... Deed Restriction Listing

Records of Emergency Release Reports

HMIRS..... Hazardous Materials Information Reporting System
CHMIRS..... California Hazardous Material Incident Report System
LDS..... Land Disposal Sites Listing
MCS..... Military Cleanup Sites Listing

Other Ascertainable Records

DOT OPS..... Incident and Accident Data
DOD..... Department of Defense Sites
FUDS..... Formerly Used Defense Sites
CONSENT..... Superfund (CERCLA) Consent Decrees
ROD..... Records Of Decision
UMTRA..... Uranium Mill Tailings Sites
MINES..... Mines Master Index File
TRIS..... Toxic Chemical Release Inventory System
TSCA..... Toxic Substances Control Act
FTTS..... FIFRA/ TSCA Tracking System - FIFRA (Federal Insecticide, Fungicide, & Rodenticide Act)/TSCA (Toxic Substances Control Act)
HIST FTTS..... FIFRA/TSCA Tracking System Administrative Case Listing
SSTS..... Section 7 Tracking Systems

EXECUTIVE SUMMARY

ICIS.....	Integrated Compliance Information System
PADS.....	PCB Activity Database System
MLTS.....	Material Licensing Tracking System
RADINFO.....	Radiation Information Database
FINDS.....	Facility Index System/Facility Registry System
RAATS.....	RCRA Administrative Action Tracking System
CA BOND EXP. PLAN.....	Bond Expenditure Plan
CA WDS.....	Waste Discharge System
NPDES.....	NPDES Permits Listing
Cortese.....	"Cortese" Hazardous Waste & Substances Sites List
WIP.....	Well Investigation Program Case List
HAZNET.....	Facility and Manifest Data
EML.....	Emissions Inventory Data
INDIAN RESERV.....	Indian Reservations
SCRD DRYCLEANERS.....	State Coalition for Remediation of Drycleaners Listing

EDR PROPRIETARY RECORDS

EDR Proprietary Records

Manufactured Gas Plants..... EDR Proprietary Manufactured Gas Plants

SURROUNDING SITES: SEARCH RESULTS

Surrounding sites were identified in the following databases.

Elevations have been determined from the USGS Digital Elevation Model and should be evaluated on a relative (not an absolute) basis. Relative elevation information between sites of close proximity should be field verified. Sites with an elevation equal to or higher than the target property have been differentiated below from sites with an elevation lower than the target property.

Page numbers and map identification numbers refer to the EDR Radius Map report where detailed data on individual sites can be reviewed.

Sites listed in ***bold italics*** are in multiple databases.

Unmappable (orphan) sites are not considered in the foregoing analysis.

STANDARD ENVIRONMENTAL RECORDS

Federal RCRA generators list

RCRA-SQG: RCRAInfo is EPA's comprehensive information system, providing access to data supporting the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. The database includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA). Small quantity generators (SQGs) generate between 100 kg and 1,000 kg of hazardous waste per month.

A review of the RCRA-SQG list, as provided by EDR, and dated 11/12/2008 has revealed that there are 5 RCRA-SQG sites within approximately 0.25 miles of the target property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
<i>STUART AUTOMOTIVE</i>	<i>4003 CORDELIA LN</i>	<i>ENE 1/8 - 1/4 (0.139 mi.)</i>	<i>4</i>	<i>8</i>
<i>FABIAN'S BODY SHOP</i>	<i>3921 SOQUEL DR AT 41ST</i>	<i>NNE 1/8 - 1/4 (0.237 mi.)</i>	<i>20</i>	<i>34</i>

EXECUTIVE SUMMARY

<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
PACIFIC BELL	7070 SOQUEL	SW 1/8 - 1/4 (0.143 mi.)	B8	11
KRAFT'S BODY SHOP INC	7000 SOQUEL AVENUE	SW 1/8 - 1/4 (0.146 mi.)	B9	16
MASTER CLEANERS	2660 41ST AVE	ENE 1/8 - 1/4 (0.177 mi.)	C12	20

State- and tribal - equivalent CERCLIS

ENVIROSTOR: The Department of Toxic Substances Control's (DTSC's) Site Mitigation and Brownfields Reuse Program's (SMBRP's) EnviroStor database identifies sites that have known contamination or sites for which there may be reasons to investigate further. The database includes the following site types: Federal Superfund sites (National Priorities List (NPL)); State Response, including Military Facilities and State Superfund; Voluntary Cleanup; and School sites. EnviroStor provides similar information to the information that was available in CalSites, and provides additional site information, including, but not limited to, identification of formerly-contaminated properties that have been released for reuse, properties where environmental deed restrictions have been recorded to prevent inappropriate land uses, and risk characterization information that is used to assess potential impacts to public health and the environment at contaminated sites.

A review of the ENVIROSTOR list, as provided by EDR, and dated 05/27/2009 has revealed that there is 1 ENVIROSTOR site within approximately 1 mile of the target property.

<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
SILVERCREST APARTMENTS Status: Active	750 BAY AVENUE	ESE 1/2 - 1 (0.819 mi.)	30	55

State and tribal leaking storage tank lists

LUST: The Leaking Underground Storage Tank Incident Reports contain an inventory of reported leaking underground storage tank incidents. The data come from the State Water Resources Control Board Leaking Underground Storage Tank Information System.

A review of the LUST list, as provided by EDR, and dated 04/08/2009 has revealed that there are 10 LUST sites within approximately 0.5 miles of the target property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
SERVICE STATION NO 88 Status: Completed - Case Closed	2700 41ST ST	ENE 1/8 - 1/4 (0.188 mi.)	C16	29
4100 SOQUEL DR Status: Completed - Case Closed	4100 SOQUEL DR	NE 1/4 - 1/2 (0.306 mi.)	24	43
<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
PACIFIC BELL Status: Completed - Case Closed	7070 SOQUEL	SW 1/8 - 1/4 (0.143 mi.)	B8	11
SAN LORENZO LUMBER CO Status: Completed - Case Closed	2435 41ST AVE	ESE 1/8 - 1/4 (0.179 mi.)	13	24
FRITO LAY Status: Completed - Case Closed	2825 MATTISON LN	WNW 1/4 - 1/2 (0.254 mi.)	21	37
CHEVRON STATION Status: Completed - Case Closed	5998 SOQUEL DR	WSW 1/4 - 1/2 (0.255 mi.)	22	39

EXECUTIVE SUMMARY

<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
41ST AVENUE UNOCAL SERVICE Status: Completed - Case Closed	2255 41ST AVE	SE 1/4 - 1/2 (0.277 mi.)	23	40
B P OIL CO FACILITY SITE 11240 Status: Open - Verification Monitoring Status: Completed - Case Closed	2178 41ST AVE	SSE 1/4 - 1/2 (0.310 mi.)	25	45
KRAFT'S BODY SHOP INC Status: Completed - Case Closed	6100 SOQUEL AVE	W 1/4 - 1/2 (0.327 mi.)	26	50
SKILL CENTER INC Status: Open - Remediation	2685 MATTISON LN	W 1/4 - 1/2 (0.359 mi.)	27	53

State and tribal registered storage tank lists

UST: The Underground Storage Tank database contains registered USTs. USTs are regulated under Subtitle I of the Resource Conservation and Recovery Act (RCRA). The data come from the State Water Resources Control Board's Hazardous Substance Storage Container Database.

A review of the UST list, as provided by EDR, and dated 04/08/2009 has revealed that there are 3 UST sites within approximately 0.25 miles of the target property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
USA GASOLINE #88	2700 41ST AVE	ENE 1/8 - 1/4 (0.188 mi.)	C17	31
<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
VALLE EUROPEAN AUTO SERVICE	2650 RESEARCH PARK DR	SW 0 - 1/8 (0.063 mi.)	A2	7
PACIFIC BELL NF508	7070 SOQUEL AVE	SW 1/8 - 1/4 (0.143 mi.)	B5	10

ADDITIONAL ENVIRONMENTAL RECORDS

Local Lists of Registered Storage Tanks

CA FID UST: The Facility Inventory Database contains active and inactive underground storage tank locations. The source is the State Water Resource Control Board.

A review of the CA FID UST list, as provided by EDR, and dated 10/31/1994 has revealed that there is 1 CA FID UST site within approximately 0.25 miles of the target property.

<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
PACIFIC BELL NF-697	7070 SOQUEL AVE	SW 1/8 - 1/4 (0.143 mi.)	B6	10

EXECUTIVE SUMMARY

HIST UST: Historical UST Registered Database.

A review of the HIST UST list, as provided by EDR, and dated 10/15/1990 has revealed that there are 4 HIST UST sites within approximately 0.25 miles of the target property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
<i>RAINTREE CAR WASH</i>	<i>2731 41ST AVE</i>	<i>ENE 1/8 - 1/4 (0.182 mi.)</i>	<i>C14</i>	<i>26</i>
<i>USA PETROLEUM COMPANY #88</i>	<i>2700 41ST AVE</i>	<i>ENE 1/8 - 1/4 (0.188 mi.)</i>	<i>C15</i>	<i>28</i>
<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
<i>PACIFIC BELL NF-697</i>	<i>7070 SOQUEL AVE</i>	<i>SW 1/8 - 1/4 (0.143 mi.)</i>	<i>B7</i>	<i>11</i>
<i>KMART ENTERPRISES</i>	<i>2600 41ST AVE</i>	<i>E 1/8 - 1/4 (0.173 mi.)</i>	<i>11</i>	<i>20</i>

SWEEPS UST: Statewide Environmental Evaluation and Planning System. This underground storage tank listing was updated and maintained by a company contacted by the SWRCB in the early 1990's. The listing is no longer updated or maintained. The local agency is the contact for more information on a site on the SWEEPS list.

A review of the SWEEPS UST list, as provided by EDR, and dated 06/01/1994 has revealed that there are 4 SWEEPS UST sites within approximately 0.25 miles of the target property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
<i>RAINTREE CAR WASH</i>	<i>2731 41ST AVE</i>	<i>ENE 1/8 - 1/4 (0.182 mi.)</i>	<i>C14</i>	<i>26</i>
<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
<i>VALLE VOLVO REPAIR</i>	<i>2650 RESEARCH PARK DR</i>	<i>SW 0 - 1/8 (0.063 mi.)</i>	<i>A1</i>	<i>7</i>
<i>PACIFIC BELL NF-697</i>	<i>7070 SOQUEL AVE</i>	<i>SW 1/8 - 1/4 (0.143 mi.)</i>	<i>B6</i>	<i>10</i>
<i>MANUEL ANECITO</i>	<i>3600 GROSS RD</i>	<i>S 1/8 - 1/4 (0.233 mi.)</i>	<i>19</i>	<i>34</i>

Other Ascertainable Records

RCRA-NonGen: RCRAInfo is EPA's comprehensive information system, providing access to data supporting the Resource Conservation and Recovery Act (RCRA) of 1976 and the Hazardous and Solid Waste Amendments (HSWA) of 1984. The database includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA). Non-Generators do not presently generate hazardous waste.

A review of the RCRA-NonGen list, as provided by EDR, and dated 11/12/2008 has revealed that there is 1 RCRA-NonGen site within approximately 0.25 miles of the target property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
<i>CALIFORNIA RADIOGRAPHICS INC</i>	<i>3335 SOQUEL DR</i>	<i>NNW 1/8 - 1/4 (0.220 mi.)</i>	<i>18</i>	<i>31</i>

EXECUTIVE SUMMARY

HIST CORTESE: The sites for the list are designated by the State Water Resource Control Board [LUST], the Integrated Waste Board [SWF/LS], and the Department of Toxic Substances Control [CALSTES].

A review of the HIST CORTESE list, as provided by EDR, and dated 04/01/2001 has revealed that there are 5 HIST CORTESE sites within approximately 0.5 miles of the target property.

<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
<i>SAN LORENZO LUMBER CO</i>	<i>2435 41ST AVE</i>	<i>ESE 1/8 - 1/4 (0.179 mi.)</i>	<i>13</i>	<i>24</i>
<i>FRITO LAY</i>	<i>2825 MATTISON LN</i>	<i>WNW 1/4 - 1/2 (0.254 mi.)</i>	<i>21</i>	<i>37</i>
<i>CHEVRON STATION</i>	<i>5998 SOQUEL DR</i>	<i>WSW 1/4 - 1/2 (0.255 mi.)</i>	<i>22</i>	<i>39</i>
<i>B P OIL CO FACILITY SITE 11240</i>	<i>2178 41ST AVE</i>	<i>SSE 1/4 - 1/2 (0.310 mi.)</i>	<i>25</i>	<i>45</i>
<i>SKILL CENTER INC</i>	<i>2685 MATTISON LN</i>	<i>W 1/4 - 1/2 (0.359 mi.)</i>	<i>27</i>	<i>53</i>

Notify 65: Notify 65 records contain facility notifications about any release that could impact drinking water and thereby expose the public to a potential health risk. The data come from the State Water Resources Control Board's Proposition 65 database.

A review of the Notify 65 list, as provided by EDR, and dated 10/21/1993 has revealed that there are 3 Notify 65 sites within approximately 1 mile of the target property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
WASH-N-DRY EM	2724 41ST STREET	ENE 0 - 1/8 (0.080 mi.)	3	7

<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
ARCO GAS STATION	819 BAY AVENUE	ESE 1/2 - 1 (0.598 mi.)	D28	55
ARCO GAS STATION	819 BAY AVENUE	ESE 1/2 - 1 (0.598 mi.)	D29	55

DRYCLEANERS: A list of drycleaner related facilities that have EPA ID numbers. These are facilities with certain SIC codes: power laundries, family and commercial; garment pressing and cleaners' agents; linen supply; coin-operated laundries and cleaning; drycleaning plants except rugs; carpet and upholster cleaning; industrial launderers; laundry and garment services.

A review of the DRYCLEANERS list, as provided by EDR, and dated 05/06/2009 has revealed that there are 2 DRYCLEANERS sites within approximately 0.25 miles of the target property.

<u>Lower Elevation</u>	<u>Address</u>	<u>Direction / Distance</u>	<u>Map ID</u>	<u>Page</u>
<i>ALL AMERICAN HONDA</i>	<i>6990 SOQUEL AVE</i>	<i>SW 1/8 - 1/4 (0.147 mi.)</i>	<i>B10</i>	<i>18</i>
<i>MASTER CLEANERS</i>	<i>2660 41ST AVE</i>	<i>ENE 1/8 - 1/4 (0.177 mi.)</i>	<i>C12</i>	<i>20</i>

EXECUTIVE SUMMARY

Due to poor or inadequate address information, the following sites were not mapped:


<u>Site Name</u>	<u>Database(s)</u>
UNOCAL SERVICE STATION #2452/C/O R	SWEEPS UST
CAPITOLA CLEANERS	DRYCLEANERS
PINE MOUNTAIN LUMBER COMPANY	Notify 65, SLIC, ENVIROSTOR
MCMILLIAN RESIDENCE	CERC-NFRAP
CHEVRON STATION #1707/98958	UST
NEW BRIGHTON PUMPING STATION	UST
HOME DEPOT USA HD6968	RCRA-SQG, HAZNET
CALIFORNIA DEPARTMENT OF TRANSPORT	RCRA-SQG
OCEAN HONDA	RCRA-SQG
TESORO WEST COAST COMPANY LLC NO 6	RCRA-SQG
SOQUEL AVENUE PROPERTY	SCH, ENVIROSTOR
NEXCYCLE	SWRCY

OVERVIEW MAP - 2521766.2s



- ★ Target Property
- ▲ Sites at elevations higher than or equal to the target property
- ◆ Sites at elevations lower than the target property
- ▲ Manufactured Gas Plants
- ☒ National Priority List Sites
- ☒ Dept. Defense Sites

- ☒ Indian Reservations BIA
- ⚡ Oil & Gas pipelines
- ▨ 100-year flood zone
- ▨ 500-year flood zone
- National Wetland Inventory
- ☒ Areas of Concern




This report includes Interactive Map Layers to display and/or hide map information. The legend includes only those icons for the default map view.

SITE NAME: SCW2
 ADDRESS: Research Park Drive
 Santa Cruz CA 95073
 LAT/LONG: 36.9844 / 121.9678

CLIENT: Atlas Engineering Services, Inc
 CONTACT: Fred Yukic
 INQUIRY #: 2521766.2s
 DATE: June 17, 2009 5:59 pm

DETAIL MAP - 2521766.2s

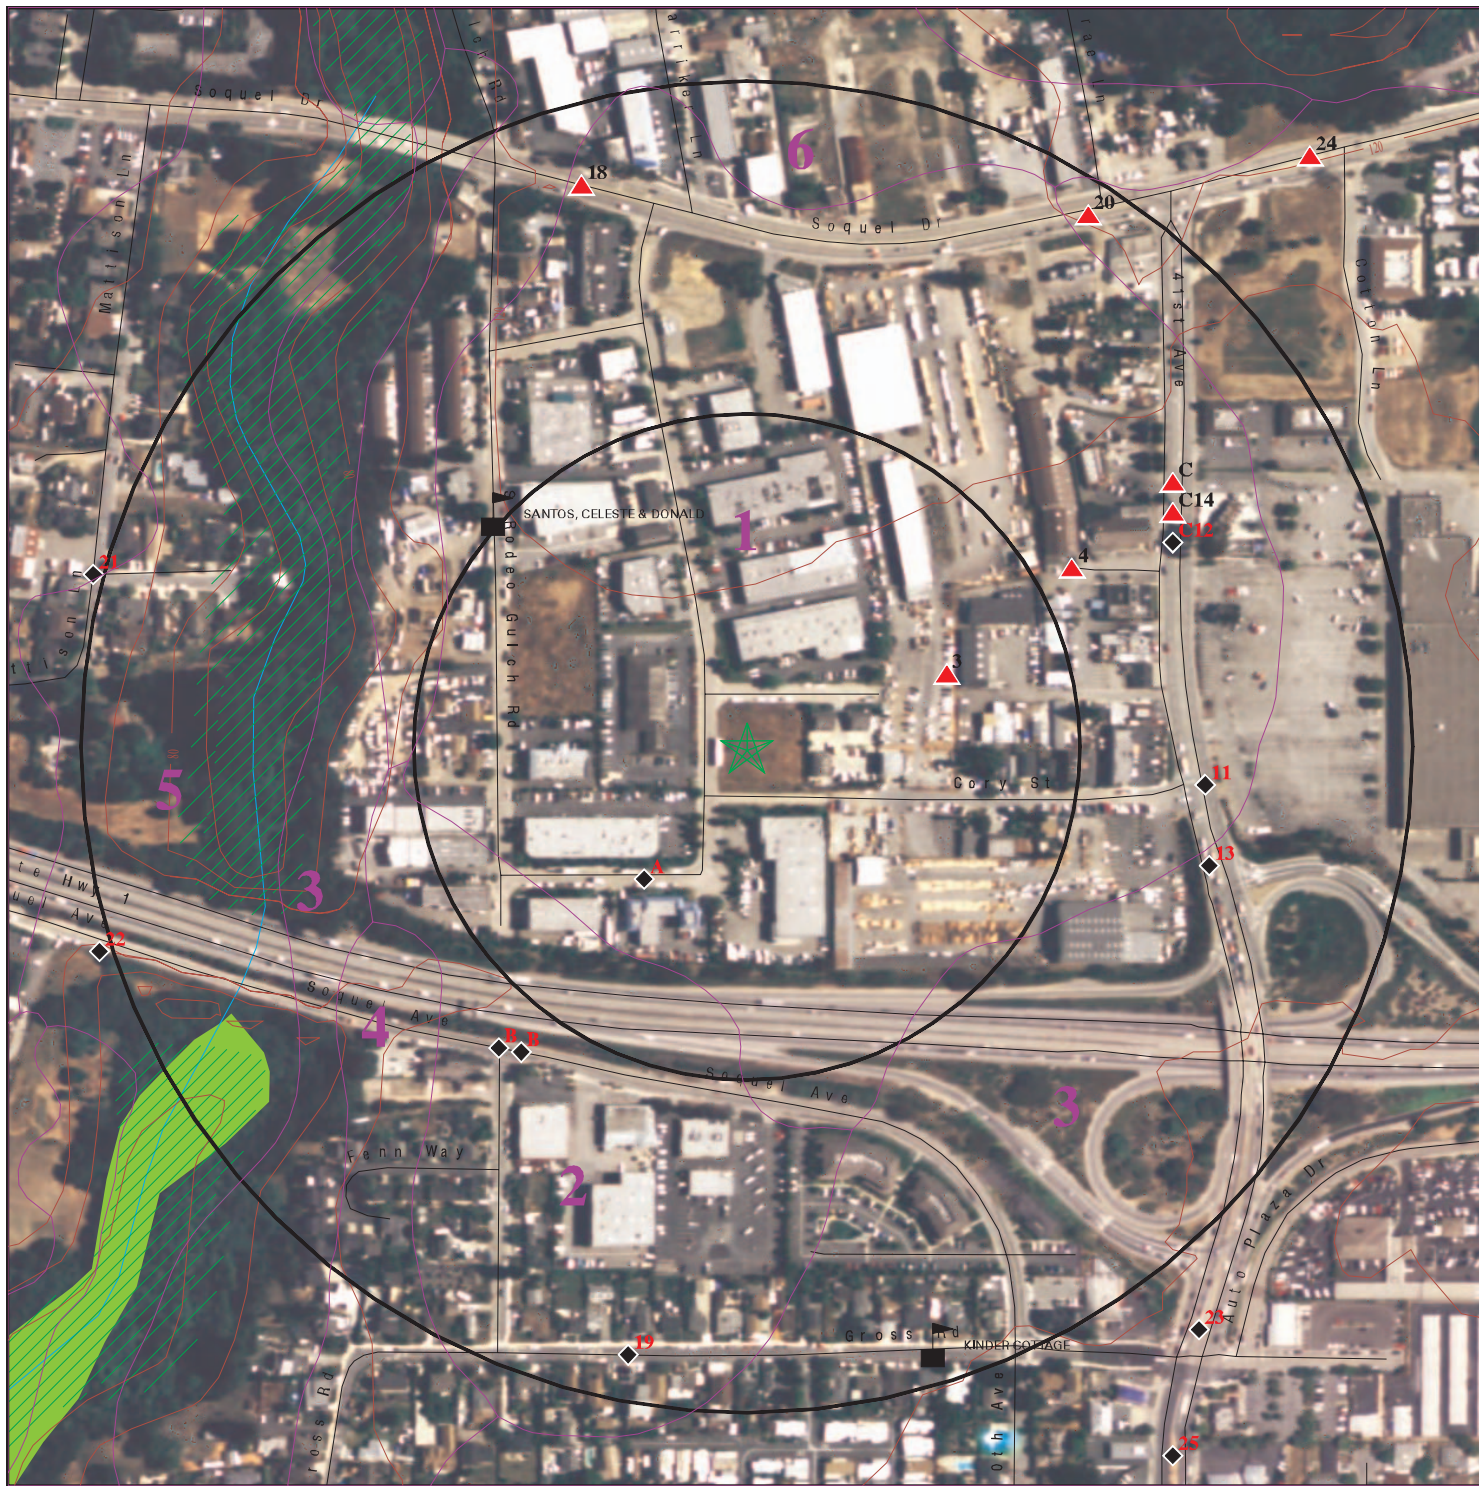

- ★ Target Property
- ▲ Sites at elevations higher than or equal to the target property
- ◆ Sites at elevations lower than the target property
- ▲ Manufactured Gas Plants
- Sensitive Receptors
- ▨ National Priority List Sites
- ▩ Dept. Defense Sites

- ▨ Indian Reservations BIA
- ⤿ Oil & Gas pipelines
- ▨ 100-year flood zone
- ▨ 500-year flood zone
- National Wetland Inventory

▨ Areas of Concern



This report includes Interactive Map Layers to display and/or hide map information. The legend includes only those icons for the default map view.

SITE NAME: SCW2
 ADDRESS: Research Park Drive
 Santa Cruz CA 95073
 LAT/LONG: 36.9844 / 121.9678

CLIENT: Atlas Engineering Services, Inc
 CONTACT: Fred Yukic
 INQUIRY #: 2521766.2s
 DATE: June 17, 2009 6:02 pm

MAP FINDINGS SUMMARY

Database	Target Property	Search Distance (Miles)	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
<u>STANDARD ENVIRONMENTAL RECORDS</u>								
<i>Federal NPL site list</i>								
NPL		1.000	0	0	0	0	NR	0
Proposed NPL		1.000	0	0	0	0	NR	0
NPL LIENS		TP	NR	NR	NR	NR	NR	0
<i>Federal Delisted NPL site list</i>								
Delisted NPL		1.000	0	0	0	0	NR	0
<i>Federal CERCLIS list</i>								
CERCLIS		0.500	0	0	0	NR	NR	0
<i>Federal CERCLIS NFRAP site List</i>								
CERC-NFRAP		0.500	0	0	0	NR	NR	0
<i>Federal RCRA CORRACTS facilities list</i>								
CORRACTS		1.000	0	0	0	0	NR	0
<i>Federal RCRA non-CORRACTS TSD facilities list</i>								
RCRA-TSDF		0.500	0	0	0	NR	NR	0
<i>Federal RCRA generators list</i>								
RCRA-LQG		0.250	0	0	NR	NR	NR	0
RCRA-SQG		0.250	0	5	NR	NR	NR	5
RCRA-CESQG		0.250	0	0	NR	NR	NR	0
<i>Federal institutional controls / engineering controls registries</i>								
US ENG CONTROLS		0.500	0	0	0	NR	NR	0
US INST CONTROL		0.500	0	0	0	NR	NR	0
<i>Federal ERNS list</i>								
ERNS		TP	NR	NR	NR	NR	NR	0
<i>State- and tribal - equivalent NPL</i>								
RESPONSE		1.000	0	0	0	0	NR	0
<i>State- and tribal - equivalent CERCLIS</i>								
ENVIROSTOR		1.000	0	0	0	1	NR	1
<i>State and tribal landfill and/or solid waste disposal site lists</i>								
SWF/LF		0.500	0	0	0	NR	NR	0
<i>State and tribal leaking storage tank lists</i>								
LUST		0.500	0	3	7	NR	NR	10
SLIC		0.500	0	0	0	NR	NR	0
INDIAN LUST		0.500	0	0	0	NR	NR	0

MAP FINDINGS SUMMARY

Database	Target Property	Search Distance (Miles)	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
<i>State and tribal registered storage tank lists</i>								
UST		0.250	1	2	NR	NR	NR	3
AST		0.250	0	0	NR	NR	NR	0
INDIAN UST		0.250	0	0	NR	NR	NR	0
<i>State and tribal voluntary cleanup sites</i>								
VCP		0.500	0	0	0	NR	NR	0
INDIAN VCP		0.500	0	0	0	NR	NR	0
<u>ADDITIONAL ENVIRONMENTAL RECORDS</u>								
<i>Local Brownfield lists</i>								
US BROWNFIELDS		0.500	0	0	0	NR	NR	0
<i>Local Lists of Landfill / Solid Waste Disposal Sites</i>								
DEBRIS REGION 9		0.500	0	0	0	NR	NR	0
ODI		0.500	0	0	0	NR	NR	0
WMUDS/SWAT		0.500	0	0	0	NR	NR	0
SWRCY		0.500	0	0	0	NR	NR	0
HAULERS		TP	NR	NR	NR	NR	NR	0
INDIAN ODI		0.500	0	0	0	NR	NR	0
<i>Local Lists of Hazardous waste / Contaminated Sites</i>								
US CDL		TP	NR	NR	NR	NR	NR	0
HIST Cal-Sites		1.000	0	0	0	0	NR	0
SCH		0.250	0	0	NR	NR	NR	0
Toxic Pits		1.000	0	0	0	0	NR	0
CDL		TP	NR	NR	NR	NR	NR	0
<i>Local Lists of Registered Storage Tanks</i>								
CA FID UST		0.250	0	1	NR	NR	NR	1
HIST UST		0.250	0	4	NR	NR	NR	4
SWEEPS UST		0.250	1	3	NR	NR	NR	4
<i>Local Land Records</i>								
LIENS 2		TP	NR	NR	NR	NR	NR	0
LUCIS		0.500	0	0	0	NR	NR	0
LIENS		TP	NR	NR	NR	NR	NR	0
DEED		0.500	0	0	0	NR	NR	0
<i>Records of Emergency Release Reports</i>								
HMIRS		TP	NR	NR	NR	NR	NR	0
CHMIRS		TP	NR	NR	NR	NR	NR	0
LDS		TP	NR	NR	NR	NR	NR	0
MCS		TP	NR	NR	NR	NR	NR	0
<i>Other Ascertainable Records</i>								
RCRA-NonGen		0.250	0	1	NR	NR	NR	1

MAP FINDINGS SUMMARY

Database	Target Property	Search Distance (Miles)	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
DOT OPS		TP	NR	NR	NR	NR	NR	0
DOD		1.000	0	0	0	0	NR	0
FUDS		1.000	0	0	0	0	NR	0
CONSENT		1.000	0	0	0	0	NR	0
ROD		1.000	0	0	0	0	NR	0
UMTRA		0.500	0	0	0	NR	NR	0
MINES		0.250	0	0	NR	NR	NR	0
TRIS		TP	NR	NR	NR	NR	NR	0
TSCA		TP	NR	NR	NR	NR	NR	0
FTTS		TP	NR	NR	NR	NR	NR	0
HIST FTTS		TP	NR	NR	NR	NR	NR	0
SSTS		TP	NR	NR	NR	NR	NR	0
ICIS		TP	NR	NR	NR	NR	NR	0
PADS		TP	NR	NR	NR	NR	NR	0
MLTS		TP	NR	NR	NR	NR	NR	0
RADINFO		TP	NR	NR	NR	NR	NR	0
FINDS		TP	NR	NR	NR	NR	NR	0
RAATS		TP	NR	NR	NR	NR	NR	0
CA BOND EXP. PLAN		1.000	0	0	0	0	NR	0
CA WDS		TP	NR	NR	NR	NR	NR	0
NPDES		TP	NR	NR	NR	NR	NR	0
Cortese		0.500	0	0	0	NR	NR	0
HIST CORTESE		0.500	0	1	4	NR	NR	5
Notify 65		1.000	1	0	0	2	NR	3
DRYCLEANERS		0.250	0	2	NR	NR	NR	2
WIP		0.250	0	0	NR	NR	NR	0
HAZNET		TP	NR	NR	NR	NR	NR	0
EMI		TP	NR	NR	NR	NR	NR	0
INDIAN RESERV		1.000	0	0	0	0	NR	0
SCRD DRYCLEANERS		0.500	0	0	0	NR	NR	0

EDR PROPRIETARY RECORDS

EDR Proprietary Records

Manufactured Gas Plants		1.000	0	0	0	0	NR	0
-------------------------	--	-------	---	---	---	---	----	---

NOTES:

TP = Target Property

NR = Not Requested at this Search Distance


Sites may be listed in more than one database

Phase 1 Environmental Assessment
APN 030-181-70
Vacant Lot on Research Park Drive
Soquel, California
July 15, 2009



APPENDIX B

PORTION OF SCCEHD HAZARDOUS MATERIALS FILE
ON
3801 SOQUEL DRIVE

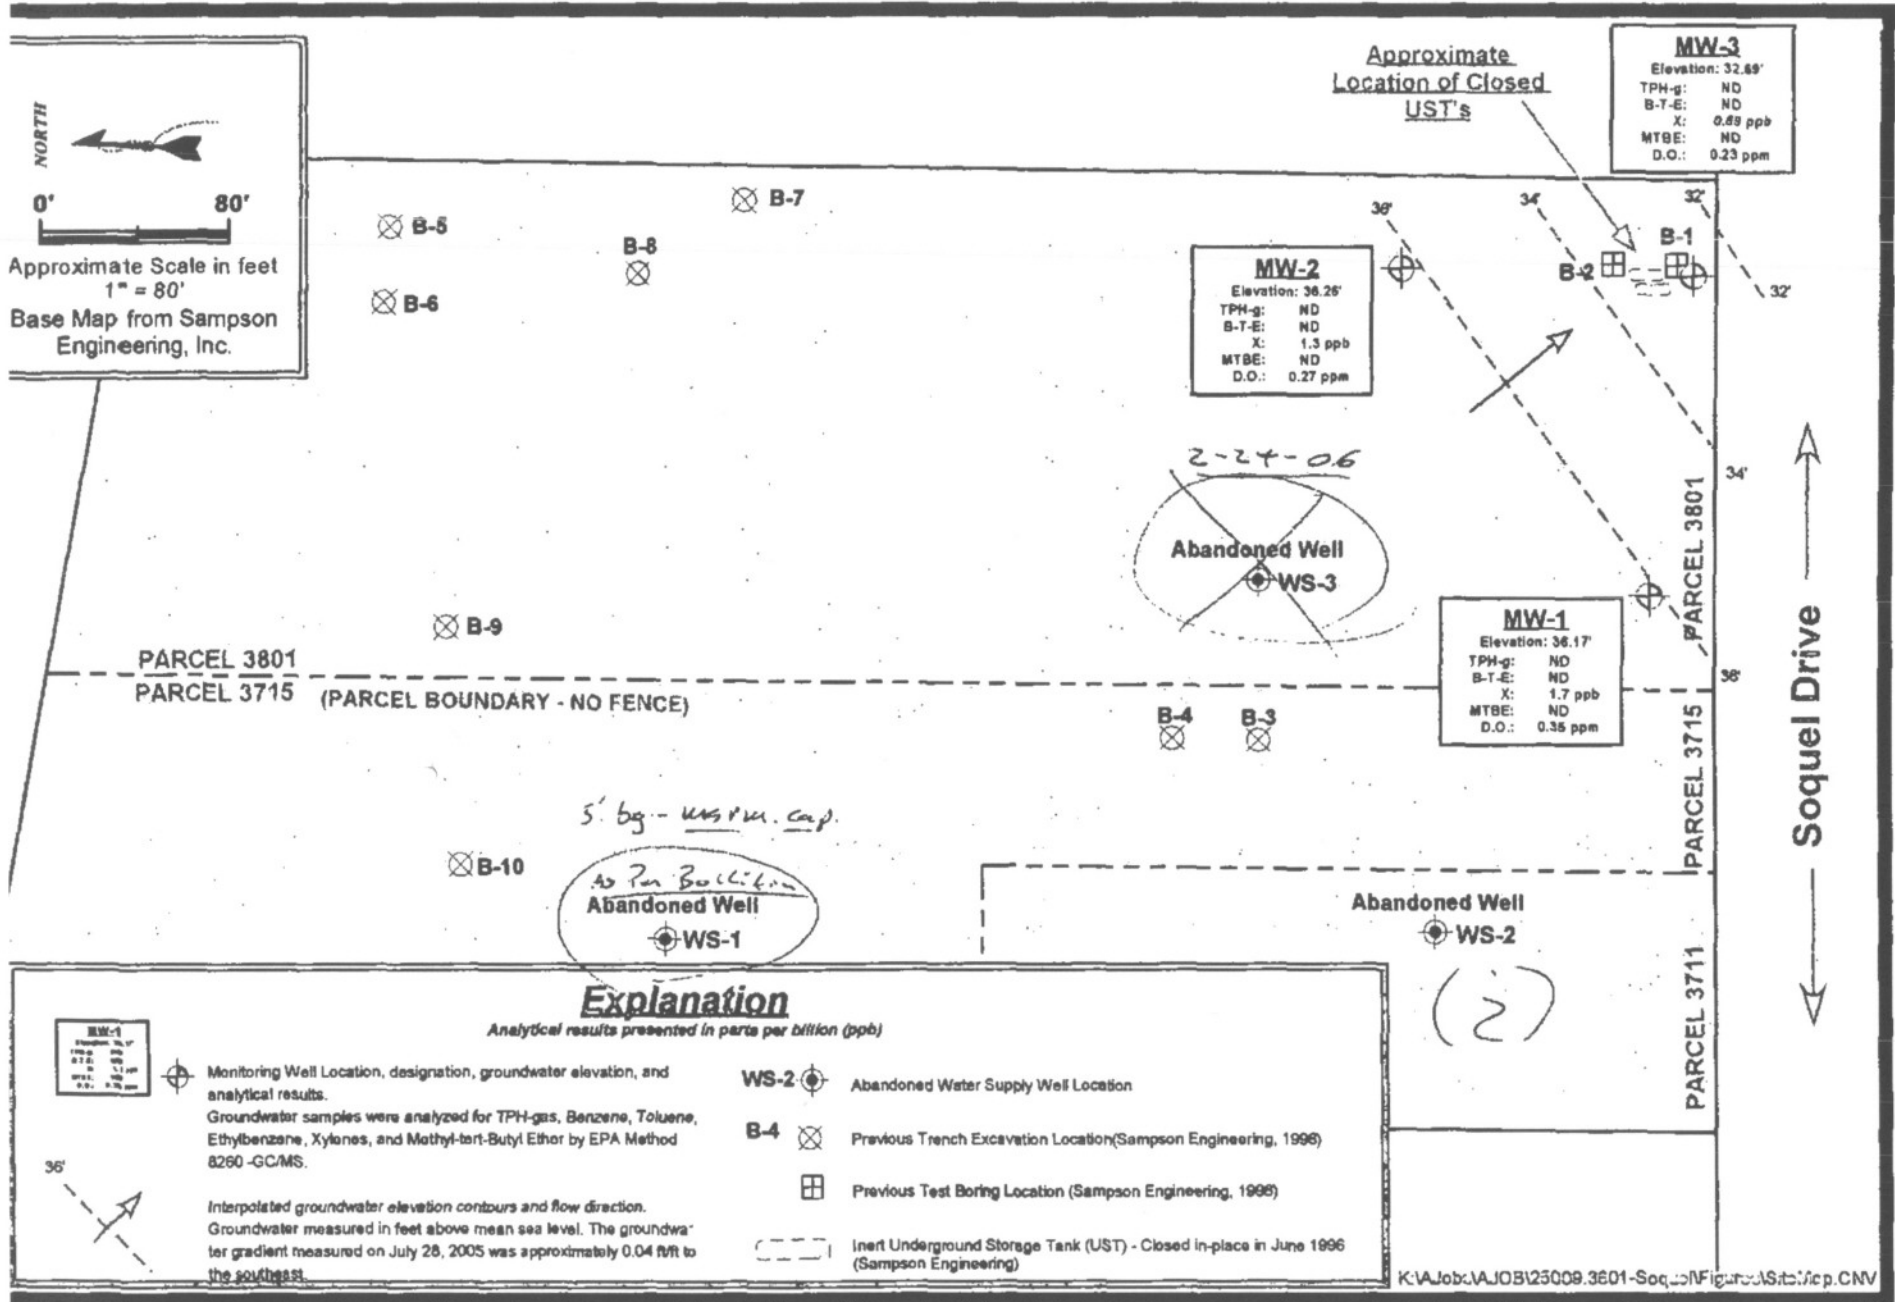

5.0 ABANDONED WATER SUPPLY WELL CLOSURE

As outlined in our *Workplan for UST Site Cleanup and Closure*, we have completed the following steps towards properly closing two abandoned water supply wells at the site, located on parcel 3801 and parcel 3715:


- Hired a professional underground locator to aid in locating two wells reported to be buried and constructed of steel casing. The field mobilization was unsuccessful in locating these wells, as the site is littered with metallic debris left over from demolition operations.
- Uncovered an 8" diameter well casing constructed of steel on parcel 3801 in an extensive effort with aid of a backhoe in a 400 foot area by 3.5 foot deep swath. We were extremely lucky in finding this well.
- Subcontracted with Maggiora Bros Drilling Inc. to extract pumps / debris from the two known supply wells on October 18, 2005.
- Subcontracted with Newman Well Surveys to video log the two known supply wells on October 2005 to check for perforation intervals, total depth, and to check for casing damage and / or obstructions in the well column.

5.1 8" Steel Well - Parcel 3801: Approximately 120 feet of "screw jack" pump column was extracted from this well on October 18, 2005. No pump was attached to the extracted column. Upon video inspection, this well was discovered to be blocked with debris (i.e. soil) at approximately 7 feet bgs. The well casing was observed to be very old and decrepit.


5.2 5" PVC Well - Parcel 3715: Approximately 160 feet of PVC pump column and pump were extracted from this well on October 18, 2005. Video inspection of this well revealed "saw cut" perforations to start at 112 feet below the top of well casing (btoc). The perforations continued to the base of the well which was tagged at 162.5 btoc. Based on casing joint intervals (20 feet) the total depth of this well was determined to be 170.9 feet btoc, as the last joint was observed at 150.9 feet btoc. Based on this observation, there may be up to 8.4 feet of sediment at the base of this well. The well casing did not appear to be damaged.

6.0 CONCLUSIONS

- Three groundwater monitoring wells at the site were properly destroyed on August 15, 2005. Groundwater at the site was confirmed to be free of contamination during WHA confirmation sampling event conducted on July 28, 2005 (*Weber, Hayes and Associates*, August 3, 2005).
- A significant remedial excavation was completed in the removal of approximately 750 yds³ of petroleum hydrocarbon impacted soils from the vicinity of a former UST system at the site. Based on



Approximate Scale in feet
1" = 80'
Base Map from Sampson
Engineering, Inc.

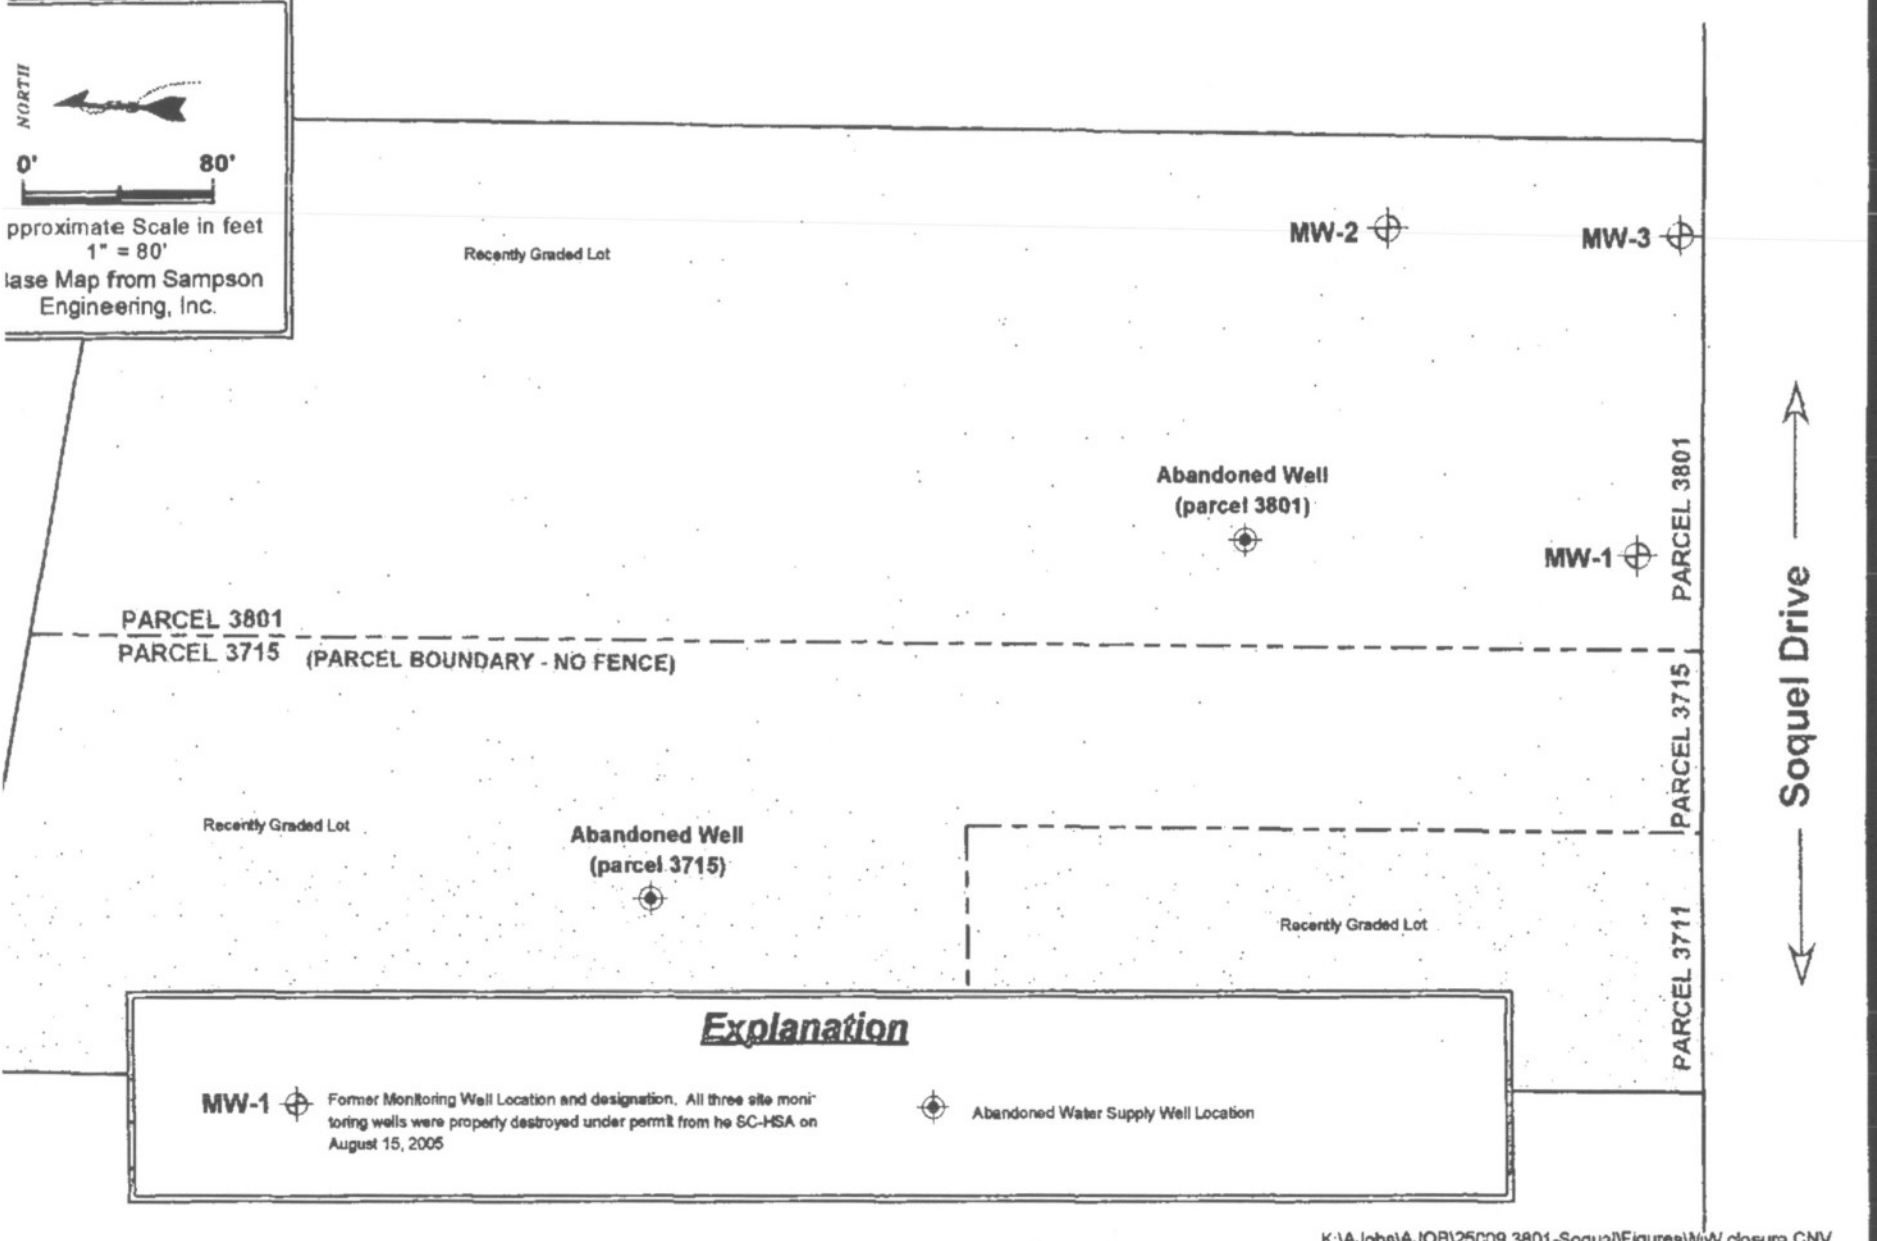

Explanation

MW-1 ◉ Former Monitoring Well Location and designation. All three site monitoring wells were properly destroyed under permit from the SC-HSA on August 15, 2005

◉ Abandoned Water Supply Well Location

K:\A\Jobs\AJOB\25C09.3801-Soquel\Figures\MW_closure.CNV

Phase 1 Environmental Assessment
APN 030-181-70
Vacant Lot on Research Park Drive
Soquel, California
July 15, 2009



APPENDIX C

SITE INSPECTION FORM

**ENVIRONMENTAL PROPERTY ASSESSMENT
FIELD CHECKLIST**

SITE NAME Research Park Dr.

NAME OF INSPECTOR F. Yurko

PROJECT NUMBER _____

DATE 7-1-09

TIME 3:45

	YES	NO	COMMENTS
1. Flora/Fauna	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<u>PE on E</u>
2. Wooded Area	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
3. Stressed Vegetation	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
4. Discolored or Disturbed Soils	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<u>Disturbed surface - no color</u>
5. Depressions/Pits	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<u>3' x 3' in center - driving through</u>
6. Mounding/Piles of Soil	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<u>2 small mounds on S. side - ea 2 1/2'</u>
7. Landfills	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
8. Scattered Debris	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<u>scattered concrete and asphalt road glass</u>
9. Solid Waste Repository	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
10. Solid Waste Hauler	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
11. Trails/Dead End Roads	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
12. Railroad Track	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
13. Railroad Spurs	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
14. Building/Structures	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Discharge Outlets	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Air	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Water	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
15. Noise	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<u>street</u>
16. Dust/Smoke	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
17. Unusual/Noxious Odors	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
18. Surface Water	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
a. Creeks	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
b. Streams	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
c. Rivers	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
d. Ponds	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
e. Wetlands	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
f. Lakes	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
g. Surface Impoundments	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
h. Swale	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<u>N to S along S. border</u>
i. Drainage Ditch	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
19. Discolored/Unusual Smelling Water	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
20. Sanitary Sewer	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
21. Storm Sewer <u>Drain</u>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<u>in street</u>
22. Septic System	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
23. Underground Utilities	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<u>water buried street electrical to G.</u>

	YES	NO	COMMENTS
24. Pipelines	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
25. Water Wells	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
26. Monitoring Wells	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
27. Soil Borings	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
28. Underground Storage Tanks	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
29. Above-Ground Storage Tanks	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
30. Drums	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
31. Transformers	<input checked="" type="checkbox"/>	<input type="checkbox"/>	offense @ 2/15 com
32. Other	<input checked="" type="checkbox"/>	<input type="checkbox"/>	concrete box offense 6'x3'x4' separate?
33. Other	<input type="checkbox"/>	<input type="checkbox"/>	
34. Other	<input type="checkbox"/>	<input type="checkbox"/>	
35. Describe Adjacent Land Use	<input type="checkbox"/>	<input type="checkbox"/>	

North _____
 South _____
 West _____
 East _____

Phase 1 Environmental Assessment
APN 030-181-70
Vacant Lot on Research Park Drive
Soquel, California
July 15, 2009



APPENDIX D

INTERVIEW FORM

Research Park Drive

7-15-09
fy

Dawn Smithson, City of SC water
ASTM E 1527 - 05
X3. USER QUESTIONNAIRE

INTRODUCTION

In order to qualify for one of the *Landowner Liability Protections (LLPs)*³⁵ offered by the Small Business Liability Relief and Brownfields Revitalization Act of 2001 (the "*Brownfields Amendments*"),³⁶ the *user* must provide the following information (if available) to the *environmental professional*. Failure to provide this information could result in a determination that "*all appropriate inquiry*" is not complete.

(1.) Environmental cleanup liens that are filed or recorded against the site (40 CFR 312.25).

Are you aware of any environmental cleanup liens against the *property* that are filed or recorded under federal, tribal, state or local law? No

(2.) Activity and land use limitations that are in place on the site or that have been filed or recorded in a registry (40 CFR 312.26).

Are you aware of any AULs, such as *engineering controls*, *land use restrictions* or *institutional controls* that are in place at the site and/or have been filed or recorded in a registry under federal, tribal, state or local law? Not that aware of

(3.) Specialized knowledge or experience of the person seeking to qualify for the LLP (40 CFR 312.28).

As the *user* of this *ESA* do you have any specialized knowledge or experience related to the *property* or nearby properties? For example, are you involved in the same line of business as the current or former *occupants* of the *property* or an adjoining *property* so that you would have specialized knowledge of the chemicals and processes used by this type of business? No

(4.) Relationship of the purchase price to the fair market value of the property if it were not contaminated (40 CFR 312.29).

Does the purchase price being paid for this *property* reasonably reflect the fair market value of the *property*? If you conclude that there is a difference, have you considered whether the lower purchase price is because contamination is known or believed to be present at the *property*? Yes, it will

(5.) Commonly known or reasonably ascertainable information about the property (40 CFR 312.30).

Are you aware of commonly known or *reasonably ascertainable* information about the *property* that would help the *environmental professional* to identify conditions indicative of releases or threatened releases? For example, as *user*,

- (a) Do you know the past uses of the *property*? No
- (b) Do you know of specific chemicals that are present or once were present at the *property*? No
- (c) Do you know of spills or other chemical releases that have taken place at the *property*? No
- (d) Do you know of any environmental cleanups that have taken place at the *property*? No

(6.) The degree of obviousness of the presence of likely presence of contamination at the property, and the ability to detect the contamination by appropriate investigation (40 CFR 312.31).

As the *user* of this *ESA*, based on your knowledge and experience related to the *property* are there any *obvious* indicators that point to the presence or likely presence of contamination at the *property*? No

³⁵ *Landowner Liability Protections*, or *LLPs*, is the term used to describe the three types of potential defenses to Superfund liability in EPA's *Interim Guidance Regarding Criteria Landowners Must Meet in Order to Qualify for Bona Fide Prospective Purchaser, Contiguous Property Owner, or Innocent Landowner Limitations on CERCLA Liability* ("Common Elements" Guide) issued on March 6, 2003.

³⁶ P.L. 107-118.

X3.1 In addition, certain information should be collected, if available, and provided to the *environmental professional* selected to conduct the Phase I. This information is intended to assist the *environmental professional* but is not necessarily required to qualify for one of the *LLPs*. The information includes:

- (a) the reason why the Phase I is required,
- (b) the type of *property* and type of *property* transaction, for example, sale, purchase, exchange, etc.,

(c) the complete and correct address for the *property* (a map or other documentation showing *property* location and boundaries is helpful),

(d) the scope of services desired for the Phase I (including whether any parties to the *property* transaction may have a required standard scope of services on whether any considerations beyond the requirements of Practice E 1527 are to be considered),

(e) identification of all parties who will rely on the Phase I report,



APPENDIX D – Beltz Well Capture Zone Report



Beltz Well #12 Capture Zone Analysis Report
(Vacant Lot on Research Park Dr., Soquel, CA)

June 28, 2010

Prepared By: Leah Van Der Maaten

PURPOSE AND SCOPE

The Phase 1 Environmental Assessment dated July 15, 2009 by Atlas Engineering Services, Inc. determined that a Leaking Underground Fuel Tank (LUST) site is located close enough to the proposed Beltz Well #12 site to pose a potentially significant environmental condition that could impact the use of the site for a drinking water well. The report recommended that a capture zone analysis of the pumping production well be conducted to ascertain the likelihood of petroleum hydrocarbons from the LUST site entering the well during production. The City performed the capture zone analysis and the methods used, results, and conclusions are summarized in this report. The scope of the analysis was to calculate the capture zone for the proposed Beltz Well #12 and determine if the LUST site is within the capture zone.

BACKGROUND INFORMATION

The proposed Beltz Well #12 site, here in referred to as well site, is located on a vacant lot on Research Park Dr. in Soquel, California (APN 030-181-170). A drinking water monitoring well was constructed adjacent to the well site in a public right of way on Cory Street in November 2009. The hydrogeological information collected during the monitoring well installation was used in this capture zone analysis.

The LUST site of concern is located at 2178 41st Avenue in Capitola, California, approximately 1,650 feet (ft) southeast of the proposed well site. The following information about the site was obtained from the California State Water Resource Control Board Geotracker website:

- The case was opened in October 1992 and remediation began in October 2001.
- The contaminant of concern is Gasoline.
- Benzene and TBA are currently above the Regional Water Quality Board's cleanup goals.

The Purisma Aquifer A zone is the shallowest aquifer in the project area (Figure 2). The deepest monitoring well at the LUST site is 72.4 ft below ground surface (Stantec, 2009); therefore, the Purisma A zone is the only contaminated aquifer. The primary direction of groundwater flow at the LUST site is in the south and southeast direction, away from the well site (Stantec, 2009). The preliminary Beltz Well #12 design places the first screened interval beginning at 150 feet below ground surface, significantly deeper than the plume at the LUFT site.

METHOD OF ANALYSIS

Capture zone analyses are typically performed for pump and treat groundwater remediation projects. The capture zone analysis for this project is more straightforward than analyses used for remediation projects. Capture zone analyses for remediation projects are complex and often require modeling software because they need to address many variables, such as geological heterogeneities and time-varying influences, so that they can effectively contain and cleanup the contamination plume. The purpose of this analysis is solely to determine if the LUST site is within the capture zone of the proposed well site. The analysis was simplified by assuming a worst case scenario, as well as assuming that the water-bearing zone is homogeneous, isotropic, confined, uniform thickness, and uniform horizontal hydraulic gradient.

This capture zone analysis was performed using equations 10.16-10.18 from *Applied Hydrogeology* by C.W. Fetter; refer to Figure 5 for details. A worst case scenario was evaluated by assuming a maximum pumping rate of 800 gallons per minute (gpm), all water was assumed to come from the Purisma Aquifer A zone, and the aquifer was assumed to be confined. The following aquifer characteristics were used in the calculations: average hydraulic conductivity of 23 ft/day, saturated aquifer thickness of 130 feet (Hopkins, February 2010), and a hydraulic gradient of 0.009 in the absence of pumping (Hopkins, April 2010). The hydraulic conductivity in the A zone varied from 13 to 32 ft/day (Hopkins, February 2010). The average of these values was used in this analysis. The hydraulic gradient was determined using the static water levels of three nearby monitoring wells (Cory Street, Coffee Lane Park, and Auto Plaza Drive) and was determined to flow west (Figure 1). The reference axis of the capture zone passes through the well site and extends parallel to the direction of the hydraulic gradient.

FINDINGS

The capture zone calculations determined a stagnation point of 911 ft and a maximum half width of the 2,861 ft. The stagnation point is the radial distance in the down-gradient direction from the well site. These values produce a capture zone that is very large, extending over 8,800 ft west of the well site. This large area was adjusted to take into account the fact that the capture zone would not extend past the end of the Purisma A aquifer. Figure 2 is a map of the Purisma A zone that shows the western boundary used to shorten the capture zone. At the western boundary of the Purisma A zone the total width of the capture zone is approximately 4,800 ft. The final capture zone is shown in figure 3. The LUFT site is located outside of both the calculated and the adjusted well site capture zone.

In addition to performing the capture zone analysis, the City investigated active LUST sites within the capture zone and reviewed LUST information from the State Water Resource Control Board Geotracker website. Geotracker identified 25 LUST sites within 4,200 feet of the well site. Refer to Figure 4 for a map of the sites and Table 1 for a detailed list of these sites. A number of these sites are located outside of the capture zone

and a majority of the sites have completed their cleanups. Geotracker identified only one active LUST site within the capture zone of the proposed well site. This site is known as Skill Center Inc. and is located at 2685 Mattison Lane in Santa Cruz, approximately 2,000 ft from the well site. On May 12, 2010 Mr. John Gerbrandt from the Santa Cruz County Environmental Health Department informed us that contrary to what was reported on Geotracker, the cleanup of this LUST site is complete and the case is closed.

CONCLUSIONS

Based on this analysis, it appears that the LUST site located at 2178 41st Avenue does not pose a potentially significant environmental condition that could impact the use of the site for a drinking water well for the following reasons:

- The LUST site is outside of the capture zone. Groundwater outside of the well site capture zone does not drain into the pumping well.
- The contamination is much shallower than the depth of the proposed well perforations.
- The groundwater at the LUST site flows away from the well site.

There are no other active LUST sites within the capture zone of the well site.

REFERENCES

Fetter, C.W. (2001). Applied Hydrogeology. Fourth Edition. (pp.436-437)


CA State Water Resources Control Board GeoTracker. BP#11240. Retrieved May 5, 2010, from
https://geotracker.waterboards.ca.gov/profile_report.asp?global_id=T0608700078

Hopkins Groundwater Consultants, Inc. (February 2010). Summary of Operations Report City of Santa Cruz Beltz Monitoring Well Construction Project Cory Street Well Site. (pp. 6-10)

Stantec. (January 19, 2009). Quarterly Groundwater Monitoring and Remediation Progress Report, Fourth Quarter 2008, Former BP Service Station No. 11240. (Table 5)

Hopkins Groundwater Consultants. (April 2010). Groundwater Gradient Map Project No. 01-010-08A.



CA State Water Resources Control Board GeoTracker. Geotracker Map and Site List. Retrieved June 7, 2010, from
https://geotracker.waterboards.ca.gov/map/?global_id=T0608700078

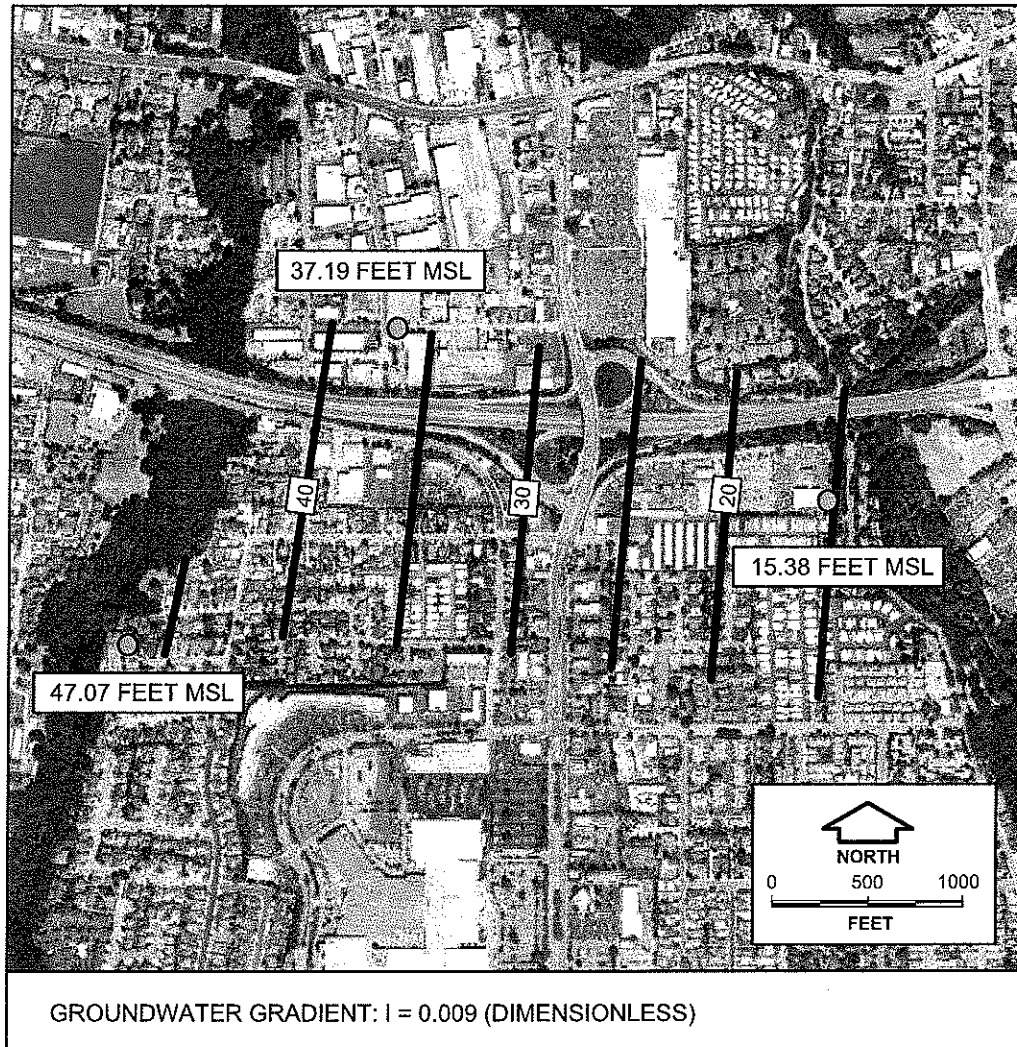

GROUNDWATER GRADIENT MAP
City of Santa Cruz
Santa Cruz, California

Figure 2

April 2010
Project No. 01-010-08A

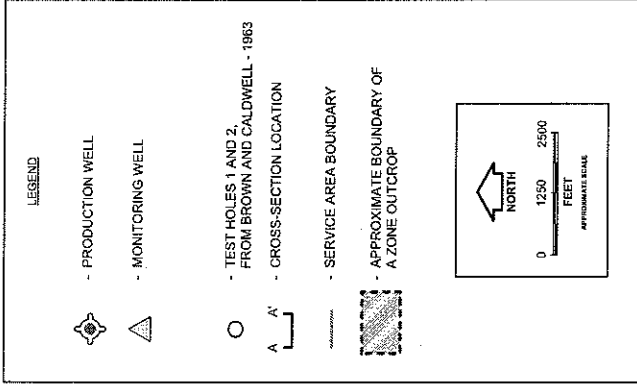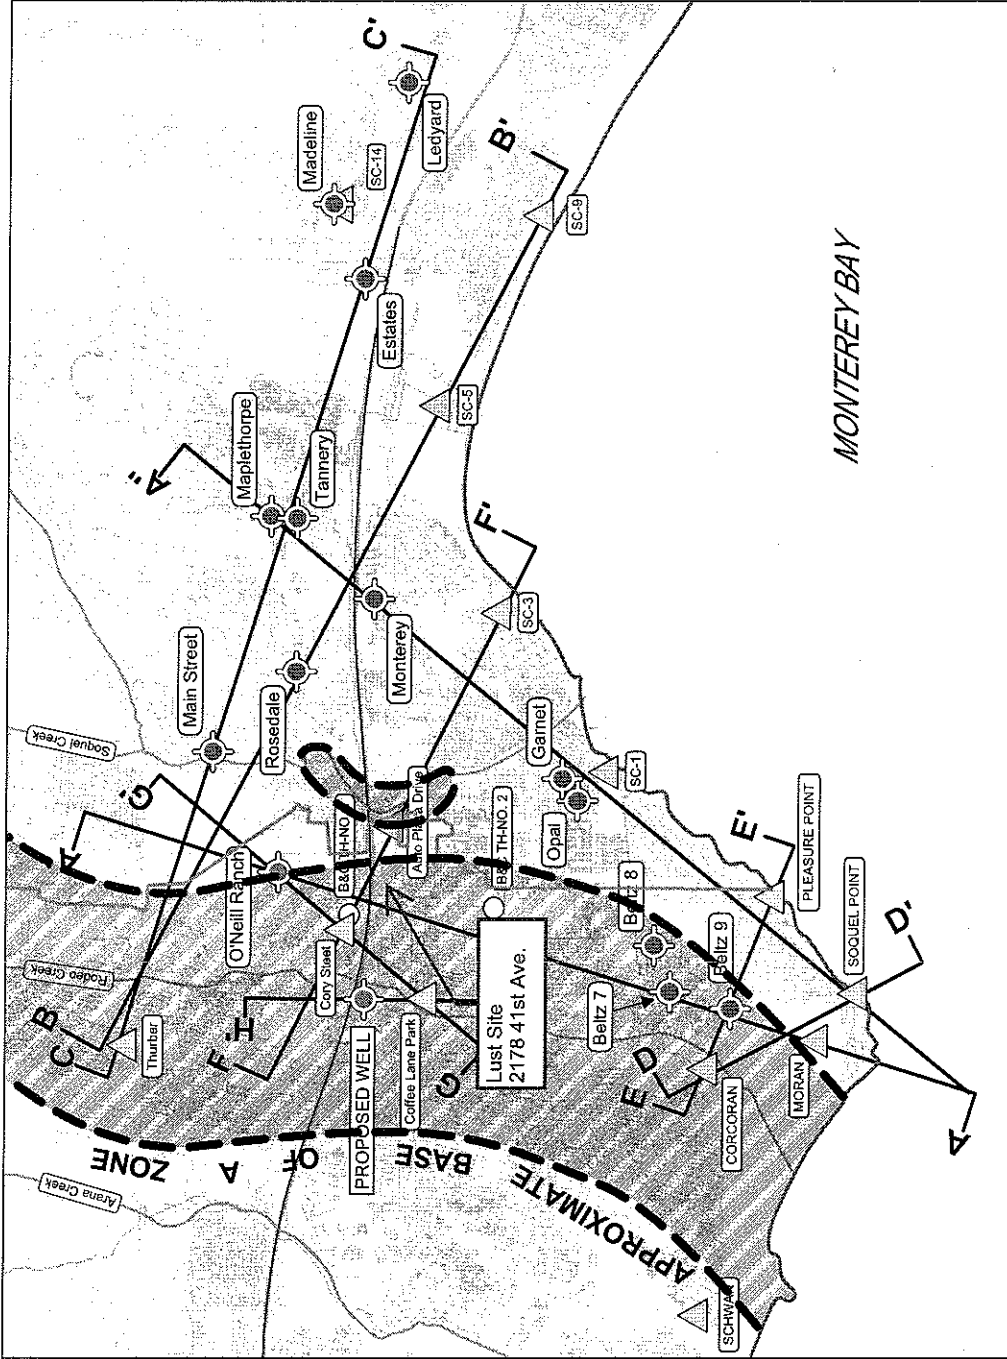

**HYDROGEOLOGICAL CROSS-SECTION
LOCATION MAP**
Hydrogeological Conditions Study
of Live Oak-Capitola Area
City of Santa Cruz
Santa Cruz, California

RESEARCH PARK DRIVE WELL SITE

CAPTURE ZONE ANALYSIS

800 GPM PUMPING RATE

SOQUEL, CALIFORNIA

MAY 11, 2010

LEGEND:

--- BOUNDARY OF CAPTURE ZONE


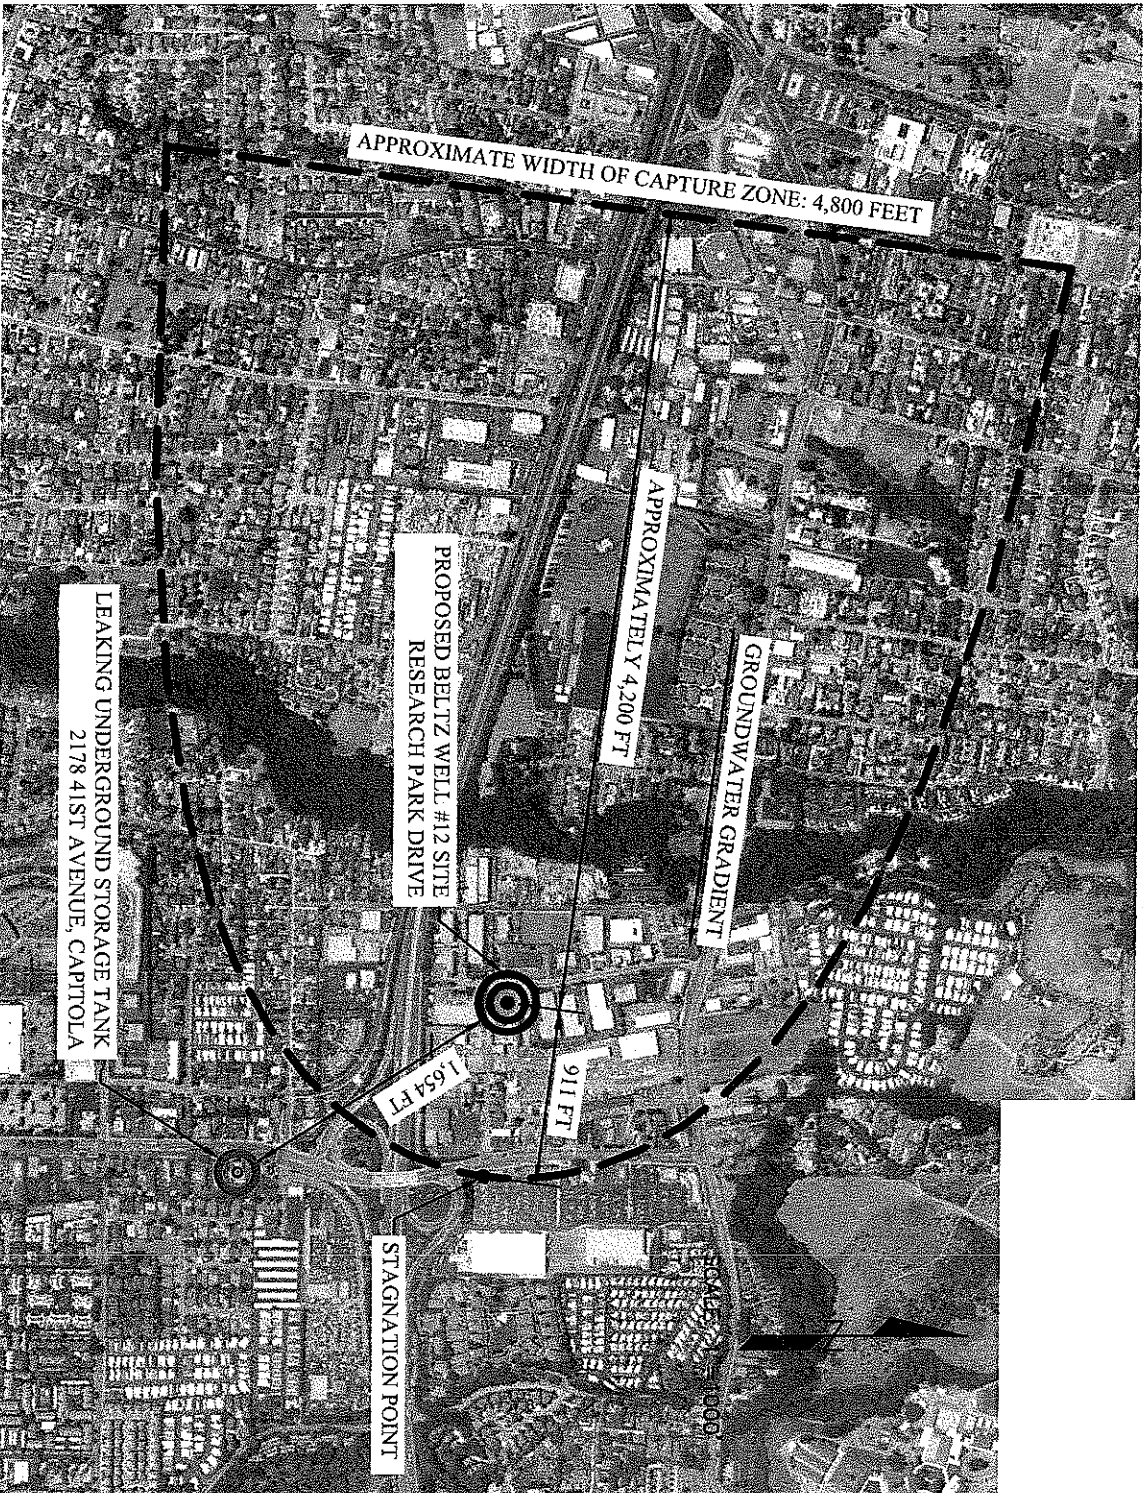


Figure 4

LINK TO THIS MAP

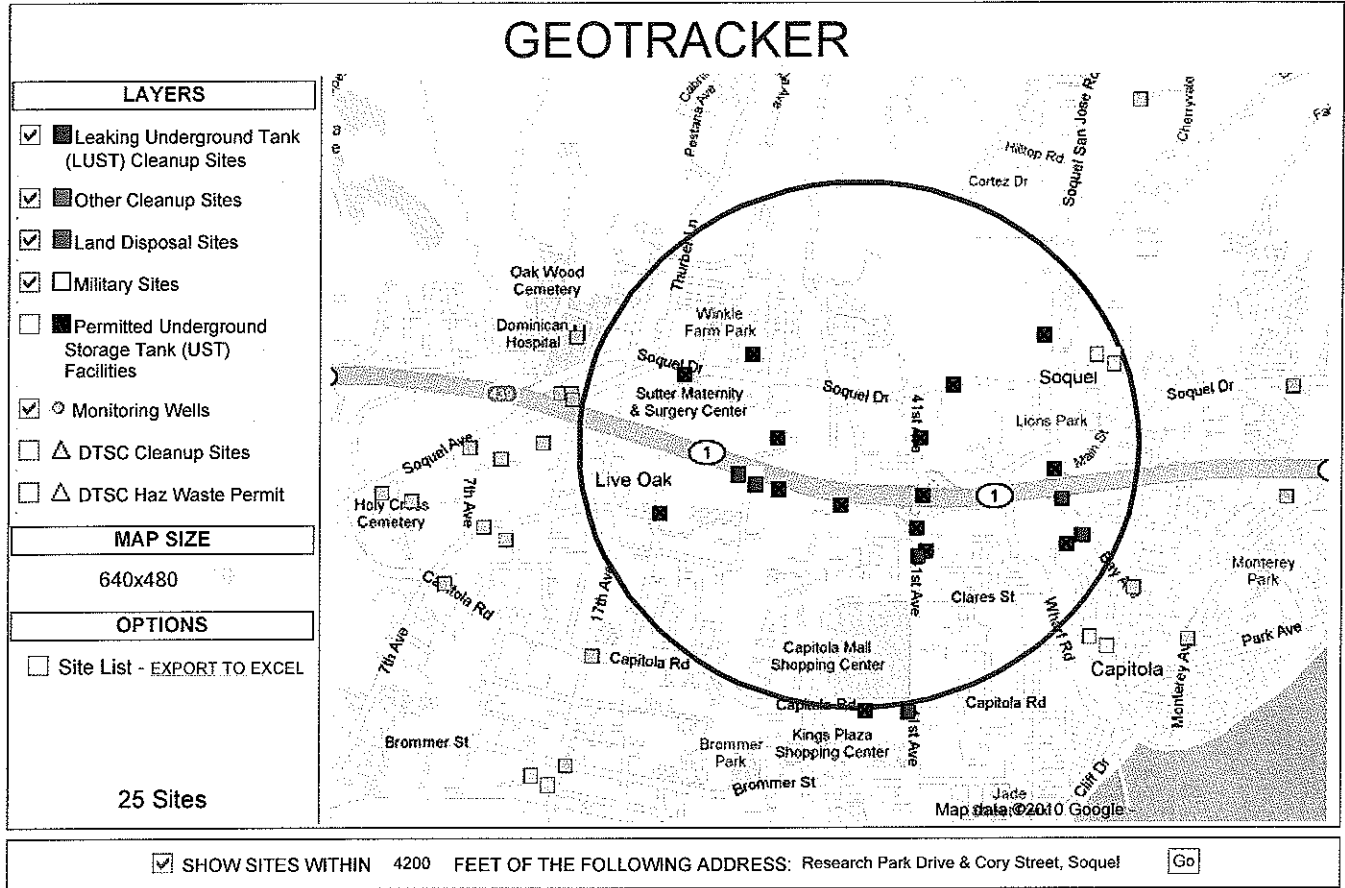

MAP AN ADDRESS: Research Park Drive & Cory Street, Soquel


Table 1: Geotracker sites within 4,200ft of proposed Beltz Well #12 site at Research Park Drive & Cory Street, Soquel CA

GEOTRACKER ID	SITE NAME	CLEANUP STATUS	ADDRESS	CITY	Within Capture Zone
T060876507	PACIFIC BELL FLEET OPERATIONS	COMPLETED - CASE CLOSED	7070 SOQUEL AVENUE	SANTA CRUZ	yes
T0608700160	SERVICE STATION NO 88	COMPLETED - CASE CLOSED	2700 41ST ST	SOQUEL	yes
T0608700067	SAN LORENZO LUMBER CO	COMPLETED - CASE CLOSED	2435 41ST AVE	SANTA CRUZ	yes
T0608700119	TOSCO SERVICE STATION #4902	COMPLETED - CASE CLOSED	2255 41ST AVE	CAPITOLA	no
T0608700108	COCA-COLA ENTERPRISES - WEST	COMPLETED - CASE CLOSED	6100 SOQUEL AVE	SANTA CRUZ	yes
T0608700195	FRITO LAY	COMPLETED - CASE CLOSED	2825 MATTISON LN	SANTA CRUZ	yes
T0608700078	BP #11240	OPEN - SITE ASSESSMENT	2178 41ST AVE	CAPITOLA	no
T0608700238	BP OIL FACILITY NO. 11240	COMPLETED - CASE CLOSED	2178 41ST AVE	CAPITOLA	no
T0608700221	CHEVRON STATION	COMPLETED - CASE CLOSED	5998 SOQUEL DR	SANTA CRUZ	yes
T0608700231	SKILL CENTER INC	COMPLETED - CASE CLOSED	2685 MATTISON LN	SANTA CRUZ	yes
T0608700170	4100 SOQUEL DR	OPEN - REMEDIATION	4100 SOQUEL DR	SOQUEL	no
T0608700297	JIMMY SMITH PLUMBING	COMPLETED - CASE CLOSED	3098 WINKLE AVE	SANTA CRUZ	yes
T0608700250	ARCO STATION	COMPLETED - CASE CLOSED	2407 PORTER ST	SOQUEL	no
T0608700308	ULTRAMAR BEACON	COMPLETED - CASE CLOSED	2210 SOQUEL DR	SANTA CRUZ	yes
T0608700168	FORMER EXXON 7-0281	OPEN - VERIFICATION MONITORING	2501 MAIN ST S	SOQUEL	no
T0608700005	FORMER EXXON 7-3604	OPEN - VERIFICATION MONITORING	836 BAY AVE	CAPITOLA	no
T0608700006	EXXON STATION 7-0281 FIRST LEA	COMPLETED - CASE CLOSED	2501 MAIN ST S	SOQUEL	no
T0608700070	CENTRAL COUNTY GARBAGE	COMPLETED - CASE CLOSED	2230 CHANTICLEER ST	SANTA CRUZ	yes
T0608700053	DANCO PROPERTY	COMPLETED - CASE CLOSED	2185 CHANTICLEER ST	SANTA CRUZ	yes
T0608700052	SOQUEL PUMP STATION	COMPLETED - CASE CLOSED	809 BAY AVE	CAPITOLA	no
T0608700245	PONZA BROTHERS YARD	COMPLETED - CASE CLOSED	3131 PORTER ST	SOQUEL	no
T0608700265	REDTREE PROPERTIES	OPEN - SITE ASSESSMENT	819 BAY AVE	CAPITOLA	no
T0608700140	GOODYEAR TIRE AND RUBBER COMPA	COMPLETED - CASE CLOSED	3800 CAPITOLA RD	CAPITOLA	no
T0608742250	SHELL SERVICE STATION	OPEN - SITE ASSESSMENT	1649 41ST AVE	CAPITOLA	no
T0608700242	TOSCO - FACILITY #2452	OPEN - REMEDIATION	4860 SOQUEL DR	SOQUEL	no

Figure 5
Capture Zone Analysis
Site: Research Park Dr/Cory St

Maximum Well Pumping Rate (gpm), Q	800
Q (ft ³ /day)	154000
Hydraulic Conductivity (ft/day), K	23
Saturated Thickness (ft), b	130
Hydraulic Gradient (dimensionless), i	0.009
stagnation point, $x_0 = -Q / (2 * 3.1416 * Kbi)$	-911
half width of capture zone, $y_{max} = Q / (2Kbi)$	2861

y	$x = -y / [\tan(2 * 3.1416 * Kbi / Q)]$
2600	8810
2400	4325
2200	2477
2000	1443
1800	773
1600	301
1400	-47
1200	-311
1000	-512
800	-664
600	-775
400	-851
200	-896
100	-907
1	-911
-100	-907
-200	-896
-400	-851
-600	-775
-800	-664
-1000	-512
-1200	-311
-1400	-47
-1600	301
-1800	773
-2000	1443
-2200	2477
-2400	4325
-2600	8810

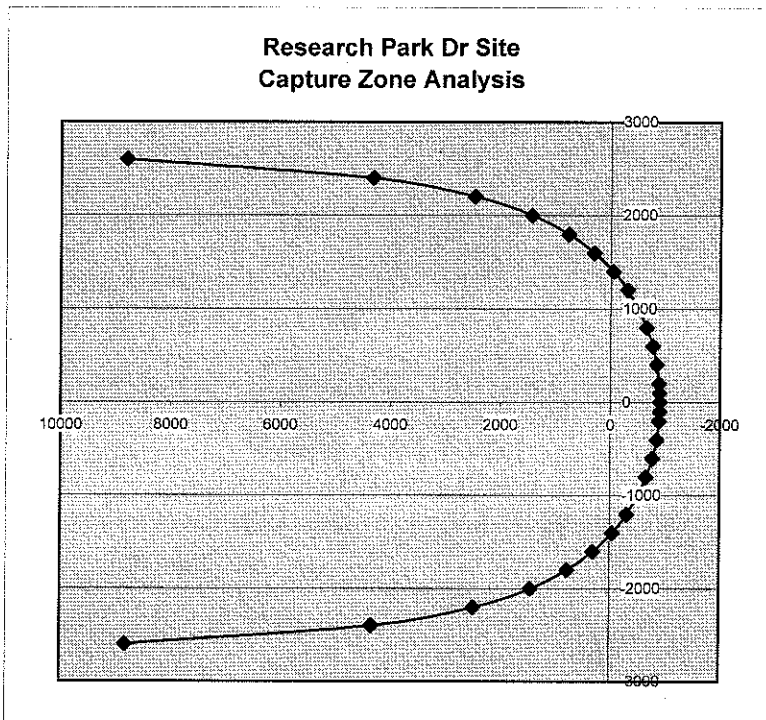



APPENDIX E – Water Quality Evaluation





MWH

LABORATORIES


A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory Report

for

City of Santa Cruz
Water Quality Laboratory
715 Graham Hill Road
Santa Cruz, CA 95060
Attention: Hugh Dalton
Fax: 831-420-5481

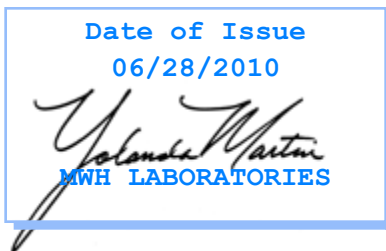

YOM: Yolanda.O.Martin
Project Manager



Report#: 335889
Project: SOURCE
Group: VOC & 525
PO#: 96-10035

Laboratory certifies that the test results meet all **NELAC** requirements unless noted in the Comments section or the Case Narrative. Following the cover page are Hits Reports, Comments, QC Summary, QC Report and Regulatory Forms. This report shall not be reproduced except in full, without the written approval of the laboratory.

Acknowledgement of Samples Received

City of Santa Cruz

715 Graham Hill Road
 Santa Cruz, CA 95060
 Attn: Hugh Dalton
 Phone: 831-420-5484

Customer Code: SANTACRUZ-CA

Group #: 335889

Project #: SOURCE

Sample Group: VOC & 525

Project Manager: Yolanda.O.Martin

Phone: 626-386-1104

PO #: 96-10035

The following samples were received from you on **June 11, 2010**. They have been scheduled for the tests listed below each sample. If this information is incorrect, please contact your service representative. Thank you for using MWH Laboratories.

Sample #	Sample Id	Sample Date
201006120044	Auto Plaza Deep MW_AP_DEEP @ML525	10-Jun-2010 0945
201006120045	Auto Plaza Medium MW_AP_MED @ML525	10-Jun-2010 1045
201006120046	Auto Plaza Shallow MW_AP_SHAL @ML525	10-Jun-2010 1100
201006120047	Cory Stree Shallow MW_CORY_SHAL @VOASDWA	10-Jun-2010 1135
201006120048	Travel Blank @VOASDWA TB	10-Jun-2010 0000

Test Description

@ML525 -- Semivolatiles by GCMS

@VOASDWA -- Volatile Organics by GCMS

@VOASDWA TB -- Volatile Organics by GCMS

335889

Blank



CHAIN OF CUSTODY RECORD

750 Royal Oaks Drive, Suite 100
Monrovia, California 91016-3629
Tel: 626 396 1100
Fax: 626 396 1101
1 800 566 LABS (1 800 566 5227)

MWH LABS USE ONLY:

LOGIN COMMENTS: _____

SAMPLES CHECKED AGAINST COC BY: JS

SAMPLES LOGGED IN BY: _____

SAMPLE TEMP WHEN REC'D AT LAB: 6/10/10 (Compliance: 4 +/- 2°C)

CONDITION OF BLUE ICE: FROZEN PARTIALLY FROZEN

THAWED _____ (check for yes)

TO BE COMPLETED BY SAMPLER:

COMPANY, UTILITY or PROJECT:
City of Santa Cruz Water Quality Laboratory

SYSTEM #: _____

P.O.# / PROJECT JOB #: 91-10035

MWH LABS CLIENT CODE: SANTACRUZ-CA

SAMPLER PRINTED NAME AND SIGNATURE: Lindsay Neun

TAT requested: rush by adv notice only
STD. X. 1 wk 3 day 2 day 1 day

SAMPLE DATE	SAMPLE TIME	STATION # or LOCATION	SITE NAME OR SAMPLE I.D.	MATRIX *	GRAB	COMP
6-10/10	945	Auto Plaza Deep	MW_AP_DEEP			
6-10/10	1045	Auto Plaza Medium	MW_AP_MED			
6-10/10	1100	Auto Plaza Shallow	MW_AP_SHAL			
6-10/10	1135	Cory Stree Shallow	MW_CORY_SHAL			

SEE ATTACHED BOTTLE ORDER FOR ANALYSES (check for yes), OR list ANALYSES REQUIRED (enter number of bottles sent for each test for each sample)

CRVI-LOW	ML 525	VOASDWA	SAMPLER COMMENTS
X	X	X	
X	X	X	
X	X	X	
X	X	X	

NON-COMPLIANCE SAMPLES (check for yes)
REGULATION INVOLVED: None (eg. SDWA, Phase V, NPDES, FDA...)

ROUTINE SPECIAL CONFIRMATION (check for yes)

City of Santa Cruz WATER & WASTE DEPARTMENT
715 GRAHAM HILL RD
SANTA CRUZ, CA 95060
Phone: 831 420-3480

* MATRIX TYPES: RSW = Raw Surface Water CFW = Chlorinated Finished Water CWW = Chlorinated Internal Billing Reference
RGW = Raw Ground Water FW = Other Finished Water WW = Other Waste

RELINQUISHED BY: Lindsay Neun SIGNATURE PRINT NAME
RECEIVED BY: Joc Sanchez DATE: 6/10/10 TIME: 1300
RELINQUISHED BY: _____
RECEIVED BY: _____

C-O-C# _____

NOTE: SHORT HOLD TIME ON CRVI-LOW



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

**Laboratory Comments
Report: #335889**

City of Santa Cruz
Water Quality Laboratory
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Flags Legend:

E6 - Concentration estimated. Internal standard recoveries did not meet method acceptance criteria.

L4 - The associated blank spike recovery was below method acceptance limits.

LK - The associated blank spike recovery was above method acceptance limits. This target analyte was not detected in the sample.

M2 - Matrix spike recovery was low; the associated blank spike recovery was acceptable.

MC - Matrix spike recovery was high; the associated blank spike recovery was acceptable. MS/MSD RPD met acceptance criteria.

R1 - RPD/RSD exceeded the method acceptance limit.

R6 - LFB/LFBD RPD exceeded the method acceptance limit. Recovery met acceptance criteria.

S6 - Surrogate recovery was below laboratory and method acceptance limits. Re-extraction and/or reanalysis confirms low recovery caused by matrix effect.



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
Hits Report: 335889

City of Santa Cruz
Water Quality Laboratory
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Analyzed	Analyte	Sample ID	Result	Federal MCL	Units	MRL
----------	---------	-----------	--------	----------------	-------	-----



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory Data
Report: 335889

City of Santa Cruz
Water Quality Laboratory
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
Auto Plaza Deep MW AP DEEP (201006120044)					Sampled on 06/10/2010 0945			
EPA 525.2 - Semivolatiles by GCMS								
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	2,4-Dinitrotoluene	ND (L4)	ug/L	0.1 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Acenaphthylene	ND	ug/L	0.1 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Alachlor	ND	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Aldrin	ND	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	alpha-Chlordane	ND	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Anthracene	ND	ug/L	0.02 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Atrazine	ND	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Benz(a)Anthracene	ND	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Benzo(a)pyrene	ND (E6,S6)	ug/L	0.02 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Benzo(b)Fluoranthene	ND (E6,S6)	ug/L	0.02 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Benzo(g,h,i)Perylene	ND (E6,S6)	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Benzo(k)Fluoranthene	ND (E6,S6)	ug/L	0.02 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Bromacil	ND (L4)	ug/L	0.2 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Butachlor	ND	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Butylbenzylphthalate	ND	ug/L	0.5 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Caffeine by method 525mod	ND (L4)	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Chrysene	ND (E6,S6)	ug/L	0.02 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Di(2-Ethylhexyl)phthalate	ND (E6,S6)	ug/L	0.6 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Di-(2-Ethylhexyl)adipate	ND	ug/L	0.6 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Di-n-Butylphthalate	ND	ug/L	1 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Diazinon (Qualitative)	ND	ug/L	0.1 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Dibenz(a,h)Anthracene	ND (E6,S6)	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Dieldrin	ND	ug/L	0.2 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Diethylphthalate	ND	ug/L	0.5 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Dimethoate	ND (L4)	ug/L	0.1 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Dimethylphthalate	ND	ug/L	0.5 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Endrin	ND	ug/L	0.2 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Fluoranthene	ND	ug/L	0.1 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Fluorene	ND	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	gamma-Chlordane	ND	ug/L	0.05 1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Heptachlor	ND	ug/L	0.03 1

Rounding on totals after summation.
(c) - indicates calculated results



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory Data
Report: 335889

City of Santa Cruz
Water Quality Laboratory
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Heptachlor Epoxide (isomer B)	ND	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Hexachlorobenzene	ND	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Hexachlorocyclopentadiene	ND	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Indeno(1,2,3,c,d)Pyrene	ND (E6,S6)	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Isophorone	ND	0.5	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Lindane	ND	0.04	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Methoxychlor	ND (E6,S6)	0.1	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Metolachlor	ND	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Metribuzin	ND (L4)	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Molinate	ND	0.1	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Pentachlorophenol	ND	1	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Phenanthrene	ND	0.04	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Propachlor	ND	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Pyrene	ND	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Simazine	ND	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Thiobencarb (ELAP)	ND	0.2	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	trans-Nonachlor	ND	0.05	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Trifluralin	ND	0.1	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	1,3-Dimethyl-2-nitrobenzene	100	%	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Acenaphthene-d10	75	%	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Chrysene-d12	30	%	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Perylene-d12	54	%	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Phenanthrene-d10	72	%	1
6/21/2010	06/24/2010	18:01	559437	(EPA 525.2)	Triphenylphosphate	114	%	1

Auto Plaza Medium MW AP MED (201006120045)

Sampled on 06/10/2010 1045

EPA 525.2 - Semivolatiles by GCMS

6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	2,4-Dinitrotoluene	ND (L4)	0.1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Acenaphthylene	ND	0.1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Alachlor	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Aldrin	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	alpha-Chlordane	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Anthracene	ND	0.02	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Atrazine	ND	0.05	1

Rounding on totals after summation.
(c) - indicates calculated results



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

**Laboratory Data
Report: 335889**

**City of Santa Cruz
Water Quality Laboratory**
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Benz(a)Anthracene	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Benzo(a)pyrene	ND	0.02	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Benzo(b)Fluoranthene	ND	0.02	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Benzo(g,h,i)Perylene	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Benzo(k)Fluoranthene	ND	0.02	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Bromacil	ND (L4)	0.2	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Butachlor	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Butylbenzylphthalate	ND	0.5	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Caffeine by method 525mod	ND (L4)	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Chrysene	ND	0.02	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Di(2-Ethylhexyl)phthalate	ND	0.6	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Di-(2-Ethylhexyl)adipate	ND (M2)	0.6	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Di-n-Butylphthalate	ND	1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Diazinon (Qualitative)	ND	0.1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Dibenz(a,h)Anthracene	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Dieldrin	ND	0.2	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Diethylphthalate	ND	0.5	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Dimethoate	ND (L4)	0.1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Dimethylphthalate	ND	0.5	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Endrin	ND	0.2	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Fluoranthene	ND	0.1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Fluorene	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	gamma-Chlordane	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Heptachlor	ND	0.03	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Heptachlor Epoxide (isomer B)	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Hexachlorobenzene	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Hexachlorocyclopentadiene	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Indeno(1,2,3,c,d)Pyrene	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Isophorone	ND	0.5	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Lindane	ND	0.04	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Methoxychlor	ND (MC)	0.1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Metolachlor	ND	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Metribuzin	ND (L4)	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Molinate	ND	0.1	1

Rounding on totals after summation.
(c) - indicates calculated results



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

**Laboratory Data
Report: 335889**

**City of Santa Cruz
Water Quality Laboratory**
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution	
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Pentachlorophenol	ND	ug/L	1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Phenanthrene	ND	ug/L	0.04	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Propachlor	ND	ug/L	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Pyrene	ND	ug/L	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Simazine	ND	ug/L	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Thiobencarb (ELAP)	ND	ug/L	0.2	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	trans-Nonachlor	ND	ug/L	0.05	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Trifluralin	ND	ug/L	0.1	1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	1,3-Dimethyl-2-nitrobenzene	99	%		1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Acenaphthene-d10	98	%		1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Chrysene-d12	69	%		1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Perylene-d12	95	%		1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Phenanthrene-d10	99	%		1
6/21/2010	06/25/2010	14:16	559438	(EPA 525.2)	Triphenylphosphate	111	%		1

Auto Plaza Shallow MW AP SHAL (201006120046)

Sampled on 06/10/2010 1100

EPA 525.2 - Semivolatiles by GCMS

6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	2,4-Dinitrotoluene	ND (L4)	ug/L	0.1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Acenaphthylene	ND	ug/L	0.1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Alachlor	ND	ug/L	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Aldrin	ND	ug/L	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	alpha-Chlordane	ND	ug/L	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Anthracene	ND	ug/L	0.02	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Atrazine	ND	ug/L	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Benz(a)Anthracene	ND	ug/L	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Benzo(a)pyrene	ND	ug/L	0.02	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Benzo(b)Fluoranthene	ND	ug/L	0.02	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Benzo(g,h,i)Perylene	ND	ug/L	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Benzo(k)Fluoranthene	ND	ug/L	0.02	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Bromacil	ND (L4)	ug/L	0.2	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Butachlor	ND	ug/L	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Butylbenzylphthalate	ND	ug/L	0.5	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Caffeine by method 525mod	ND (L4)	ug/L	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Chrysene	ND	ug/L	0.02	1



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

**Laboratory Data
Report: 335889**

**City of Santa Cruz
Water Quality Laboratory**
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Di(2-Ethylhexyl)phthalate	ND	0.6	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Di-(2-Ethylhexyl)adipate	ND	0.6	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Di-n-Butylphthalate	ND	1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Diazinon (Qualitative)	ND	0.1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Dibenz(a,h)Anthracene	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Dieldrin	ND	0.2	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Diethylphthalate	ND	0.5	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Dimethoate	ND (L4)	0.1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Dimethylphthalate	ND	0.5	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Endrin	ND	0.2	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Fluoranthene	ND	0.1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Fluorene	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	gamma-Chlordane	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Heptachlor	ND	0.03	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Heptachlor Epoxide (isomer B)	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Hexachlorobenzene	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Hexachlorocyclopentadiene	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Indeno(1,2,3,c,d)Pyrene	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Isophorone	ND	0.5	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Lindane	ND	0.04	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Methoxychlor	ND	0.1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Metolachlor	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Metribuzin	ND (L4)	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Molinate	ND	0.1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Pentachlorophenol	ND	1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Phenanthrene	ND	0.04	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Propachlor	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Pyrene	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Simazine	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Thiobencarb (ELAP)	ND	0.2	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	trans-Nonachlor	ND	0.05	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Trifluralin	ND	0.1	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	1,3-Dimethyl-2-nitrobenzene	100	%	1
6/21/2010	06/24/2010	18:49	559437	(EPA 525.2)	Acenaphthene-d10	97	%	1

Rounding on totals after summation.
(c) - indicates calculated results



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory Data
Report: 335889

City of Santa Cruz
Water Quality Laboratory
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
6/21/2010	06/24/2010	18:49	559437 (EPA 525.2)	Chrysene-d12	67	%		1
6/21/2010	06/24/2010	18:49	559437 (EPA 525.2)	Perylene-d12	95	%		1
6/21/2010	06/24/2010	18:49	559437 (EPA 525.2)	Phenanthrene-d10	96	%		1
6/21/2010	06/24/2010	18:49	559437 (EPA 525.2)	Triphenylphosphate	112	%		1

Cory Stree Shallow MW CORY SHAL (201006120047)

Sampled on 06/10/2010 1135

EPA 524.2 - Volatile Organics by GCMS

6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,1,1,2-Tetrachloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,1,1-Trichloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,1,2,2-Tetrachloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,1,2-Trichloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,1-Dichloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,1-Dichloroethylene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,1-Dichloropropene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,2,3-Trichlorobenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,2,3-Trichloropropane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,2,4-Trichlorobenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,2,4-Trimethylbenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,2-Dichloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,2-Dichloropropane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,3,5-Trimethylbenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,3-Dichloropropane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	2,2-Dichloropropane	ND (R6)	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	2-Butanone (MEK)	ND	ug/L	5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	4-Methyl-2-Pentanone (MIBK)	ND	ug/L	5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Benzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Bromobenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Bromochloromethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Bromodichloromethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Bromoethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Bromoform	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Bromomethane (Methyl Bromide)	ND (LK,R1)	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Carbon disulfide	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Carbon Tetrachloride	ND (R6)	ug/L	0.5	1



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

**Laboratory Data
Report: 335889**

**City of Santa Cruz
Water Quality Laboratory**
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Chlorobenzene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Chlorodibromomethane	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Chloroethane	ND (LK,R1)	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Chloroform (Trichloromethane)	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Chloromethane(Methyl Chloride)	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	cis-1,2-Dichloroethylene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	cis-1,3-Dichloropropene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Di-isopropyl ether	ND	3	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Dibromomethane	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Dichlorodifluoromethane	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Dichloromethane	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Ethyl benzene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Hexachlorobutadiene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Isopropylbenzene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	m,p-Xylenes	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	m-Dichlorobenzene (1,3-DCB)	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Methyl Tert-butyl ether (MTBE)	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	n-Butylbenzene	ND (R6)	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	n-Propylbenzene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Naphthalene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	o-Chlorotoluene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	o-Dichlorobenzene (1,2-DCB)	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	o-Xylene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	p-Chlorotoluene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	p-Dichlorobenzene (1,4-DCB)	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	p-Isopropyltoluene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	sec-Butylbenzene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Styrene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	tert-amyl Methyl Ether	ND	3	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	tert-Butyl Ethyl Ether	ND	3	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	tert-Butylbenzene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Tetrachloroethylene (PCE)	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Toluene	ND	0.5	1
6/15/2010	06/15/2010	19:51	558133	(EPA 524.2)	Total 1,3-Dichloropropene	ND	0.5	1

Rounding on totals after summation.
(c) - indicates calculated results



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

**Laboratory Data
Report: 335889**

**City of Santa Cruz
Water Quality Laboratory**
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Total THM	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Total xylenes	ND	ug/L	1	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	trans-1,2-Dichloroethylene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	trans-1,3-Dichloropropene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Trichloroethylene (TCE)	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Trichlorofluoromethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Trichlorotrifluoroethane(Freon 113)	ND	ug/L	0.5	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Vinyl chloride (VC)	ND	ug/L	0.3	1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	1,2-Dichloroethane-d4	115	%		1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	4-Bromofluorobenzene	100	%		1
6/15/2010	06/15/2010	19:51	558133 (EPA 524.2)	Toluene-d8	101	%		1

Travel Blank (201006120048)

Sampled on 06/10/2010 0000

EPA 524.2 - Volatile Organics by GCMS

6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,1,1,2-Tetrachloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,1,1-Trichloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,1,2,2-Tetrachloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,1,2-Trichloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,1-Dichloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,1-Dichloroethylene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,1-Dichloropropene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,2,3-Trichlorobenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,2,3-Trichloropropane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,2,4-Trichlorobenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,2,4-Trimethylbenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,2-Dichloroethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,2-Dichloropropane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,3,5-Trimethylbenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,3-Dichloropropane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	2,2-Dichloropropane	ND (R6)	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	2-Butanone (MEK)	ND	ug/L	5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	4-Methyl-2-Pentanone (MIBK)	ND	ug/L	5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Benzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Bromobenzene	ND	ug/L	0.5	1



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

**Laboratory Data
Report: 335889**

**City of Santa Cruz
Water Quality Laboratory**
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Bromochloromethane	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Bromodichloromethane	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Bromoethane	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Bromoform	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Bromomethane (Methyl Bromide)	ND (LK,R1)	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Carbon disulfide	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Carbon Tetrachloride	ND (R6)	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Chlorobenzene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Chlorodibromomethane	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Chloroethane	ND (LK,R1)	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Chloroform (Trichloromethane)	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Chloromethane(Methyl Chloride)	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	cis-1,2-Dichloroethylene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	cis-1,3-Dichloropropene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Di-isopropyl ether	ND	3	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Dibromomethane	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Dichlorodifluoromethane	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Dichloromethane	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Ethyl benzene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Hexachlorobutadiene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Isopropylbenzene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	m,p-Xylenes	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	m-Dichlorobenzene (1,3-DCB)	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Methyl Tert-butyl ether (MTBE)	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	n-Butylbenzene	ND (R6)	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	n-Propylbenzene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	Naphthalene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	o-Chlorotoluene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	o-Dichlorobenzene (1,2-DCB)	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	o-Xylene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	p-Chlorotoluene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	p-Dichlorobenzene (1,4-DCB)	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	p-Isopropyltoluene	ND	0.5	1
6/15/2010	06/15/2010	20:15	558133	(EPA 524.2)	sec-Butylbenzene	ND	0.5	1

Rounding on totals after summation.
(c) - indicates calculated results



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory Data
Report: 335889

City of Santa Cruz
Water Quality Laboratory
Hugh Dalton
715 Graham Hill Road
Santa Cruz, CA 95060

Samples Received on:
06/11/2010

Prepared	Analyzed	QC Ref #	Method	Analyte	Result	Units	MRL	Dilution
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Styrene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	tert-amyl Methyl Ether	ND	ug/L	3	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	tert-Butyl Ethyl Ether	ND	ug/L	3	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	tert-Butylbenzene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Tetrachloroethylene (PCE)	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Toluene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Total 1,3-Dichloropropene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Total THM	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Total xylenes	ND	ug/L	1	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	trans-1,2-Dichloroethylene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	trans-1,3-Dichloropropene	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Trichloroethylene (TCE)	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Trichlorofluoromethane	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Trichlorotrifluoroethane(Freon 113)	ND	ug/L	0.5	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Vinyl chloride (VC)	ND	ug/L	0.3	1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	1,2-Dichloroethane-d4	117	%		1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	4-Bromofluorobenzene	98	%		1
6/15/2010	06/15/2010	20:15	558133 (EPA 524.2)	Toluene-d8	99	%		1



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Summary: 335889

City of Santa Cruz

QC Ref # 558133 - Volatile Organics by GCMS

201006120047 Cory Stree Shallow MW_CORY_SHAL
201006120048 Travel Blank

Analysis Date: 06/15/2010

Analyzed by: MCB
Analyzed by: MCB

QC Ref # 559437 - Semivolatiles by GCMS

201006120044 Auto Plaza Deep MW_AP_DEEP
201006120044 Auto Plaza Deep MW_AP_DEEP
201006120046 Auto Plaza Shallow MW_AP_SHAL

Analysis Date: 06/24/2010

Analyzed by: JWC
Analyzed by: JWC
Analyzed by: JWC

QC Ref # 559438 - Semivolatiles by GCMS

201006120045 Auto Plaza Medium MW_AP_MED

Analysis Date: 06/25/2010

Analyzed by: JWC



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
QC Ref# 558133 - Volatile Organics by GCMS by EPA 524.2					Analysis Date: 06/15/2010				
LCS1	1,1,1,2-Tetrachloroethane		5.0	4.4	ug/L	88	(70-130)		
LCS2	1,1,1,2-Tetrachloroethane		5.0	3.94	ug/L	79	(70-130)	20	11
MBLK	1,1,1,2-Tetrachloroethane			<0.25	ug/L				
MRL_CHK	1,1,1,2-Tetrachloroethane		0.5	0.480	ug/L	96	(50-150)		
LCS1	1,1,1-Trichloroethane		5.0	5.54	ug/L	111	(70-130)		
LCS2	1,1,1-Trichloroethane		5.0	4.56	ug/L	91	(70-130)	20	19
MBLK	1,1,1-Trichloroethane			<0.25	ug/L				
MRL_CHK	1,1,1-Trichloroethane		0.5	0.580	ug/L	116	(50-150)		
LCS1	1,1,2,2-Tetrachloroethane		5.0	5.18	ug/L	104	(70-130)		
LCS2	1,1,2,2-Tetrachloroethane		5.0	4.85	ug/L	97	(70-130)	20	6.6
MBLK	1,1,2,2-Tetrachloroethane			<0.25	ug/L				
MRL_CHK	1,1,2,2-Tetrachloroethane		0.5	0.540	ug/L	108	(50-150)		
LCS1	1,1,2-Trichloroethane		5.0	5.14	ug/L	103	(70-130)		
LCS2	1,1,2-Trichloroethane		5.0	4.81	ug/L	96	(70-130)	20	6.6
MBLK	1,1,2-Trichloroethane			<0.25	ug/L				
MRL_CHK	1,1,2-Trichloroethane		0.5	0.540	ug/L	108	(50-150)		
LCS1	1,1-Dichloroethane		5.0	5.47	ug/L	109	(70-130)		
LCS2	1,1-Dichloroethane		5.0	4.85	ug/L	97	(70-130)	20	12
MBLK	1,1-Dichloroethane			<0.25	ug/L				
MRL_CHK	1,1-Dichloroethane		0.5	0.560	ug/L	112	(50-150)		
LCS1	1,1-Dichloroethylene		5.0	5.12	ug/L	102	(70-130)		
LCS2	1,1-Dichloroethylene		5.0	4.19	ug/L	84	(70-130)	20	20
MBLK	1,1-Dichloroethylene			<0.25	ug/L				
MRL_CHK	1,1-Dichloroethylene		0.5	0.560	ug/L	112	(50-150)		
LCS1	1,1-Dichloropropene		5.0	5.77	ug/L	115	(70-130)		
LCS2	1,1-Dichloropropene		5.0	4.92	ug/L	98	(70-130)	20	16
MBLK	1,1-Dichloropropene			<0.25	ug/L				
MRL_CHK	1,1-Dichloropropene		0.5	0.590	ug/L	118	(50-150)		
LCS1	1,2,3-Trichlorobenzene		5.0	5.31	ug/L	106	(70-130)		
LCS2	1,2,3-Trichlorobenzene		5.0	4.59	ug/L	92	(70-130)	20	15
MBLK	1,2,3-Trichlorobenzene			<0.25	ug/L				
MRL_CHK	1,2,3-Trichlorobenzene		0.5	0.560	ug/L	112	(50-150)		
LCS1	1,2,3-Trichloropropane		5.0	5.15	ug/L	103	(70-130)		
LCS2	1,2,3-Trichloropropane		5.0	4.9	ug/L	98	(70-130)	20	5.0
MBLK	1,2,3-Trichloropropane			<0.25	ug/L				
MRL_CHK	1,2,3-Trichloropropane		0.5	0.560	ug/L	112	(50-150)		
LCS1	1,2,4-Trichlorobenzene		5.0	5.26	ug/L	105	(70-130)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

17/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
LCS2	1,2,4-Trichlorobenzene		5.0	4.4	ug/L	88	(70-130)	20	18
MBLK	1,2,4-Trichlorobenzene			<0.25	ug/L				
MRL_CHK	1,2,4-Trichlorobenzene		0.5	0.530	ug/L	106	(50-150)		
LCS1	1,2,4-Trimethylbenzene		5.0	5.09	ug/L	102	(70-130)		
LCS2	1,2,4-Trimethylbenzene		5.0	4.57	ug/L	91	(70-130)	20	11
MBLK	1,2,4-Trimethylbenzene			<0.25	ug/L				
MRL_CHK	1,2,4-Trimethylbenzene		0.5	0.550	ug/L	110	(50-150)		
LCS1	1,2-Dichloroethane		5.0	5.67	ug/L	113	(70-130)		
LCS2	1,2-Dichloroethane		5.0	5.3	ug/L	106	(70-130)	20	6.8
MBLK	1,2-Dichloroethane			<0.25	ug/L				
MRL_CHK	1,2-Dichloroethane		0.5	0.590	ug/L	118	(50-150)		
LCS1	1,2-Dichloroethane-d4 (S)			115	%	115	(70-130)		
LCS2	1,2-Dichloroethane-d4 (S)			115	%	115	(70-130)		
MBLK	1,2-Dichloroethane-d4 (S)			111	%	111	(70-130)		
MRL_CHK	1,2-Dichloroethane-d4 (S)			119	%	119	(70-130)		
LCS1	1,2-Dichloropropane		5.0	5.18	ug/L	104	(70-130)		
LCS2	1,2-Dichloropropane		5.0	4.9	ug/L	98	(70-130)	20	5.6
MBLK	1,2-Dichloropropane			<0.25	ug/L				
MRL_CHK	1,2-Dichloropropane		0.5	0.600	ug/L	120	(50-150)		
LCS1	1,3,5-Trimethylbenzene		5.0	5.22	ug/L	104	(70-130)		
LCS2	1,3,5-Trimethylbenzene		5.0	4.44	ug/L	89	(70-130)	20	16
MBLK	1,3,5-Trimethylbenzene			<0.25	ug/L				
MRL_CHK	1,3,5-Trimethylbenzene		0.5	0.520	ug/L	104	(50-150)		
LCS1	1,3-Dichloropropane		5.0	5.44	ug/L	109	(70-130)		
LCS2	1,3-Dichloropropane		5.0	4.97	ug/L	99	(70-130)	20	9.0
MBLK	1,3-Dichloropropane			<0.25	ug/L				
MRL_CHK	1,3-Dichloropropane		0.5	0.540	ug/L	108	(50-150)		
LCS1	2,2-Dichloropropane		5.0	5.59	ug/L	112	(70-130)		
LCS2	2,2-Dichloropropane		5.0	4.49	ug/L	90	(70-130)	20	<u>22</u>
MBLK	2,2-Dichloropropane			<0.25	ug/L				
MRL_CHK	2,2-Dichloropropane		0.5	0.520	ug/L	104	(50-150)		
LCS1	2-Butanone (MEK)		50	46.2	ug/L	92	(70-130)		
LCS2	2-Butanone (MEK)		50	45.4	ug/L	91	(70-130)	20	1.3
MBLK	2-Butanone (MEK)			<2.5	ug/L				
MRL_CHK	2-Butanone (MEK)		5.0	5.52	ug/L	110	(50-150)		
LCS1	4-Bromofluorobenzene (S)			98.0	%	98	(70-130)		
LCS2	4-Bromofluorobenzene (S)			97.2	%	97	(70-130)		
MBLK	4-Bromofluorobenzene (S)			97.0	%	97	(70-130)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MRL_CHK	4-Bromofluorobenzene (S)			94.0	%	94	(70-130)		
LCS1	4-Methyl-2-Pentanone (MIBK)		50	45.4	ug/L	91	(70-130)		
LCS2	4-Methyl-2-Pentanone (MIBK)		50	43.4	ug/L	87	(70-130)	20	4.5
MBLK	4-Methyl-2-Pentanone (MIBK)			<2.5	ug/L				
MRL_CHK	4-Methyl-2-Pentanone (MIBK)		5.0	5.39	ug/L	108	(50-150)		
LCS1	Benzene		5.0	5.26	ug/L	105	(70-130)		
LCS2	Benzene		5.0	4.65	ug/L	93	(70-130)	20	12
MBLK	Benzene			<0.25	ug/L				
MRL_CHK	Benzene		0.5	0.590	ug/L	118	(50-150)		
LCS1	Bromobenzene		5.0	4.65	ug/L	93	(70-130)		
LCS2	Bromobenzene		5.0	4.18	ug/L	84	(70-130)	20	11
MBLK	Bromobenzene			<0.25	ug/L				
MRL_CHK	Bromobenzene		0.5	0.520	ug/L	104	(50-150)		
LCS1	Bromochloromethane		5.0	4.46	ug/L	89	(70-130)		
LCS2	Bromochloromethane		5.0	4.09	ug/L	82	(70-130)	20	8.7
MBLK	Bromochloromethane			<0.25	ug/L				
MRL_CHK	Bromochloromethane		0.5	0.420	ug/L	84	(50-150)		
LCS1	Bromodichloromethane		5.0	5.47	ug/L	109	(70-130)		
LCS2	Bromodichloromethane		5.0	4.77	ug/L	95	(70-130)	20	14
MBLK	Bromodichloromethane			<0.25	ug/L				
MRL_CHK	Bromodichloromethane		0.5	0.580	ug/L	116	(50-150)		
LCS1	Bromoethane		5.0	4.48	ug/L	90	(70-130)		
LCS2	Bromoethane		5.0	4.02	ug/L	80	(70-130)	20	11
MBLK	Bromoethane			<0.25	ug/L				
MRL_CHK	Bromoethane		0.5	0.530	ug/L	106	(50-150)		
LCS1	Bromoform		5.0	4.42	ug/L	88	(70-130)		
LCS2	Bromoform		5.0	4.13	ug/L	83	(70-130)	20	6.8
MBLK	Bromoform			<0.25	ug/L				
MRL_CHK	Bromoform		0.5	0.410	ug/L	82	(50-150)		
LCS1	Bromomethane (Methyl Bromide)		5.0	6.6	ug/L	<u>132</u>	(70-130)		
LCS2	Bromomethane (Methyl Bromide)		5.0	5.23	ug/L	105	(70-130)	20	<u>23</u>
MBLK	Bromomethane (Methyl Bromide)			<0.25	ug/L				
MRL_CHK	Bromomethane (Methyl Bromide)		0.5	0.720	ug/L	144	(50-150)		
LCS1	Carbon disulfide		5.0	4.64	ug/L	93	(70-130)		
LCS2	Carbon disulfide		5.0	3.88	ug/L	78	(70-130)	20	18
MBLK	Carbon disulfide			<0.25	ug/L				
MRL_CHK	Carbon disulfide		0.5	0.550	ug/L	110	(50-150)		
LCS1	Carbon Tetrachloride		5.0	5.17	ug/L	103	(70-130)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz (continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
LCS2	Carbon Tetrachloride		5.0	4.19	ug/L	84	(70-130)	20	<u>21</u>
MBLK	Carbon Tetrachloride			<0.25	ug/L				
MRL_CHK	Carbon Tetrachloride		0.5	0.500	ug/L	100	(50-150)		
LCS1	Chlorobenzene		5.0	4.84	ug/L	97	(70-130)		
LCS2	Chlorobenzene		5.0	4.43	ug/L	89	(70-130)	20	8.8
MBLK	Chlorobenzene			<0.25	ug/L				
MRL_CHK	Chlorobenzene		0.5	0.510	ug/L	102	(50-150)		
LCS1	Chlorodibromomethane		5.0	4.5	ug/L	90	(70-130)		
LCS2	Chlorodibromomethane		5.0	3.95	ug/L	79	(70-130)	20	13
MBLK	Chlorodibromomethane			<0.25	ug/L				
MRL_CHK	Chlorodibromomethane		0.5	0.400	ug/L	80	(50-150)		
LCS1	Chloroethane		5.0	6.63	ug/L	<u>133</u>	(70-130)		
LCS2	Chloroethane		5.0	4.83	ug/L	97	(70-130)	20	<u>31</u>
MBLK	Chloroethane			<0.25	ug/L				
MRL_CHK	Chloroethane		0.5	0.600	ug/L	120	(50-150)		
LCS1	Chloroform (Trichloromethane)		5.0	5.58	ug/L	112	(70-130)		
LCS2	Chloroform (Trichloromethane)		5.0	4.87	ug/L	97	(70-130)	20	14
MBLK	Chloroform (Trichloromethane)			<0.25	ug/L				
MRL_CHK	Chloroform (Trichloromethane)		0.5	0.610	ug/L	122	(50-150)		
LCS1	Chloromethane(Methyl Chloride)		5.0	5.14	ug/L	103	(70-130)		
LCS2	Chloromethane(Methyl Chloride)		5.0	4.84	ug/L	97	(70-130)	20	6.0
MBLK	Chloromethane(Methyl Chloride)			<0.25	ug/L				
MRL_CHK	Chloromethane(Methyl Chloride)		0.5	0.670	ug/L	134	(50-150)		
LCS1	cis-1,2-Dichloroethylene		5.0	5.18	ug/L	104	(70-130)		
LCS2	cis-1,2-Dichloroethylene		5.0	4.66	ug/L	93	(70-130)	20	11
MBLK	cis-1,2-Dichloroethylene			<0.25	ug/L				
MRL_CHK	cis-1,2-Dichloroethylene		0.5	0.520	ug/L	104	(50-150)		
LCS1	cis-1,3-Dichloropropene		5.0	5.37	ug/L	107	(70-130)		
LCS2	cis-1,3-Dichloropropene		5.0	5.02	ug/L	100	(70-130)	20	6.7
MBLK	cis-1,3-Dichloropropene			<0.25	ug/L				
MRL_CHK	cis-1,3-Dichloropropene		0.5	0.540	ug/L	108	(50-150)		
LCS1	Di-isopropyl ether		5.0	4.57	ug/L	91	(70-130)		
LCS2	Di-isopropyl ether		5.0	4.13	ug/L	83	(70-130)	20	10
MBLK	Di-isopropyl ether			<1.5	ug/L				
MRL_CHK	Di-isopropyl ether		0.5	0.490	ug/L	98	(50-150)		
LCS1	Dibromomethane		5.0	5.29	ug/L	106	(70-130)		
LCS2	Dibromomethane		5.0	4.75	ug/L	95	(70-130)	20	11
MBLK	Dibromomethane			<0.25	ug/L				

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

20/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MRL_CHK	Dibromomethane		0.5	0.540	ug/L	108	(50-150)		
LCS1	Dichlorodifluoromethane		5.0	3.63	ug/L	73	(70-130)		
LCS2	Dichlorodifluoromethane		5.0	3.68	ug/L	74	(70-130)	20	1.4
MBLK	Dichlorodifluoromethane			<0.25	ug/L				
MRL_CHK	Dichlorodifluoromethane		0.5	0.510	ug/L	102	(50-150)		
LCS1	Dichloromethane		5.0	4.91	ug/L	98	(70-130)		
LCS2	Dichloromethane		5.0	4.49	ug/L	90	(70-130)	20	8.9
MBLK	Dichloromethane			<0.25	ug/L				
MRL_CHK	Dichloromethane		0.5	0.570	ug/L	114	(50-150)		
LCS1	Ethyl benzene		5.0	5.21	ug/L	104	(70-130)		
LCS2	Ethyl benzene		5.0	4.63	ug/L	93	(70-130)	20	12
MBLK	Ethyl benzene			<0.25	ug/L				
MRL_CHK	Ethyl benzene		0.5	0.570	ug/L	114	(50-150)		
LCS1	Hexachlorobutadiene		5.0	4.74	ug/L	95	(70-130)		
LCS2	Hexachlorobutadiene		5.0	4.00	ug/L	80	(70-130)	20	17
MBLK	Hexachlorobutadiene			<0.25	ug/L				
MRL_CHK	Hexachlorobutadiene		0.5	0.580	ug/L	116	(50-150)		
LCS1	Isopropylbenzene		5.0	5.08	ug/L	102	(70-130)		
LCS2	Isopropylbenzene		5.0	4.33	ug/L	87	(70-130)	20	16
MBLK	Isopropylbenzene			<0.25	ug/L				
MRL_CHK	Isopropylbenzene		0.5	0.560	ug/L	112	(50-150)		
LCS1	m,p-Xylenes		10	10.1	ug/L	101	(70-130)		
LCS2	m,p-Xylenes		10	8.77	ug/L	88	(70-130)	20	14
MBLK	m,p-Xylenes			<0.25	ug/L				
MRL_CHK	m,p-Xylenes		1.0	1.05	ug/L	105	(50-150)		
LCS1	m-Dichlorobenzene (1,3-DCB)		5.0	4.56	ug/L	91	(70-130)		
LCS2	m-Dichlorobenzene (1,3-DCB)		5.0	4.12	ug/L	82	(70-130)	20	10
MBLK	m-Dichlorobenzene (1,3-DCB)			<0.25	ug/L				
MRL_CHK	m-Dichlorobenzene (1,3-DCB)		0.5	0.470	ug/L	94	(50-150)		
LCS1	Methyl Tert-butyl ether (MTBE)		5.0	4.86	ug/L	97	(70-130)		
LCS2	Methyl Tert-butyl ether (MTBE)		5.0	4.63	ug/L	93	(70-130)	20	4.8
MBLK	Methyl Tert-butyl ether (MTBE)			<0.25	ug/L				
MRL_CHK	Methyl Tert-butyl ether (MTBE)		0.5	0.530	ug/L	106	(50-150)		
LCS1	n-Butylbenzene		5.0	6.21	ug/L	124	(70-130)		
LCS2	n-Butylbenzene		5.0	5.04	ug/L	101	(70-130)	20	<u>21</u>
MBLK	n-Butylbenzene			<0.25	ug/L				
MRL_CHK	n-Butylbenzene		0.5	0.660	ug/L	132	(50-150)		
LCS1	n-Propylbenzene		5.0	5.13	ug/L	103	(70-130)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

21/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
LCS2	n-Propylbenzene		5.0	4.34	ug/L	87	(70-130)	20	17
MBLK	n-Propylbenzene			<0.25	ug/L				
MRL_CHK	n-Propylbenzene		0.5	0.540	ug/L	108	(50-150)		
LCS1	Naphthalene		5.0	5.81	ug/L	116	(70-130)		
LCS2	Naphthalene		5.0	4.92	ug/L	98	(70-130)	20	17
MBLK	Naphthalene			<0.25	ug/L				
MRL_CHK	Naphthalene		0.5	0.730	ug/L	146	(50-150)		
LCS1	o-Chlorotoluene		5.0	4.72	ug/L	94	(70-130)		
LCS2	o-Chlorotoluene		5.0	4.28	ug/L	86	(70-130)	20	9.8
MBLK	o-Chlorotoluene			<0.25	ug/L				
MRL_CHK	o-Chlorotoluene		0.5	0.490	ug/L	98	(50-150)		
LCS1	o-Dichlorobenzene (1,2-DCB)		5.0	4.74	ug/L	95	(70-130)		
LCS2	o-Dichlorobenzene (1,2-DCB)		5.0	4.33	ug/L	87	(70-130)	20	9.0
MBLK	o-Dichlorobenzene (1,2-DCB)			<0.25	ug/L				
MRL_CHK	o-Dichlorobenzene (1,2-DCB)		0.5	0.550	ug/L	110	(50-150)		
LCS1	o-Xylene		5.0	4.91	ug/L	98	(70-130)		
LCS2	o-Xylene		5.0	4.34	ug/L	87	(70-130)	20	12
MBLK	o-Xylene			<0.25	ug/L				
MRL_CHK	o-Xylene		0.5	0.490	ug/L	98	(50-150)		
LCS1	p-Chlorotoluene		5.0	4.8	ug/L	96	(70-130)		
LCS2	p-Chlorotoluene		5.0	4.1	ug/L	82	(70-130)	20	16
MBLK	p-Chlorotoluene			<0.25	ug/L				
MRL_CHK	p-Chlorotoluene		0.5	0.490	ug/L	98	(50-150)		
LCS1	p-Dichlorobenzene (1,4-DCB)		5.0	4.38	ug/L	88	(70-130)		
LCS2	p-Dichlorobenzene (1,4-DCB)		5.0	4.14	ug/L	83	(70-130)	20	5.6
MBLK	p-Dichlorobenzene (1,4-DCB)			<0.25	ug/L				
MRL_CHK	p-Dichlorobenzene (1,4-DCB)		0.5	0.510	ug/L	102	(50-150)		
LCS1	p-Isopropyltoluene		5.0	5.28	ug/L	106	(70-130)		
LCS2	p-Isopropyltoluene		5.0	4.47	ug/L	89	(70-130)	20	17
MBLK	p-Isopropyltoluene			<0.25	ug/L				
MRL_CHK	p-Isopropyltoluene		0.5	0.520	ug/L	104	(50-150)		
LCS1	sec-Butylbenzene		5.0	5.49	ug/L	110	(70-130)		
LCS2	sec-Butylbenzene		5.0	4.52	ug/L	90	(70-130)	20	19
MBLK	sec-Butylbenzene			<0.25	ug/L				
MRL_CHK	sec-Butylbenzene		0.5	0.590	ug/L	118	(50-150)		
LCS1	Styrene		5.0	4.84	ug/L	97	(70-130)		
LCS2	Styrene		5.0	4.46	ug/L	89	(70-130)	20	8.2
MBLK	Styrene			<0.25	ug/L				

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

22/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MRL_CHK	Styrene		0.5	0.480	ug/L	96	(50-150)		
LCS1	tert-amyl Methyl Ether		5.0	4.83	ug/L	97	(70-130)		
LCS2	tert-amyl Methyl Ether		5.0	4.43	ug/L	89	(70-130)	20	8.6
MBLK	tert-amyl Methyl Ether			<1.5	ug/L				
MRL_CHK	tert-amyl Methyl Ether		0.5	0.560	ug/L	112	(50-150)		
LCS1	tert-Butyl Ethyl Ether		5.0	4.75	ug/L	95	(70-130)		
LCS2	tert-Butyl Ethyl Ether		5.0	4.28	ug/L	86	(70-130)	20	10
MBLK	tert-Butyl Ethyl Ether			<1.5	ug/L				
MRL_CHK	tert-Butyl Ethyl Ether		0.5	0.520	ug/L	104	(50-150)		
LCS1	tert-Butylbenzene		5.0	5.12	ug/L	102	(70-130)		
LCS2	tert-Butylbenzene		5.0	4.37	ug/L	87	(70-130)	20	16
MBLK	tert-Butylbenzene			<0.25	ug/L				
MRL_CHK	tert-Butylbenzene		0.5	0.550	ug/L	110	(50-150)		
LCS1	Tetrachloroethylene (PCE)		5.0	4.88	ug/L	98	(70-130)		
LCS2	Tetrachloroethylene (PCE)		5.0	4.14	ug/L	83	(70-130)	20	16
MBLK	Tetrachloroethylene (PCE)			<0.25	ug/L				
MRL_CHK	Tetrachloroethylene (PCE)		0.5	0.480	ug/L	96	(50-150)		
LCS1	Toluene		5.0	5.11	ug/L	102	(70-130)		
LCS2	Toluene		5.0	4.55	ug/L	91	(70-130)	20	12
MBLK	Toluene			<0.25	ug/L				
MRL_CHK	Toluene		0.5	0.560	ug/L	112	(50-150)		
LCS1	Toluene-d8 (S)			101	%	101	(70-130)		
LCS2	Toluene-d8 (S)			102	%	102	(70-130)		
MBLK	Toluene-d8 (S)			99.4	%	99	(70-130)		
MRL_CHK	Toluene-d8 (S)			103	%	103	(70-130)		
LCS1	trans-1,2-Dichloroethylene		5.0	5.14	ug/L	103	(70-130)		
LCS2	trans-1,2-Dichloroethylene		5.0	4.32	ug/L	86	(70-130)	20	17
MBLK	trans-1,2-Dichloroethylene			<0.25	ug/L				
MRL_CHK	trans-1,2-Dichloroethylene		0.5	0.580	ug/L	116	(50-150)		
LCS1	trans-1,3-Dichloropropene		5.0	5.14	ug/L	103	(70-130)		
LCS2	trans-1,3-Dichloropropene		5.0	4.57	ug/L	91	(70-130)	20	12
MBLK	trans-1,3-Dichloropropene			<0.25	ug/L				
MRL_CHK	trans-1,3-Dichloropropene		0.5	0.460	ug/L	92	(50-150)		
LCS1	Trichloroethylene (TCE)		5.0	4.61	ug/L	92	(70-130)		
LCS2	Trichloroethylene (TCE)		5.0	4.02	ug/L	80	(70-130)	20	14
MBLK	Trichloroethylene (TCE)			<0.25	ug/L				
MRL_CHK	Trichloroethylene (TCE)		0.5	0.500	ug/L	100	(50-150)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
LCS1	Trichlorofluoromethane		5.0	5.22	ug/L	104	(70-130)		
LCS2	Trichlorofluoromethane		5.0	4.91	ug/L	98	(70-130)	20	6.1
MBLK	Trichlorofluoromethane			<0.25	ug/L				
MRL_CHK	Trichlorofluoromethane		0.5	0.530	ug/L	106	(50-150)		
LCS1	Trichlorotrifluoroethane(Freon		5.0	5.09	ug/L	102	(70-130)		
LCS2	Trichlorotrifluoroethane(Freon		5.0	4.97	ug/L	99	(70-130)	20	2.4
MBLK	Trichlorotrifluoroethane(Freon			<0.25	ug/L				
MRL_CHK	Trichlorotrifluoroethane(Freon		0.5	0.520	ug/L	104	(50-150)		
LCS1	Vinyl chloride (VC)		5.0	5.69	ug/L	114	(70-130)		
LCS2	Vinyl chloride (VC)		5.0	5.56	ug/L	111	(70-130)	20	2.3
MBLK	Vinyl chloride (VC)			<0.15	ug/L				
MRL_CHK	Vinyl chloride (VC)		0.5	0.740	ug/L	148	(50-150)		

QC Ref# 559437 - Semivolatiles by GCMS by EPA 525.2

Analysis Date: 06/24/2010

LCS1	1,3-Dimethyl-2-nitrobenzene (S)			99.4	%	99	(70-130)		
LCS2	1,3-Dimethyl-2-nitrobenzene (S)			93.5	%	94	(70-130)		
MBLK	1,3-Dimethyl-2-nitrobenzene (S)			99.5	%	100	(70-130)		
MRL_CHK	1,3-Dimethyl-2-nitrobenzene (S)			101	%	101	(70-130)		
MS_201006120045	1,3-Dimethyl-2-nitrobenzene (S)			97.7	%	98	(70-130)		
LCS1	2,4-Dinitrotoluene		2.0	1.2	ug/L	<u>60</u>	(70-130)		
LCS2	2,4-Dinitrotoluene		2.0	1.25	ug/L	<u>62</u>	(70-130)	20	4.1
MBLK	2,4-Dinitrotoluene			<0.05	ug/L				
MRL_CHK	2,4-Dinitrotoluene		0.1	0.113	ug/L	113	(50-150)		
MS_201006120045	2,4-Dinitrotoluene	ND	2.0	1.52	ug/L	76	(70-130)		
LCS1	2,6-Dinitrotoluene		2.0	1.34	ug/L	<u>67</u>	(70-130)		
LCS2	2,6-Dinitrotoluene		2.0	1.3	ug/L	<u>65</u>	(70-130)	20	2.3
MBLK	2,6-Dinitrotoluene			<0.05	ug/L				
MRL_CHK	2,6-Dinitrotoluene		0.1	0.0920	ug/L	92	(50-150)		
MS_201006120045	2,6-Dinitrotoluene		2.0	1.65	ug/L	83	(70-130)		
LCS1	4,4-DDD		2.0	1.94	ug/L	97	(70-130)		
LCS2	4,4-DDD		2.0	1.94	ug/L	97	(70-130)	20	0.0
MBLK	4,4-DDD			<0.05	ug/L				
MRL_CHK	4,4-DDD		0.1	0.0940	ug/L	94	(50-150)		
MS_201006120045	4,4-DDD		2.0	1.85	ug/L	93	(70-130)		
LCS1	4,4-DDE		2.0	1.85	ug/L	93	(70-130)		
LCS2	4,4-DDE		2.0	1.87	ug/L	93	(70-130)	20	1.1
MBLK	4,4-DDE			<0.05	ug/L				
MRL_CHK	4,4-DDE		0.1	0.0910	ug/L	91	(50-150)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

24/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MS_201006120045	4,4-DDE		2.0	1.57	ug/L	78	(70-130)		
LCS1	4,4-DDT		2.0	1.86	ug/L	93	(70-130)		
LCS2	4,4-DDT		2.0	1.84	ug/L	92	(70-130)	20	1.1
MBLK	4,4-DDT			<0.05	ug/L				
MRL_CHK	4,4-DDT		0.1	0.120	ug/L	120	(50-150)		
MS_201006120045	4,4-DDT		2.0	1.55	ug/L	77	(70-130)		
LCS1	Acenaphthene		2.0	1.83	ug/L	91	(70-130)		
LCS2	Acenaphthene		2.0	1.81	ug/L	91	(70-130)	20	1.1
MBLK	Acenaphthene			<0.05	ug/L				
MRL_CHK	Acenaphthene		0.1	0.0980	ug/L	98	(50-150)		
MS_201006120045	Acenaphthene		2.0	1.83	ug/L	92	(70-130)		
LCS1	Acenaphthene-d10 (I)			87.6	%	88	(50-150)		
LCS2	Acenaphthene-d10 (I)			83.1	%	83	(50-150)		
MBLK	Acenaphthene-d10 (I)			96.5	%	97	(50-150)		
MRL_CHK	Acenaphthene-d10 (I)			94.4	%	94	(50-150)		
MS_201006120045	Acenaphthene-d10 (I)			78.2	%	78	(50-150)		
LCS1	Acenaphthylene		2.0	1.8	ug/L	90	(70-130)		
LCS2	Acenaphthylene		2.0	1.81	ug/L	91	(70-130)	20	0.55
MBLK	Acenaphthylene			<0.05	ug/L				
MRL_CHK	Acenaphthylene		0.1	0.0900	ug/L	90	(50-150)		
MS_201006120045	Acenaphthylene	ND	2.0	1.9	ug/L	95	(70-130)		
LCS1	Acetochlor		2.0	1.94	ug/L	97	(70-130)		
LCS2	Acetochlor		2.0	2.06	ug/L	103	(70-130)	20	6.0
MBLK	Acetochlor			<0.05	ug/L				
MRL_CHK	Acetochlor		0.05	0.0570	ug/L	114	(50-150)		
MS_201006120045	Acetochlor		2.0	2.14	ug/L	107	(70-130)		
LCS1	Alachlor		2.0	2.02	ug/L	101	(70-130)		
LCS2	Alachlor		2.0	2.00	ug/L	100	(70-130)	20	1
MBLK	Alachlor			<0.025	ug/L				
MRL_CHK	Alachlor		0.05	0.0730	ug/L	146	(50-150)		
MS_201006120045	Alachlor	ND	2.0	2.1	ug/L	105	(70-130)		
LCS1	Aldrin		2.0	1.42	ug/L	71	(70-130)		
LCS2	Aldrin		2.0	1.45	ug/L	73	(70-130)	20	2.1
MBLK	Aldrin			<0.025	ug/L				
MRL_CHK	Aldrin		0.05	0.0470	ug/L	94	(50-150)		
MS_201006120045	Aldrin	ND	2.0	1.66	ug/L	83	(70-130)		
LCS1	Alpha-BHC		2.0	1.93	ug/L	97	(70-130)		
LCS2	Alpha-BHC		2.0	1.94	ug/L	97	(70-130)	20	0.52

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

25/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MBLK	Alpha-BHC			<0.05	ug/L				
MRL_CHK	Alpha-BHC		0.1	0.0990	ug/L	99	(50-150)		
MS_201006120045	Alpha-BHC		2.0	2.01	ug/L	100	(70-130)		
LCS1	alpha-Chlordane		2.0	2.01	ug/L	100	(70-130)		
LCS2	alpha-Chlordane		2.0	1.87	ug/L	94	(70-130)	20	7.2
MBLK	alpha-Chlordane			<0.025	ug/L				
MRL_CHK	alpha-Chlordane		0.05	0.0510	ug/L	102	(50-150)		
MS_201006120045	alpha-Chlordane	ND	2.0	2.01	ug/L	100	(70-130)		
LCS1	Anthracene		2.0	1.81	ug/L	91	(70-130)		
LCS2	Anthracene		2.0	1.77	ug/L	89	(70-130)	20	1.7
MBLK	Anthracene			<0.01	ug/L				
MRL_CHK	Anthracene		0.02	0.0200	ug/L	100	(50-150)		
MS_201006120045	Anthracene	ND	2.0	1.87	ug/L	94	(70-130)		
LCS1	Atrazine		2.0	2.02	ug/L	101	(70-130)		
LCS2	Atrazine		2.0	2.03	ug/L	102	(70-130)	20	0.49
MBLK	Atrazine			<0.025	ug/L				
MRL_CHK	Atrazine		0.05	0.0530	ug/L	106	(50-150)		
MS_201006120045	Atrazine	ND	2.0	2.00	ug/L	100	(70-130)		
LCS1	Benz(a)Anthracene		2.0	1.86	ug/L	93	(70-130)		
LCS2	Benz(a)Anthracene		2.0	1.87	ug/L	93	(70-130)	20	0.54
MBLK	Benz(a)Anthracene			<0.025	ug/L				
MRL_CHK	Benz(a)Anthracene		0.05	0.0510	ug/L	102	(50-150)		
MS_201006120045	Benz(a)Anthracene	ND	2.0	1.62	ug/L	81	(70-130)		
LCS1	Benzo(a)pyrene		2.0	1.94	ug/L	97	(70-130)		
LCS2	Benzo(a)pyrene		2.0	1.94	ug/L	97	(70-130)	20	0.0
MBLK	Benzo(a)pyrene			<0.01	ug/L				
MRL_CHK	Benzo(a)pyrene		0.02	0.0220	ug/L	110	(50-150)		
MS_201006120045	Benzo(a)pyrene	ND	2.0	2.05	ug/L	103	(70-130)		
LCS1	Benzo(b)Fluoranthene		2.0	1.91	ug/L	95	(70-130)		
LCS2	Benzo(b)Fluoranthene		2.0	1.92	ug/L	96	(70-130)	20	0.52
MBLK	Benzo(b)Fluoranthene			<0.01	ug/L				
MRL_CHK	Benzo(b)Fluoranthene		0.02	0.0250	ug/L	125	(50-150)		
MS_201006120045	Benzo(b)Fluoranthene	ND	2.0	2.09	ug/L	105	(70-130)		
LCS1	Benzo(g,h,i)Perylene		2.0	1.88	ug/L	94	(70-130)		
LCS2	Benzo(g,h,i)Perylene		2.0	1.87	ug/L	94	(70-130)	20	0.53
MBLK	Benzo(g,h,i)Perylene			<0.025	ug/L				
MRL_CHK	Benzo(g,h,i)Perylene		0.05	0.0590	ug/L	118	(50-150)		
MS_201006120045	Benzo(g,h,i)Perylene	ND	2.0	1.78	ug/L	89	(70-130)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

26/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
LCS1	Benzo(k)Fluoranthene		2.0	2.02	ug/L	101	(70-130)		
LCS2	Benzo(k)Fluoranthene		2.0	1.92	ug/L	96	(70-130)	20	5.1
MBLK	Benzo(k)Fluoranthene			<0.01	ug/L				
MRL_CHK	Benzo(k)Fluoranthene		0.02	0.0270	ug/L	135	(50-150)		
MS_201006120045	Benzo(k)Fluoranthene	ND	2.0	2.07	ug/L	104	(70-130)		
LCS1	Beta-BHC		2.0	1.93	ug/L	97	(70-130)		
LCS2	Beta-BHC		2.0	1.91	ug/L	95	(70-130)	20	1.0
MBLK	Beta-BHC			<0.05	ug/L				
MRL_CHK	Beta-BHC		0.1	0.102	ug/L	102	(50-150)		
MS_201006120045	Beta-BHC		2.0	1.93	ug/L	97	(70-130)		
LCS1	Bromacil		2.0	1.39	ug/L	70	(70-130)		
LCS2	Bromacil		2.0	1.44	ug/L	72	(70-130)	20	3.5
MBLK	Bromacil			<0.05	ug/L				
MRL_CHK	Bromacil		0.1	0.148	ug/L	148	(50-150)		
MS_201006120045	Bromacil	ND	2.0	1.77	ug/L	88	(70-130)		
LCS1	Butachlor		2.0	2.05	ug/L	102	(70-130)		
LCS2	Butachlor		2.0	1.99	ug/L	99	(70-130)	20	3.0
MBLK	Butachlor			<0.025	ug/L				
MRL_CHK	Butachlor		0.05	0.0460	ug/L	92	(50-150)		
MS_201006120045	Butachlor	ND	2.0	2.13	ug/L	107	(70-130)		
LCS1	Butylbenzylphthalate		2.0	2.06	ug/L	103	(70-130)		
LCS2	Butylbenzylphthalate		2.0	2.1	ug/L	105	(70-130)	20	1.9
MBLK	Butylbenzylphthalate			<0.15	ug/L				
MRL_CHK	Butylbenzylphthalate		0.15	0.177	ug/L	118	(50-150)		
MS_201006120045	Butylbenzylphthalate	ND	2.0	2.06	ug/L	103	(70-130)		
LCS1	Caffeine by method 525mod		2.0	0.805	ug/L	<u>40</u>	(45-137)		
LCS2	Caffeine by method 525mod		2.0	0.790	ug/L	<u>40</u>	(45-137)	20	1.9
MBLK	Caffeine by method 525mod			<0.01	ug/L				
MRL_CHK	Caffeine by method 525mod		0.05	0.0510	ug/L	102	(50-150)		
MS_201006120045	Caffeine by method 525mod	ND	2.0	1.28	ug/L	64	(46-144)		
LCS1	Chlorobenzilate		2.0	1.94	ug/L	97	(70-130)		
LCS2	Chlorobenzilate		2.0	1.99	ug/L	99	(70-130)	20	2.5
MBLK	Chlorobenzilate			<0.05	ug/L				
MRL_CHK	Chlorobenzilate		0.1	0.107	ug/L	107	(50-150)		
MS_201006120045	Chlorobenzilate		2.0	2.05	ug/L	102	(70-130)		
LCS1	Chloroneb		2.0	1.91	ug/L	96	(70-130)		
LCS2	Chloroneb		2.0	1.91	ug/L	96	(70-130)	20	0.0
MBLK	Chloroneb			<0.05	ug/L				

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

27/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz (continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MRL_CHK	Chloroneb		0.1	0.109	ug/L	109	(50-150)		
MS_201006120045	Chloroneb		2.0	1.93	ug/L	96	(70-130)		
LCS1	Chlorothalonil(Draconil,Bravo)		2.0	1.9	ug/L	95	(70-130)		
LCS2	Chlorothalonil(Draconil,Bravo)		2.0	1.88	ug/L	94	(70-130)	20	1.1
MBLK	Chlorothalonil(Draconil,Bravo)			<0.05	ug/L				
MRL_CHK	Chlorothalonil(Draconil,Bravo)		0.05	0.0580	ug/L	116	(50-150)		
MS_201006120045	Chlorothalonil(Draconil,Bravo)		2.0	1.93	ug/L	97	(70-130)		
LCS1	Chlorpyrifos (Dursban)		2.0	1.99	ug/L	99	(70-130)		
LCS2	Chlorpyrifos (Dursban)		2.0	1.92	ug/L	96	(70-130)	20	3.6
MBLK	Chlorpyrifos (Dursban)			<0.025	ug/L				
MRL_CHK	Chlorpyrifos (Dursban)		0.05	0.0500	ug/L	100	(50-150)		
MS_201006120045	Chlorpyrifos (Dursban)		2.0	2.01	ug/L	101	(70-130)		
LCS1	Chrysene		2.0	1.9	ug/L	95	(70-130)		
LCS2	Chrysene		2.0	1.81	ug/L	91	(70-130)	20	4.8
MBLK	Chrysene			<0.01	ug/L				
MRL_CHK	Chrysene		0.02	0.0260	ug/L	130	(50-150)		
MS_201006120045	Chrysene	ND	2.0	2.04	ug/L	102	(70-130)		
LCS1	Chrysene-d12 (I)			87.2	%	87	(50-150)		
LCS2	Chrysene-d12 (I)			87.5	%	88	(50-150)		
MBLK	Chrysene-d12 (I)			90.2	%	90	(50-150)		
MRL_CHK	Chrysene-d12 (I)			79.4	%	79	(50-150)		
MS_201006120045	Chrysene-d12 (I)			52.9	%	53	(50-150)		
LCS1	Delta-BHC		2.0	1.91	ug/L	96	(70-130)		
LCS2	Delta-BHC		2.0	1.89	ug/L	94	(70-130)	20	1.1
MBLK	Delta-BHC			<0.05	ug/L				
MRL_CHK	Delta-BHC		0.1	0.110	ug/L	110	(50-150)		
MS_201006120045	Delta-BHC		2.0	1.93	ug/L	96	(70-130)		
LCS1	Di(2-Ethylhexyl)phthalate		2.0	1.8	ug/L	90	(70-130)		
LCS2	Di(2-Ethylhexyl)phthalate		2.0	1.78	ug/L	89	(70-130)	20	1.1
MBLK	Di(2-Ethylhexyl)phthalate			<0.15	ug/L				
MRL_CHK	Di(2-Ethylhexyl)phthalate		0.3	0.392	ug/L	131	(50-150)		
MS_201006120045	Di(2-Ethylhexyl)phthalate	ND	2.0	2.03	ug/L	102	(70-130)		
LCS1	Di-(2-Ethylhexyl)adipate		2.0	1.83	ug/L	91	(70-130)		
LCS2	Di-(2-Ethylhexyl)adipate		2.0	1.83	ug/L	91	(70-130)	20	0.0
MBLK	Di-(2-Ethylhexyl)adipate			<0.15	ug/L				
MRL_CHK	Di-(2-Ethylhexyl)adipate		0.3	0.315	ug/L	105	(50-150)		
MS_201006120045	Di-(2-Ethylhexyl)adipate	ND	2.0	1.37	ug/L	68	(70-130)		
LCS1	Di-n-Butylphthalate		4.0	4.02	ug/L	100	(70-130)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

28/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz (continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
LCS2	Di-n-Butylphthalate		4.0	4.03	ug/L	101	(70-130)	20	0.25
MBLK	Di-n-Butylphthalate			<0.15	ug/L				
MRL_CHK	Di-n-Butylphthalate		0.3	0.346	ug/L	115	(50-150)		
MS_201006120045	Di-n-Butylphthalate	ND	4.0	4.22	ug/L	106	(70-130)		
LCS1	Di-N-octylphthalate		2.0	1.76	ug/L	88	(70-130)		
LCS2	Di-N-octylphthalate		2.0	1.8	ug/L	90	(70-130)	20	2.3
MBLK	Di-N-octylphthalate			<0.05	ug/L				
MRL_CHK	Di-N-octylphthalate		0.1	0.147	ug/L	147	(50-150)		
MS_201006120045	Di-N-octylphthalate		2.0	1.68	ug/L	84	(70-130)		
LCS1	Diazinon (Qualitative)		2.0	1.97	ug/L	99	(70-130)		
LCS2	Diazinon (Qualitative)		2.0	1.93	ug/L	97	(70-130)	20	2.0
MBLK	Diazinon (Qualitative)			<0.05	ug/L				
MRL_CHK	Diazinon (Qualitative)		0.1	0.0960	ug/L	96	(50-150)		
MS_201006120045	Diazinon (Qualitative)	ND	2.0	1.98	ug/L	99	(70-130)		
LCS1	Dibenz(a,h)Anthracene		2.0	1.85	ug/L	93	(70-130)		
LCS2	Dibenz(a,h)Anthracene		2.0	1.82	ug/L	91	(70-130)	20	1.6
MBLK	Dibenz(a,h)Anthracene			<0.025	ug/L				
MRL_CHK	Dibenz(a,h)Anthracene		0.05	0.0620	ug/L	124	(50-150)		
MS_201006120045	Dibenz(a,h)Anthracene	ND	2.0	1.7	ug/L	85	(70-130)		
LCS1	Dichlorvos (DDVP)		2.0	1.82	ug/L	91	(70-130)		
LCS2	Dichlorvos (DDVP)		2.0	1.88	ug/L	94	(70-130)	20	3.2
MBLK	Dichlorvos (DDVP)			<0.025	ug/L				
MRL_CHK	Dichlorvos (DDVP)		0.05	0.0580	ug/L	116	(50-150)		
MS_201006120045	Dichlorvos (DDVP)		2.0	2.02	ug/L	101	(70-130)		
LCS1	Dieldrin		2.0	1.86	ug/L	93	(70-130)		
LCS2	Dieldrin		2.0	1.8	ug/L	90	(70-130)	20	3.3
MBLK	Dieldrin			<0.05	ug/L				
MRL_CHK	Dieldrin		0.1	0.104	ug/L	104	(50-150)		
MS_201006120045	Dieldrin	ND	2.0	1.94	ug/L	97	(70-130)		
LCS1	Diethylphthalate		2.0	2.02	ug/L	101	(70-130)		
LCS2	Diethylphthalate		2.0	2.04	ug/L	102	(70-130)	20	0.99
MBLK	Diethylphthalate			<0.15	ug/L				
MRL_CHK	Diethylphthalate		0.15	0.161	ug/L	107	(50-150)		
MS_201006120045	Diethylphthalate	ND	2.0	2.07	ug/L	104	(70-130)		
LCS1	Dimethoate		2.0	0.696	ug/L	35	(35-100)		
LCS2	Dimethoate		2.0	0.722	ug/L	36	(35-100)	20	3.7
MBLK	Dimethoate			<0.05	ug/L				
MRL_CHK	Dimethoate		0.1	0.0800	ug/L	80	(50-150)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

29/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MS_201006120045	Dimethoate	ND	2.0	1.05	ug/L	52	(34-111)		
LCS1	Dimethylphthalate		2.0	2.00	ug/L	100	(70-130)		
LCS2	Dimethylphthalate		2.0	1.96	ug/L	98	(70-130)	20	2.0
MBLK	Dimethylphthalate			<0.15	ug/L				
MRL_CHK	Dimethylphthalate		0.3	0.331	ug/L	110	(50-150)		
MS_201006120045	Dimethylphthalate	ND	2.0	2.03	ug/L	101	(70-130)		
LCS1	Endosulfan I (Alpha)		2.0	1.67	ug/L	83	(70-130)		
LCS2	Endosulfan I (Alpha)		2.0	1.64	ug/L	82	(70-130)	20	1.8
MBLK	Endosulfan I (Alpha)			<0.05	ug/L				
MRL_CHK	Endosulfan I (Alpha)		0.1	0.0690	ug/L	69	(50-150)		
MS_201006120045	Endosulfan I (Alpha)		2.0	1.69	ug/L	85	(70-130)		
LCS1	Endosulfan II (Beta)		2.0	1.86	ug/L	93	(70-130)		
LCS2	Endosulfan II (Beta)		2.0	1.89	ug/L	94	(70-130)	20	1.6
MBLK	Endosulfan II (Beta)			<0.05	ug/L				
MRL_CHK	Endosulfan II (Beta)		0.1	0.119	ug/L	119	(50-150)		
MS_201006120045	Endosulfan II (Beta)		2.0	1.94	ug/L	97	(70-130)		
LCS1	Endosulfan Sulfate		2.0	1.85	ug/L	93	(70-130)		
LCS2	Endosulfan Sulfate		2.0	1.89	ug/L	95	(70-130)	20	2.1
MBLK	Endosulfan Sulfate			<0.05	ug/L				
MRL_CHK	Endosulfan Sulfate		0.1	0.0980	ug/L	98	(50-150)		
MS_201006120045	Endosulfan Sulfate		2.0	1.94	ug/L	97	(70-130)		
LCS1	Endrin		2.0	2.01	ug/L	101	(70-130)		
LCS2	Endrin		2.0	2.15	ug/L	107	(70-130)	20	6.7
MBLK	Endrin			<0.05	ug/L				
MRL_CHK	Endrin		0.1	0.112	ug/L	112	(50-150)		
MS_201006120045	Endrin	ND	2.0	2.21	ug/L	111	(70-130)		
LCS1	Endrin Aldehyde		2.0	1.93	ug/L	96	(70-130)		
LCS2	Endrin Aldehyde		2.0	1.92	ug/L	96	(70-130)	20	0.52
MBLK	Endrin Aldehyde			<0.05	ug/L				
MRL_CHK	Endrin Aldehyde		0.1	0.107	ug/L	107	(50-150)		
MS_201006120045	Endrin Aldehyde		2.0	1.91	ug/L	95	(70-130)		
LCS1	EPTC		2.0	1.85	ug/L	92	(70-130)		
LCS2	EPTC		2.0	1.81	ug/L	91	(70-130)	20	2.2
MBLK	EPTC			<0.05	ug/L				
MRL_CHK	EPTC		0.1	0.0950	ug/L	95	(50-150)		
MS_201006120045	EPTC		2.0	1.82	ug/L	91	(70-130)		
LCS1	Fluoranthene		2.0	1.92	ug/L	96	(70-130)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

30/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
LCS2	Fluoranthene		2.0	1.89	ug/L	95	(70-130)	20	1.6
MBLK	Fluoranthene			<0.05	ug/L				
MRL_CHK	Fluoranthene		0.05	0.0530	ug/L	106	(50-150)		
MS_201006120045	Fluoranthene	ND	2.0	1.93	ug/L	96	(70-130)		
LCS1	Fluorene		2.0	1.85	ug/L	92	(70-130)		
LCS2	Fluorene		2.0	1.9	ug/L	95	(70-130)	20	2.7
MBLK	Fluorene			<0.05	ug/L				
MRL_CHK	Fluorene		0.05	0.0500	ug/L	100	(50-150)		
MS_201006120045	Fluorene	ND	2.0	1.88	ug/L	94	(70-130)		
LCS1	gamma-Chlordane		2.0	1.94	ug/L	97	(70-130)		
LCS2	gamma-Chlordane		2.0	1.96	ug/L	98	(70-130)	20	1.0
MBLK	gamma-Chlordane			<0.025	ug/L				
MRL_CHK	gamma-Chlordane		0.05	0.0570	ug/L	114	(50-150)		
MS_201006120045	gamma-Chlordane	ND	2.0	1.87	ug/L	94	(70-130)		
LCS1	Heptachlor		2.0	1.84	ug/L	92	(70-130)		
LCS2	Heptachlor		2.0	1.82	ug/L	91	(70-130)	20	1.1
MBLK	Heptachlor			<0.015	ug/L				
MRL_CHK	Heptachlor		0.04	0.0460	ug/L	115	(50-150)		
MS_201006120045	Heptachlor	ND	2.0	1.97	ug/L	98	(70-130)		
LCS1	Heptachlor Epoxide (isomer B)		2.0	1.78	ug/L	89	(70-130)		
LCS2	Heptachlor Epoxide (isomer B)		2.0	1.76	ug/L	88	(70-130)	20	1.1
MBLK	Heptachlor Epoxide (isomer B)			<0.025	ug/L				
MRL_CHK	Heptachlor Epoxide (isomer B)		0.05	0.0560	ug/L	112	(50-150)		
MS_201006120045	Heptachlor Epoxide (isomer B)	ND	2.0	1.86	ug/L	93	(70-130)		
LCS1	Hexachlorobenzene		2.0	1.8	ug/L	90	(70-130)		
LCS2	Hexachlorobenzene		2.0	1.8	ug/L	90	(70-130)	20	0.0
MBLK	Hexachlorobenzene			<0.025	ug/L				
MRL_CHK	Hexachlorobenzene		0.05	0.0510	ug/L	102	(50-150)		
MS_201006120045	Hexachlorobenzene	ND	2.0	1.76	ug/L	88	(70-130)		
LCS1	Hexachlorocyclopentadiene		2.0	1.8	ug/L	90	(70-130)		
LCS2	Hexachlorocyclopentadiene		2.0	1.73	ug/L	87	(70-130)	20	4.0
MBLK	Hexachlorocyclopentadiene			<0.025	ug/L				
MRL_CHK	Hexachlorocyclopentadiene		0.05	0.0410	ug/L	82	(50-150)		
MS_201006120045	Hexachlorocyclopentadiene	ND	2.0	1.86	ug/L	93	(70-130)		
LCS1	Indeno(1,2,3,c,d)Pyrene		2.0	1.85	ug/L	92	(70-130)		
LCS2	Indeno(1,2,3,c,d)Pyrene		2.0	1.85	ug/L	93	(70-130)	20	0.0
MBLK	Indeno(1,2,3,c,d)Pyrene			<0.025	ug/L				
MRL_CHK	Indeno(1,2,3,c,d)Pyrene		0.05	0.0660	ug/L	132	(50-150)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

31/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MS_201006120045	Indeno(1,2,3,c,d)Pyrene	ND	2.0	1.73	ug/L	86	(70-130)		
LCS1	Isophorone		2.0	1.83	ug/L	91	(70-130)		
LCS2	Isophorone		2.0	1.83	ug/L	91	(70-130)	20	0.0
MBLK	Isophorone			<0.25	ug/L				
MRL_CHK	Isophorone		0.1	0.113	ug/L	113	(50-150)		
MS_201006120045	Isophorone	ND	2.0	1.86	ug/L	93	(70-130)		
LCS1	Lindane		2.0	1.78	ug/L	89	(70-130)		
LCS2	Lindane		2.0	1.87	ug/L	94	(70-130)	20	4.9
MBLK	Lindane			<0.02	ug/L				
MRL_CHK	Lindane		0.04	0.0460	ug/L	115	(50-150)		
MS_201006120045	Lindane	ND	2.0	1.82	ug/L	91	(70-130)		
LCS1	Malathion		2.0	2.07	ug/L	103	(70-130)		
LCS2	Malathion		2.0	2.03	ug/L	101	(70-130)	20	2.0
MBLK	Malathion			<0.05	ug/L				
MRL_CHK	Malathion		0.1	0.103	ug/L	103	(50-150)		
MS_201006120045	Malathion		2.0	2.1	ug/L	105	(70-130)		
LCS1	Methoxychlor		2.0	2.06	ug/L	103	(70-130)		
LCS2	Methoxychlor		2.0	2.02	ug/L	101	(70-130)	20	2.0
MBLK	Methoxychlor			<0.05	ug/L				
MRL_CHK	Methoxychlor		0.1	0.145	ug/L	145	(50-150)		
MS_201006120045	Methoxychlor	ND	2.0	2.77	ug/L	<u>139</u>	(70-130)		
LCS1	Metolachlor		2.0	2.02	ug/L	101	(70-130)		
LCS2	Metolachlor		2.0	2.00	ug/L	100	(70-130)	20	1
MBLK	Metolachlor			<0.025	ug/L				
MRL_CHK	Metolachlor		0.05	0.0520	ug/L	104	(50-150)		
MS_201006120045	Metolachlor	ND	2.0	2.09	ug/L	105	(70-130)		
LCS1	Metribuzin		2.0	1.37	ug/L	<u>68</u>	(70-130)		
LCS2	Metribuzin		2.0	1.42	ug/L	71	(70-130)	20	3.6
MBLK	Metribuzin			<0.05	ug/L				
MRL_CHK	Metribuzin		0.05	0.0500	ug/L	100	(50-150)		
MS_201006120045	Metribuzin	ND	2.0	1.87	ug/L	93	(70-130)		
LCS1	Molinate		2.0	1.95	ug/L	98	(70-130)		
LCS2	Molinate		2.0	1.99	ug/L	100	(70-130)	20	2.0
MBLK	Molinate			<0.05	ug/L				
MRL_CHK	Molinate		0.1	0.110	ug/L	110	(50-150)		
MS_201006120045	Molinate	ND	2.0	2.04	ug/L	102	(70-130)		
LCS1	Naphthalene		2.0	1.86	ug/L	93	(70-130)		
LCS2	Naphthalene		2.0	1.74	ug/L	87	(70-130)	20	6.7

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

32/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MBLK	Naphthalene			<0.05	ug/L				
MRL_CHK	Naphthalene		0.1	0.106	ug/L	106	(50-150)		
MS_201006120045	Naphthalene		2.0	1.82	ug/L	91	(70-130)		
LCS1	Parathion		2.0	1.86	ug/L	93	(70-130)		
LCS2	Parathion		2.0	1.85	ug/L	92	(70-130)	20	0.54
MBLK	Parathion			<0.05	ug/L				
MRL_CHK	Parathion		0.1	0.145	ug/L	145	(50-150)		
MS_201006120045	Parathion		2.0	1.99	ug/L	99	(70-130)		
LCS1	Pendimethalin		2.0	1.91	ug/L	95	(70-130)		
LCS2	Pendimethalin		2.0	1.84	ug/L	92	(70-130)	20	3.7
MBLK	Pendimethalin			<0.05	ug/L				
MRL_CHK	Pendimethalin		0.1	0.148	ug/L	148	(50-150)		
MS_201006120045	Pendimethalin		2.0	1.9	ug/L	95	(70-130)		
LCS1	Pentachlorophenol		8.0	7.15	ug/L	89	(70-130)		
LCS2	Pentachlorophenol		8.0	7.19	ug/L	90	(70-130)	20	0.56
MBLK	Pentachlorophenol			<0.6	ug/L				
MRL_CHK	Pentachlorophenol		0.5	0.603	ug/L	121	(50-150)		
MS_201006120045	Pentachlorophenol	ND	8.0	7.48	ug/L	94	(70-130)		
LCS1	Permethrin (mixed isomers)		4.0	3.83	ug/L	96	(70-130)		
LCS2	Permethrin (mixed isomers)		4.0	3.73	ug/L	93	(70-130)	20	2.6
MBLK	Permethrin (mixed isomers)			<0.1	ug/L				
MRL_CHK	Permethrin (mixed isomers)		0.15	0.325	ug/L	<u>217</u>	(50-150)		
MS_201006120045	Permethrin (mixed isomers)		4.0	3.97	ug/L	99	(70-130)		
LCS1	Perylene-d12 (S)			92.9	%	93	(70-130)		
LCS2	Perylene-d12 (S)			95.6	%	96	(70-130)		
MBLK	Perylene-d12 (S)			75.5	%	76	(70-130)		
MRL_CHK	Perylene-d12 (S)			80.8	%	81	(70-130)		
MS_201006120045	Perylene-d12 (S)			96.1	%	96	(70-130)		
LCS1	Phenanthrene		2.0	1.74	ug/L	87	(70-130)		
LCS2	Phenanthrene		2.0	1.75	ug/L	88	(70-130)	20	1.1
MBLK	Phenanthrene			<0.02	ug/L				
MRL_CHK	Phenanthrene		0.02	0.0210	ug/L	105	(50-150)		
MS_201006120045	Phenanthrene	ND	2.0	1.84	ug/L	92	(70-130)		
LCS1	Phenanthrene-d10 (I)			90.8	%	91	(50-150)		
LCS2	Phenanthrene-d10 (I)			88.3	%	88	(50-150)		
MBLK	Phenanthrene-d10 (I)			100	%	100	(50-150)		
MRL_CHK	Phenanthrene-d10 (I)			96.6	%	97	(50-150)		
MS_201006120045	Phenanthrene-d10 (I)			78.4	%	78	(50-150)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

33/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
LCS1	Propachlor		2.0	1.98	ug/L	99	(70-130)		
LCS2	Propachlor		2.0	2.02	ug/L	101	(70-130)	20	2.0
MBLK	Propachlor			<0.025	ug/L				
MRL_CHK	Propachlor		0.05	0.0610	ug/L	122	(50-150)		
MS_201006120045	Propachlor	ND	2.0	2.03	ug/L	102	(70-130)		
LCS1	Pyrene		2.0	1.94	ug/L	97	(70-130)		
LCS2	Pyrene		2.0	1.93	ug/L	96	(70-130)	20	0.52
MBLK	Pyrene			<0.025	ug/L				
MRL_CHK	Pyrene		0.05	0.0540	ug/L	108	(50-150)		
MS_201006120045	Pyrene	ND	2.0	1.96	ug/L	98	(70-130)		
LCS1	Simazine		2.0	1.54	ug/L	77	(70-130)		
LCS2	Simazine		2.0	1.67	ug/L	84	(70-130)	20	8.1
MBLK	Simazine			<0.025	ug/L				
MRL_CHK	Simazine		0.05	0.0590	ug/L	118	(50-150)		
MS_201006120045	Simazine	ND	2.0	1.93	ug/L	97	(70-130)		
LCS1	Terbacil		2.0	1.67	ug/L	83	(70-130)		
LCS2	Terbacil		2.0	1.65	ug/L	82	(70-130)	20	1.2
MBLK	Terbacil			<0.05	ug/L				
MRL_CHK	Terbacil		0.1	0.132	ug/L	132	(50-150)		
MS_201006120045	Terbacil		2.0	2.13	ug/L	107	(70-130)		
LCS1	Terbuthylazine		2.0	2.08	ug/L	104	(70-130)		
LCS2	Terbuthylazine		2.0	2.1	ug/L	105	(70-130)	20	0.96
MBLK	Terbuthylazine			<0.2	ug/L				
MRL_CHK	Terbuthylazine		0.1	0.115	ug/L	115	(50-150)		
MS_201006120045	Terbuthylazine		2.0	2.07	ug/L	103	(70-130)		
LCS1	Thiobencarb		2.0	1.98	ug/L	99	(70-130)		
LCS2	Thiobencarb		2.0	1.99	ug/L	100	(70-130)	20	0.50
MBLK	Thiobencarb			<0.1	ug/L				
MRL_CHK	Thiobencarb		0.1	0.103	ug/L	103	(50-150)		
MS_201006120045	Thiobencarb	ND	2.0	2.07	ug/L	103	(70-130)		
LCS1	trans-Nonachlor		2.0	1.91	ug/L	96	(70-130)		
LCS2	trans-Nonachlor		2.0	1.9	ug/L	95	(70-130)	20	0.53
MBLK	trans-Nonachlor			<0.025	ug/L				
MRL_CHK	trans-Nonachlor		0.05	0.0470	ug/L	94	(50-150)		
MS_201006120045	trans-Nonachlor	ND	2.0	1.83	ug/L	92	(70-130)		
LCS1	Trifluralin		2.0	1.93	ug/L	97	(70-130)		
LCS2	Trifluralin		2.0	2.01	ug/L	100	(70-130)	20	4.1
MBLK	Trifluralin			<0.05	ug/L				

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

34/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)



MWH

LABORATORIES

A Division of MWH Americas, Inc.

750 Royal Oak Dr., Suite 100
Monrovia, California, 91016-3629
Tel: 626 386 1100
Fax: 626 386 1101
1 800 566 LABS (1 800 566 5227)

Laboratory
QC Report: 335889

City of Santa Cruz
(continued)

QC Type	Analyte	Native	Spiked	Recovered	Units	Yield (%)	Limits (%)	RPDLimit (%)	RPD%
MRL_CHK	Trifluralin		0.1	0.125	ug/L	125	(50-150)		
MS_201006120045	Trifluralin	ND	2.0	2.01	ug/L	101	(70-130)		
LCS1	Triphenylphosphate (S)			109	%	109	(70-130)		
LCS2	Triphenylphosphate (S)			109	%	109	(70-130)		
MBLK	Triphenylphosphate (S)			109	%	109	(70-130)		
MRL_CHK	Triphenylphosphate (S)			105	%	105	(70-130)		
MS_201006120045	Triphenylphosphate (S)			105	%	105	(70-130)		

Spike recovery is already corrected for native results.

Spikes which exceed Limits and Method Blanks with positive results are highlighted by Underlining.

Criteria for MS and Dup are advisory only, batch control is based on LCS or CCC. Criteria for duplicates are advisory only, unless otherwise specified in the method.

(S) Indicates surrogate compound.

35/43

(I) Indicates internal standard compound.

RPD not calculated for LCS2 when different a concentration than LCS1 is used

RPD not calculated for Duplicates when the result is not five times the MRL (Minimum Reporting Level)

ORGANIC CHEMICAL ANALYSIS (11/07)

Date of Report: 6/28/2010

Sample ID No.: 201006120044 - 335889

Laboratory Name: MWH Laboratories

Signature Lab Director: _____

Name of Sampler: _____

Employed by: _____

Date/Time Sample Collected: 6/10/2010 0945

Date/Time Received @Lab: 06/11/2010

Date Analyses Completed: 6/25/2010

System Name: XXXXXXXXXXXX

System Number: XXXXXXXX

Variable ID: _____

COC ID: Auto Plaza Deep MW_AP_DEEP

Name or Number of Sample Source: _____

User ID: _____ **Station number:** XXXXXXXX-XXX

Date/Time of Sample: 10 06 10 0945 **Laboratory Code:** |9|5|9|0|
 YY MM DD TTTT **Date Analyses completed:** 10 06 25
 YY MM DD

Submitted by: Hugh Dalton Phone# 831-420-5484

TEST METHOD	CHEMICAL ALL CHEMICALS EXCEPT 2,3,7,8 TCDD (DIOXIN) reported uG/L	ENTRY #	ANALYSES RESULTS	MCL ug/L	DLR ug/L
-------------	---	---------	------------------	----------	----------

REGULATED ORGANIC CHEMICALS

525.2	Lindane (gamma-BHC)	ug/L	39340	<0.2	0.2	0.2
525.2	Methoxychlor	ug/L	39480	<10.0	30	10.0
525.2	Diethylhexylphthalate (DEHP)	ug/L	39100	<3.0	4	3.0
525.2	Atrazine (Aatrex)	ug/L	39033	<0.5	1	0.5
525.2	Molinate (Ordram)	ug/L	82199	<2	20	2
525.2	Simazine (Princep)	ug/L	39055	<1	4	1
525.2	Thiobencarb (Bolero)	ug/L	A-001	<1.0	70	1.0
525.2	Alachlor (Alanex)	ug/L	77825	<1.0	2	1.0
525.2	Benzo(a)pyrene	ug/L	34247	<0.1	0.2	0.1
525.2	Di(2-ethylhexyl) Adipate	ug/L	A-026	<5.0	400	5.0
525.2	Hexachlorobenzene	ug/L	39700	<0.5	1	0.5
525.2	Hexachlorocyclopentadiene	ug/L	34386	<1.0	50	1.0

UNREGULATED ORGANIC CHEMICALS

525.2	2,4-Dinitrotoluene	ug/L	34611	<0.1		
525.2	Aldrin	ug/L	39330	<0.075		0.075
525.2	Bromacil (Hyvar)	ug/L	82198	<10.0		10.0
525.2	Butachlor	ug/L	77860	<0.38		0.38
525.2	Diazinon	ug/L	39570	<0.1		
525.2	Metribuzin	ug/L	81408	<0.05		
525.2	Propachlor	ug/L	38533	<0.5		0.5
525.2	Metolachlor	ug/L	39356	<0.05		

TEST METHOD	CHEMICAL ALL CHEMICALS EXCEPT 2,3,7,8 TCDD (DIOXIN) reported uG/L	ENTRY #	ANALYSES RESULTS	MCL ug/L	DLR ug/L
525.2	Dimethoate (Cygon)	ug/L	38458	<0.1	
Pharmaceuticals and Surrogates:					
525.2	Caffeine	ug/L	81436	<0.05	

TEST METHOD	CHEMICAL ALL CHEMICALS EXCEPT 2,3,7,8 TCDD (DIOXIN) reported uG/L	ENTRY #	ANALYSES RESULTS	MCL ug/L	DLR ug/L
525.2	Dimethoate (Cygon)	ug/L 38458	<0.1		
Pharmaceuticals and Surrogates:					
525.2	Caffeine	ug/L 81436	<0.05		

ORGANIC CHEMICAL ANALYSIS (11/07)

Date of Report: 6/28/2010

Sample ID No.: 201006120046 - 335889

Laboratory
Name: MWH Laboratories

Signature Lab
Director: _____

Name of Sampler: _____

Employed by: _____

Date/Time Sample
Collected: 6/10/2010 1100

Date/Time
Received @Lab: 06/11/2010

Date Analyses
Completed: 6/25/2010

System Name: XXXXXXXXXXXX

System Number: _____

Variable ID: _____

COC ID: Auto Plaza Shallow MW_AP_SHAL

Name or Number of Sample Source: _____

User ID: _____ **Station number:** _____

Date/Time of Sample: 10 06 10 1100 **Laboratory Code:** |9|5|9|0|
 YY MM DD TTTT Date Analyses completed: 10 06 25
YY MM DD

Submitted by: Hugh Dalton Phone# 831-420-5484

TEST METHOD	CHEMICAL ALL CHEMICALS EXCEPT 2,3,7,8 TCDD (DIOXIN) reported uG/L	ENTRY #	ANALYSES RESULTS	MCL ug/L	DLR ug/L
-------------	---	---------	------------------	----------	----------

REGULATED ORGANIC CHEMICALS

525.2	Lindane (gamma-BHC)	ug/L	39340	<0.2	0.2	0.2
525.2	Methoxychlor	ug/L	39480	<10.0	30	10.0
525.2	Diethylhexylphthalate (DEHP)	ug/L	39100	<3.0	4	3.0
525.2	Atrazine (Aatrex)	ug/L	39033	<0.5	1	0.5
525.2	Molinate (Ordram)	ug/L	82199	<2	20	2
525.2	Simazine (Princep)	ug/L	39055	<1	4	1
525.2	Thiobencarb (Bolero)	ug/L	A-001	<1.0	70	1.0
525.2	Alachlor (Alanex)	ug/L	77825	<1.0	2	1.0
525.2	Benzo(a)pyrene	ug/L	34247	<0.1	0.2	0.1
525.2	Di(2-ethylhexyl) Adipate	ug/L	A-026	<5.0	400	5.0
525.2	Hexachlorobenzene	ug/L	39700	<0.5	1	0.5
525.2	Hexachlorocyclopentadiene	ug/L	34386	<1.0	50	1.0

UNREGULATED ORGANIC CHEMICALS

525.2	2,4-Dinitrotoluene	ug/L	34611	<0.1		
525.2	Aldrin	ug/L	39330	<0.075		0.075
525.2	Bromacil (Hyvar)	ug/L	82198	<10.0		10.0
525.2	Butachlor	ug/L	77860	<0.38		0.38
525.2	Diazinon	ug/L	39570	<0.1		
525.2	Metribuzin	ug/L	81408	<0.05		
525.2	Propachlor	ug/L	38533	<0.5		0.5
525.2	Metolachlor	ug/L	39356	<0.05		

TEST METHOD	CHEMICAL ALL CHEMICALS EXCEPT 2,3,7,8 TCDD (DIOXIN) reported uG/L	ENTRY #	ANALYSES RESULTS	MCL ug/L	DLR ug/L
525.2	Dimethoate (Cygon)	ug/L	38458	<0.1	
Pharmaceuticals and Surrogates:					
525.2	Caffeine	ug/L	81436	<0.05	

ORGANIC CHEMICAL ANALYSIS (11/07)

Date of Report: 6/28/2010

Sample ID No.: 201006120047 - 335889

Laboratory
Name: MWH Laboratories

Signature Lab
Director: _____

Name of Sampler: _____

Employed by: _____

Date/Time Sample
Collected: 6/10/2010 1135

Date/Time
Received @Lab: 06/11/2010

Date Analyses
Completed: 6/25/2010

System Name: XXXXXXXXXXXX

System Number: _____

Variable ID: _____

COC ID: Cory Stree Shallow MW_CORY_SH

Name or Number of Sample Source: _____

User ID: _____	Station number: _____
Date/Time of Sample: 10 06 10 1135 YY MM DD TTTT	Laboratory Code: <u> 9 5 9 0 </u>
	Date Analyses completed: 10 06 25 YY MM DD
Submitted by: <u>Hugh Dalton</u>	Phone# <u>831-420-5484</u>

TEST METHOD	CHEMICAL ALL CHEMICALS EXCEPT 2,3,7,8 TCDD (DIOXIN) reported uG/L	ENTRY #	ANALYSES RESULTS	MCL ug/L	DLR ug/L
-------------	---	---------	------------------	----------	----------

REGULATED ORGANIC CHEMICALS

524.2	Total Trihalomethane(TTHMs)	ug/L	82080	<0.5	80
524.2	Bromodichloromethane	ug/L	32101	<1.0	1.0
524.2	Bromoform	ug/L	32104	<1.0	1.0
524.2	Chloroform(Trichloromethane)	ug/L	32106	<1.0	1.0
524.2	Dibromochloromethane	ug/L	32105	<1.0	1.0
524.2	Benzene	ug/L	34030	<0.5	1 0.5
524.2	Carbon Tetrachloride	ug/L	32102	<0.5	0.5 0.5
524.2	1,2-Dichlorobenzene (o-DCB)	ug/L	34536	<0.5	600 0.5
524.2	1,4-Dichlorobenzene (p-DCB)	ug/L	34571	<0.5	5 0.5
524.2	1,1-Dichloroethane (1,1-DCA)	ug/L	34496	<0.5	5 0.5
524.2	1,2-Dichloroethane (1,2-DCA)	ug/L	34531	<0.5	0.5 0.5
524.2	1,1-Dichloroethylene (1,1-DCE)	ug/L	34501	<0.5	6 0.5
524.2	cis-1,2-Dichloroethylene (c-1,2-DCE)	ug/L	77093	<0.5	6 0.5
524.2	trans-1,2-Dichloroethylene	ug/L	34546	<0.5	10 0.5
524.2	Dichloromethane(Methylene Chloride)	ug/L	34423	<0.5	5 0.5
524.2	1,2-Dichloropropane	ug/L	34541	<0.5	5 0.5
524.2	cis-1,3-Dichloropropene	ug/L	34704	<0.5	0.5 0.5
524.2	trans-1,3-Dichloropropene	ug/L	34699	<0.5	0.5 0.5
524.2	Total 1,3-Dichloropropene	ug/L	34561	<0.5	0.5 0.5
524.2	Ethyl Benzene	ug/L	34371	<0.5	300 0.5
524.2	Methyl Tert-Butyl Ether (MTBE)	ug/L	46491	<3.0	5.0 3.0
524.2	Monochlorobenzene (Chlorobenzene)	ug/L	34301	<0.5	70 0.5
524.2	Styrene	ug/L	77128	<0.5	100 0.5
524.2	1,1,2,2-Tetrachloroethane 42/43	ug/L	34516	<0.5	1 0.5

TEST METHOD	CHEMICAL ALL CHEMICALS EXCEPT 2,3,7,8 TCDD (DIOXIN) reported ug/L	ENTRY #	ANALYSES RESULTS	MCL ug/L	DLR ug/L
524.2	Tetrachloroethylene (PCE)	ug/L 34475	<0.5	5	0.5
524.2	Toluene	ug/L 34010	<0.5	150	0.5
524.2	1,2,4-Trichlorobenzene	ug/L 34551	<0.5	5	0.5
524.2	1,1,1-Trichloroethane(1,1,1-TCA)	ug/L 34506	<0.5	200	0.5
524.2	1,1,2-Trichloroethane(1,1,2-TCA)	ug/L 34511	<0.5	5	0.5
524.2	Trichloroethylene (TCE)	ug/L 39180	<0.5	5	0.5
524.2	Trichlorofluoromethane (FREON 11)	ug/L 34488	<5	150	5
524.2	Trichlorotrifluoroethane(Freon113)	ug/L 81611	<10.0	1200	10.0
524.2	Vinyl Chloride (VC)	ug/L 39175	<0.5	0.5	0.5
524.2	m,p-Xylene	ug/L A-014	<0.5		0.5
524.2	o-Xylene	ug/L 77135	<0.5		0.5
524.2	Total Xylenes (m,p, & o)	ug/L 81551	<1	1750	

UNREGULATED ORGANIC CHEMICALS

524.2	Bromobenzene	ug/L 81555	<0.5		0.5
524.2	tert-Amyl-Methyl Ether (TAME)	ug/L A-034	<3.0		3.0
524.2	Bromochloromethane	ug/L A-012	<0.5		0.5
524.2	Bromomethane (Methyl Bromide)	ug/L 34413	<0.5		0.5
524.2	n-Butylbenzene	ug/L A-010	<0.5		0.5
524.2	tert-Butylbenzene	ug/L 77353	<0.5		0.5
524.2	Chloroethane	ug/L 34311	<0.5		0.5
524.2	Di-isopropyl Ether (DIPE)	ug/L A-036	<3.0		3.0
524.2	Chloromethane (Methyl Chloride)	ug/L 34418	<0.5		0.5
524.2	2-Chlorotoluene	ug/L A-008	<0.5		0.5
524.2	4-Chlorotoluene	ug/L A-009	<0.5		0.5
524.2	Dibromomethane	ug/L 77596	<0.5		0.5
524.2	m-Dichlorobenzene (1,3-DCB)	ug/L 34566	<0.5		0.5
524.2	1,3-Dichloropropane	ug/L 77173	<0.5		0.5
524.2	2,2-Dichloropropane	ug/L 77170	<0.5		0.5
524.2	1,1-Dichloropropene	ug/L 77168	<0.5		0.5
524.2	Dichlorodifluoromethane (Freon 12)	ug/L 34668	<0.5		0.5
524.2	Ethyl-tert-Butyl Ether (ETBE)	ug/L A-033	<3.0		3.0
524.2	Hexachlorobutadiene	ug/L 34391	<0.5		0.5
524.2	Isopropylbenzene (Cumene)	ug/L 77223	<0.5		0.5
524.2	p-Isopropyltoluene	ug/L A-011	<0.5		
524.2	sec-Butylbenzene	ug/L 77350	<0.5		0.5
524.2	Naphthalene	ug/L 34696	<0.5		0.5
524.2	n-Propylbenzene	ug/L 77224	<0.5		0.5

524.2	1,1,1,2-Tetrachloroethane	ug/L 77562	<0.5		0.5
524.2	1,2,3-Trichlorobenzene	ug/L 77613	<0.5		0.5
524.2	1,3,5-Trimethylbenzene	ug/L 77226	<0.5		0.5
524.2	1,2,4-Trimethylbenzene	ug/L 77222	<0.5		0.5
524.2	Methyl ethyl ketone (MEK, Butanone)	ug/L 81595	<5.0		5.0
524.2	Methyl isobutyl ketone (MIBK)	ug/L 81596	<5.0		5.0

524.2	Carbon Disulfide	ug/L 77041	<0.5		0.5
-------	------------------	------------	------	--	-----